

SUBURBAN MANUFACTURING COMPANY, DAYTON, TN. 37321

REFRIGERANT R-22

23

OZ. BY WEIGHT TEST PRESSURE: 300 HI SIDE, 150 LOW SIDE

191432

COOL BTU/HR	HEAT BTU/HR	VOLTS	WATTS	RUNNING AMP	CYC.	PH	START AMP	P.F. %	COMPRESSOR FLA	FAN MOTOR FLA	COMBUSTION AIR MOTOR FLA	
9,370/9,520	12,000	208/230	1090/1135	5.25/5	60	1	30	99	4.3/4.0	1.5/1.4	.35/.32	6.9/6.8

Serviced By


McKAMISH

BUILDING EXCELLENCE

007832

Pittsburgh, PA
Plumbing & HVAC

24 Hour Service: 412.781.6363
Members of MCA, SMACNA, NEBB

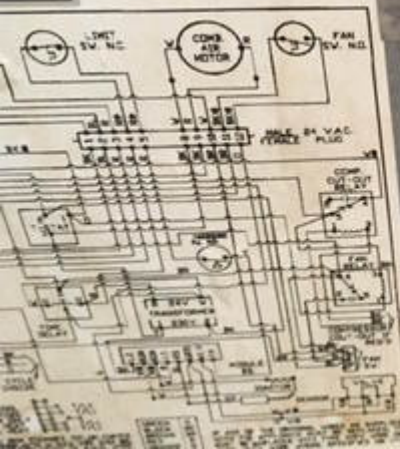

CHAUFFAGE

1. Régler pour débit de chaleur faible ("LOW HEAT").
2. Régler le thermostat à la température désirée. Le thermostat contrôlera automatiquement le chauffage.
REMARQUE: Si un désamorçage se produit, attendre 5 minutes, puis régler le thermostat.
3. Laisser l'appareil se réchauffer durant 2 ou 3 minutes.
4. Pour éteindre, régler à la position d'arrêt ("STOP").

CLIMATISATION

1. Régler pour un débit d'air climatisé faible ("LOW COOL").
2. Régler le thermostat à la température désirée. Le thermostat contrôlera automatiquement la climatisation.
3. Pour éteindre, régler à la position d'arrêt ("STOP").
REMARQUE: Attendre 5 minutes avant d'essayer de redémarrer le système de climatisation en marche s'il vient d'être arrêté.

VENTILATEUR SEULEMENT

1. Régler à la position de ventilation ("FAN ON"). Le ventilateur aspirera l'air dans la pièce.