



Bell & Gossett®

A-C MOTOR



CUST NO 903576 CAT NO

MOD Q K 56A17D57F K

HP 1/4

HZ 60

V 115/208-230 PH 1

RPM 1715 CODE E

A2.8/1.5-1.4 SF 1.35

SFA3.6/1.9-1.8 FR 56Z

AMB 40°C INSUL CLASS B3 NEMA DESIGN

RATING CONT TYPE SC ENC. DP

HZ 50 HP 1/6 CODE

V 110/220 A 2.4/1.2

RPM 1440 SFA

SF 1.0 E6312

TERMINALLY PROTECTED

REF. K1AK60648


- WARNING -

FAILURE TO FOLLOW ALL SAFETY INFORMATION CAN RESULT IN SERIOUS PERSONAL INJURY OR DEATH. DISCONNECT ALL POWER BEFORE SERVICING. INSTALL AND GROUND PER LOCAL AND NATIONAL DISCONNECT POWER SOURCES BEFORE TOUCHING INTERNAL PARTS.

X0246025

ROTATION: CW - OPE

BROWN — ⑤	LOW VOLTAGE	WHITE — ⑤	HIGH VOLTAGE
BLACK — ④	LINE 2	BROWN — ⑥	LINE 2
WHITE — ④	LINE 1	BLACK — ④	LINE 1
9580242	ROTATION = FIXED CW		

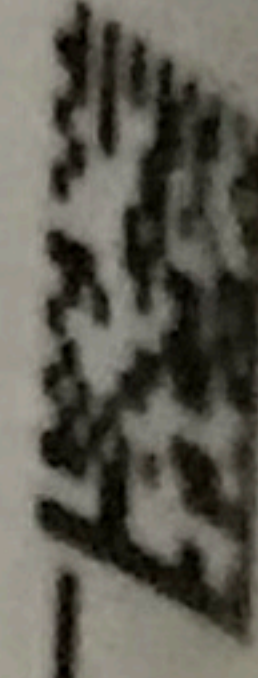

PERMANENTLY LUBRICATED - BALL BEARING

ASSEMBLED IN MEXICO



BELL & GOSSETT

MORTON GROVE, IL, U.S.A.
ASSEMBLED IN U.S.A.

60

PUMP

SIZE

1.85.25

88015

M41

IDENT.
NO.
SERIAL
NO.

172304LF

CSA
ENCL
2





BELL & GOSSETT®
MORTON GROVE, IL, U.S.A.
ASSEMBLED IN U.S.A.

SIZE

60

PUMP

IDENT.
NO.


SERIAL
NO.

K575

32013

1721745


CSA
ENCL
2

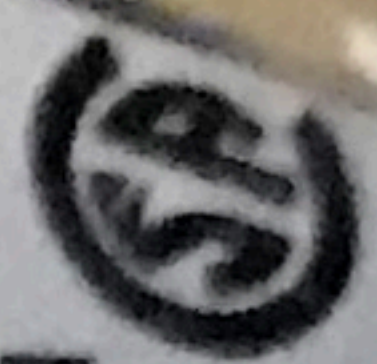

46015

THIS SIDE UP



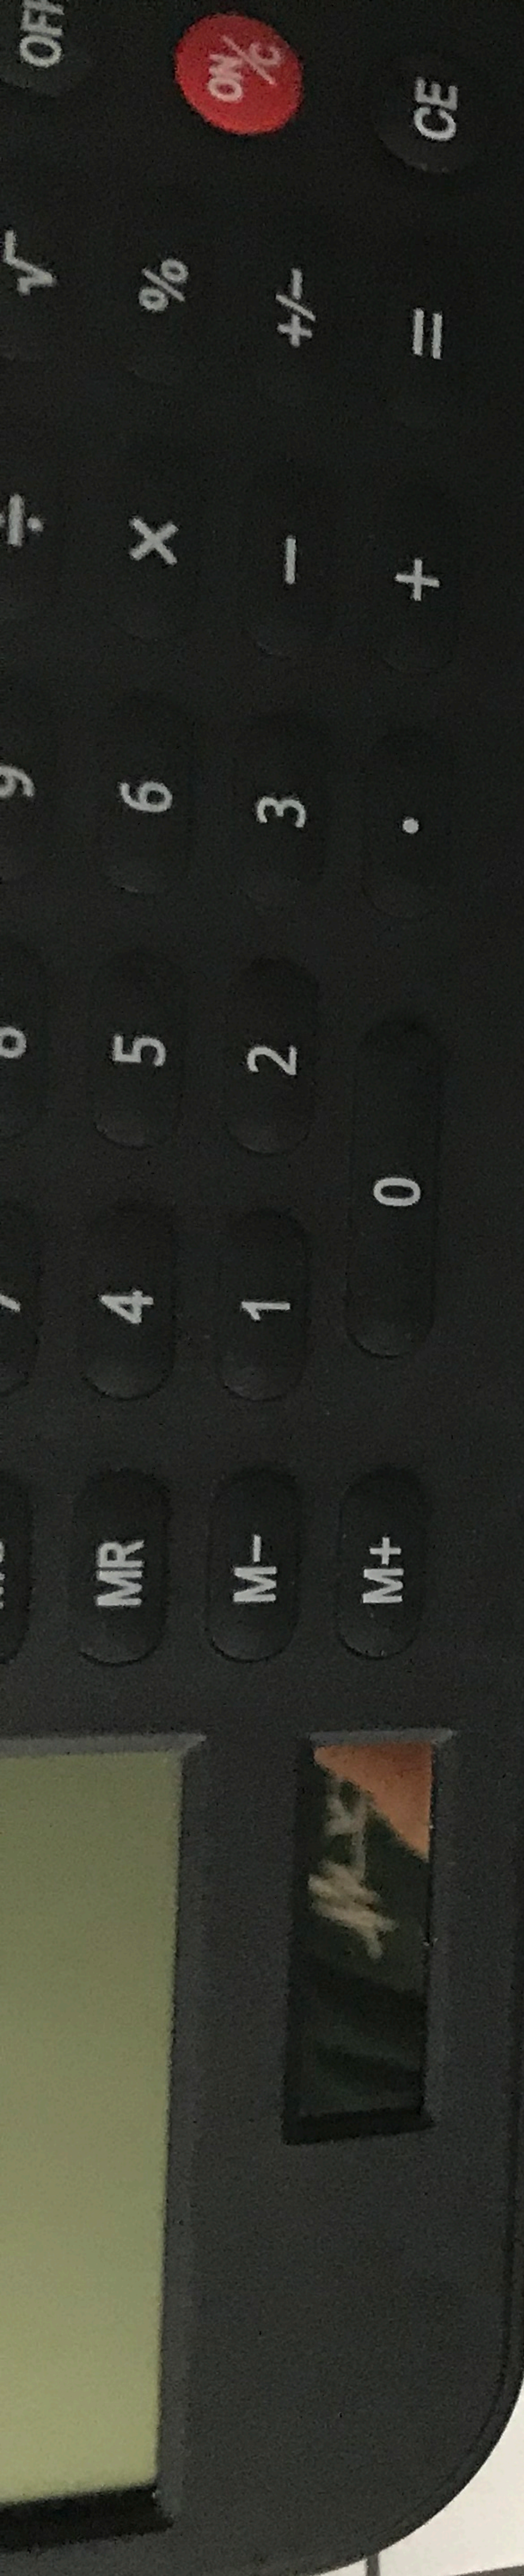

_____ of _____ One copy per piece of equipment

Date: _____
(412) 795-3040
Fax (412) 795-3206

Customer Name: Johnstown Army Reserve Job #: Pm366
Customer Contact: Al Molinski Phone #: 814-244-1912
Address: 288 Aviation drive
Job Location: Johnstown Pa
Equipment Type: Pump Make: Bell & Gossett
Model #: Q 12 56A17057F Serial #: K14K60048
Volts 115/208-230 Phase 1 Equipment Location: Boiler room
Equipment #: Asset # 5003 Area Served: building loop
Filter(s) (qty., size & type): NA
Belt(s) (qty., size & type): NA
Accessibility: Boiler room
Evaluation: Motor on the pump has bad bearings & needs replaced
it is a domestic water pump there are valves to valve it off

Photos Attached: Yes ☐ No ☐ Status: Incomplete ☐ Complete ☐
Other _____ Priority 1-5: ☐ (5 Being High)

Reviewed By: _____ Date: _____ Service Tech: Dom Date: 9-26-18

WHITE - Service Department YELLOW - Job File PINK - Technician