



OneCIS Insurance Company

95 Oakwood Rd
Lake Zurich, IL 60047
(855) 593-5115
www.us.bureauveritas.com



May 20, 2019

44110-007209.00

CMI Management Inc.
Mr. Bernie Koblinsky
PFC Anthony Eafrati USARC
100 Front St
Weirton, WV 26062-4221
bernie.koblinsky@cmimgmt.com

RE: Jurisdictional Inspection:
PFC Anthony Eafrati USARC
100 Front St
Weirton, WV 26062-4221

Thank you for the consideration I received during my visit on May 2, 2019 at your facility listed above. The purpose of the visit was to perform the jurisdictional inspections of the objects listed below to determine compliance with jurisdictional laws and regulations. I was accompanied by Scott Werry of CMI 412-510-7772 during my visit.


The inspections were performed on behalf of CMI Management, Inc. (US Army Reserve Offices).

The following objects were inspected at the time of the visit:

Year Built	Type of object	Jurisdictional Number	NB Number	Recommendations
1900	Cast Iron	WV041-01	0	See Below
1900	Cast Iron	WV041-02	0	See Below

The following observations were noted during the inspection of this equipment:

The following safety equipment was operationally tested satisfactorily as follows: relief valve by hand, low water fuel cut out, operating switch, high temperature shut down.

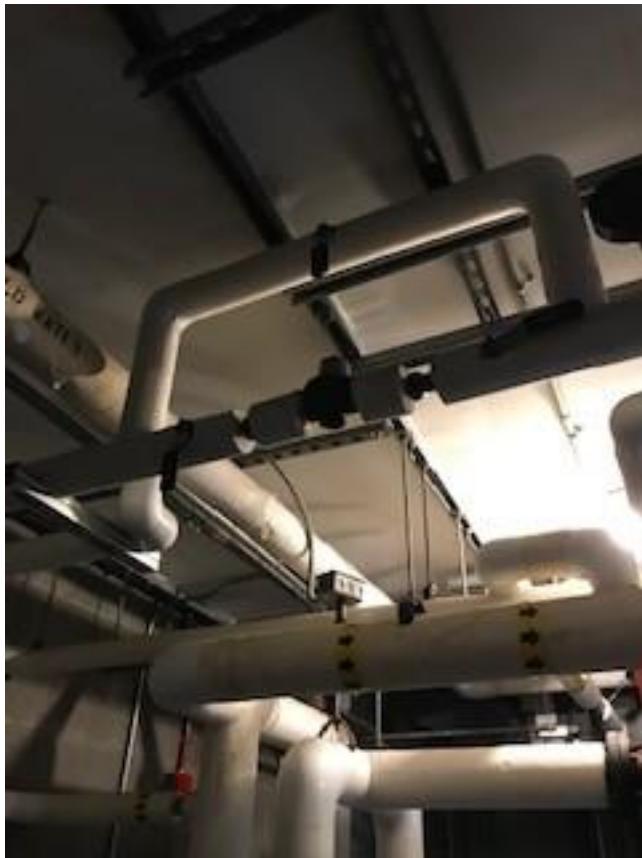

The boiler had the feed water line misaligned.

This led to the boiler firing to keep up demand and the high temperature shut off device with the manual reset did not work, warning of a problem.



OneCIS Insurance Company

95 Oakwood Rd
Lake Zurich, IL 60047
(855) 593-5115
www.us.bureauveritas.com

BUREAU
VERITAS



The recommendations made to correct the deficiencies are listed below.

The next inspection is tentatively scheduled to be completed by 05/02/2020. The OneCIS Operating Certificates are being withheld for the objects with code recommendations listed below:

Recommendations

The following recommendations must be completed.

No. 2019-05-1 - Complete within 30 days
Peerless-WV041-01

Condition: The boiler is not equipped with a high temperature shut off with a manual reset capabilities.

Requirement: Replace the high temperature shut off device with one that has the manual reset capabilities. In accordance with CSD-1,CW-410 (c)

No. 2019-05-2 - Complete within 30 days
Peerless-WV041-02

Condition: The boiler is not equipped with a high temperature shut off device with the manual reset capabilities.

Requirement: Replace the high temperature shut off device with one that has the manual reset capabilities. In accordance with CSD-1,CW-410 (c)

Please contact me by phone at 724-759-9488 or by e-mail at craig.bell@onecis.com if there are any questions and to clear any recommendations.

Sincerely,

Craig Bell

Craig Bell
Boiler & Machinery Inspection Specialist

DISTRIBUTION

Cc:

Thomas Kovach, OneCIS Insurance
Thomas.kovach@onecis.com

FILE

This document is advisory in nature. Reports or certificates provided in connection with any state-required boiler or pressure vessel inspection do not mean that all hazards or conditions were controlled at the time of the inspection. No liability is assumed by the information contained in this document.

Location Detail

Search Criteria: Country: USA; NOB/SIC: ;Address 1: ;City: ;Zip: ;County: ;FIPS Code: ;Status: Active; Order Results by: Location Name; Then Order by: Address

Policy Name: CMI Management, Inc (US Army Reserve Offices) Policy Number: 44110-007209.00

Location: PFC Anthony Eafrati USARC Location ID: 3933724

Address: 100 Front St - Weirton, WV 26062-4221

Phone:

County: Hancock FIPS: 54029 NOB/SIC:

Primary Contact: Bernie Koblinsky - Phone: 703-738-5303 - Email: bernie.koblinsky@cmimgmt.com

Billing Contact: Bernie Koblinsky - 5285 Shawnee Rd Ste 510 Alexandria, VA 22312-2334 - Phone: 703-738-5303 - Email: bernie.koblinsky@cmimgmt.com

Registered Owner's Email (NYC Locations Only):

Juris #	Alt Juris #	Type	Use	NB	Serial	Manufacturer	Year Built	Due Date	Inspect Type	Status	Location
WV041-01		Cast Iron	Hot Water Heating	0		Peerless	1900	05/02/2020	Recurring Cert	Active	bl rrm
WV041-02		Cast Iron	Hot Water Heating	0		Peerless	1900	05/02/2020	Recurring Cert	Active	bl rrm

Total Objects at this Location: 2

Total Objects	2
Total Locations	1
Total Active Objects	2