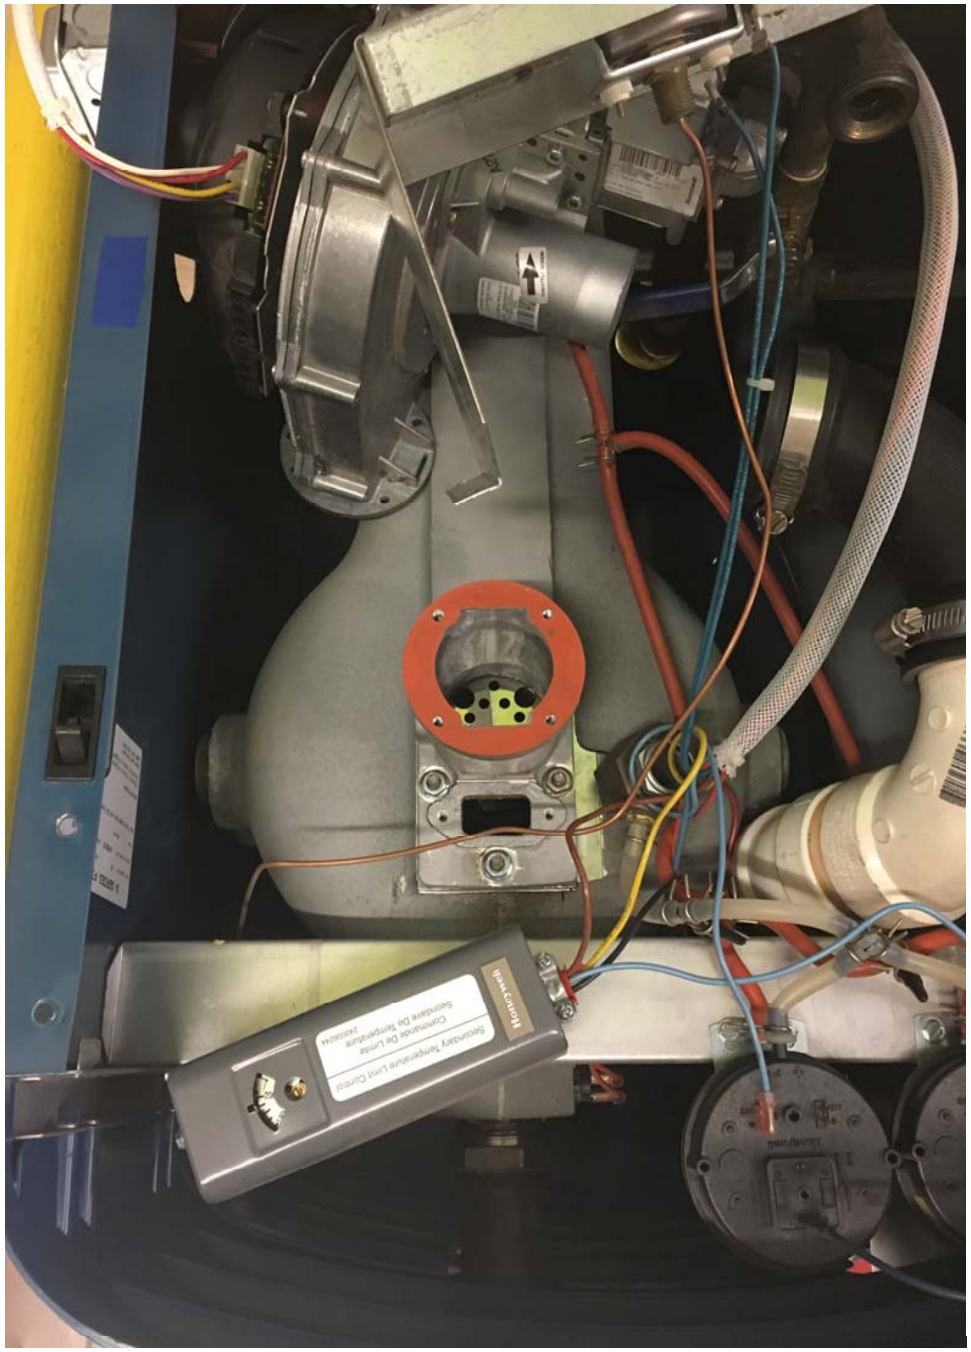
Honeywell
Secondary Temperature Limit Control
Commande De Limite
Secondaire De Temperature


P9017
181905
Be
Boiler

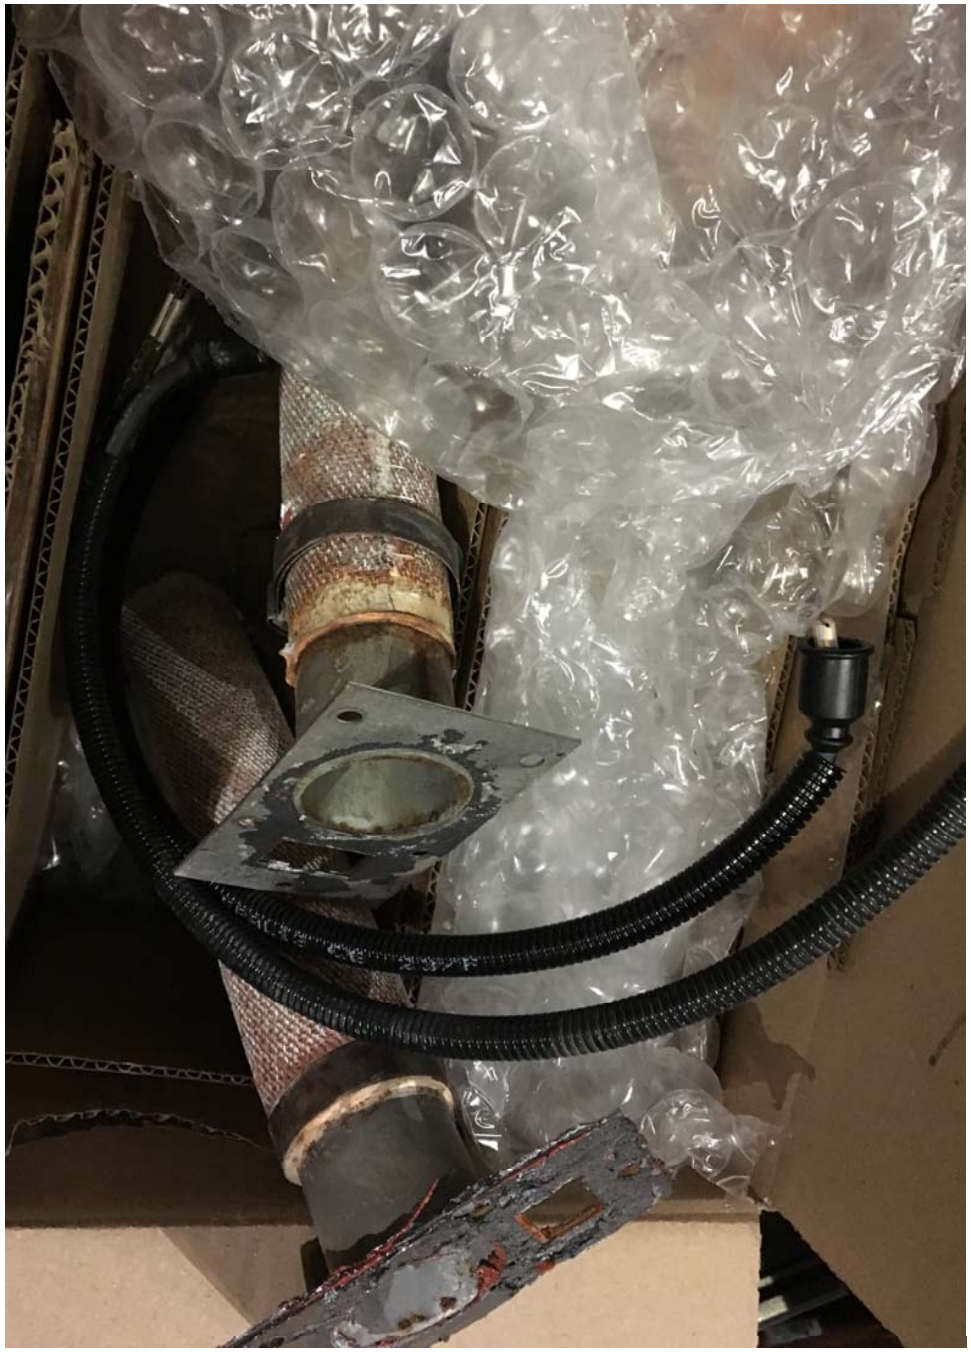

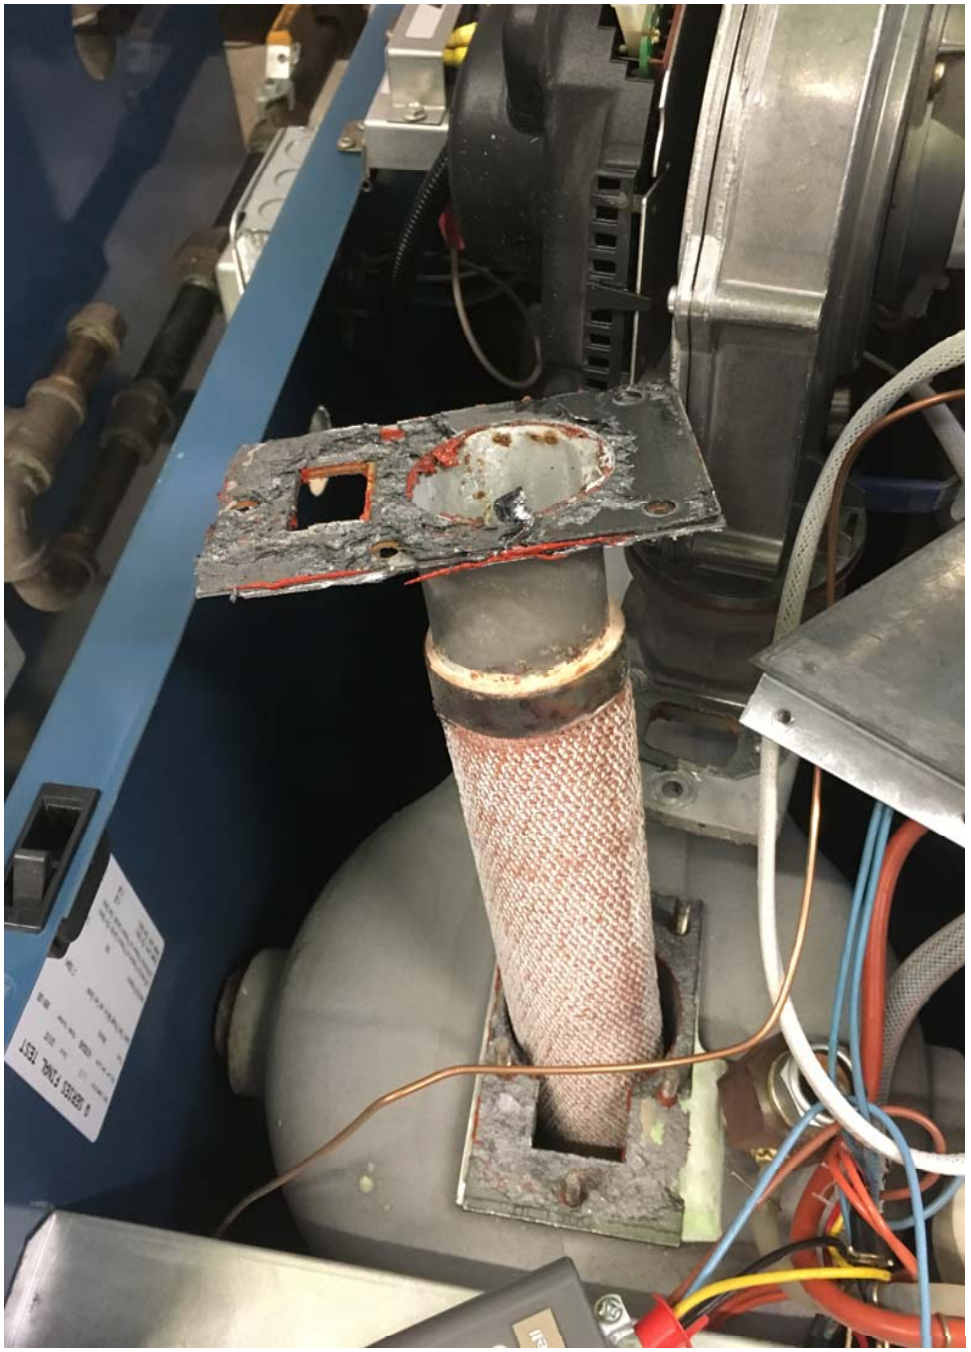

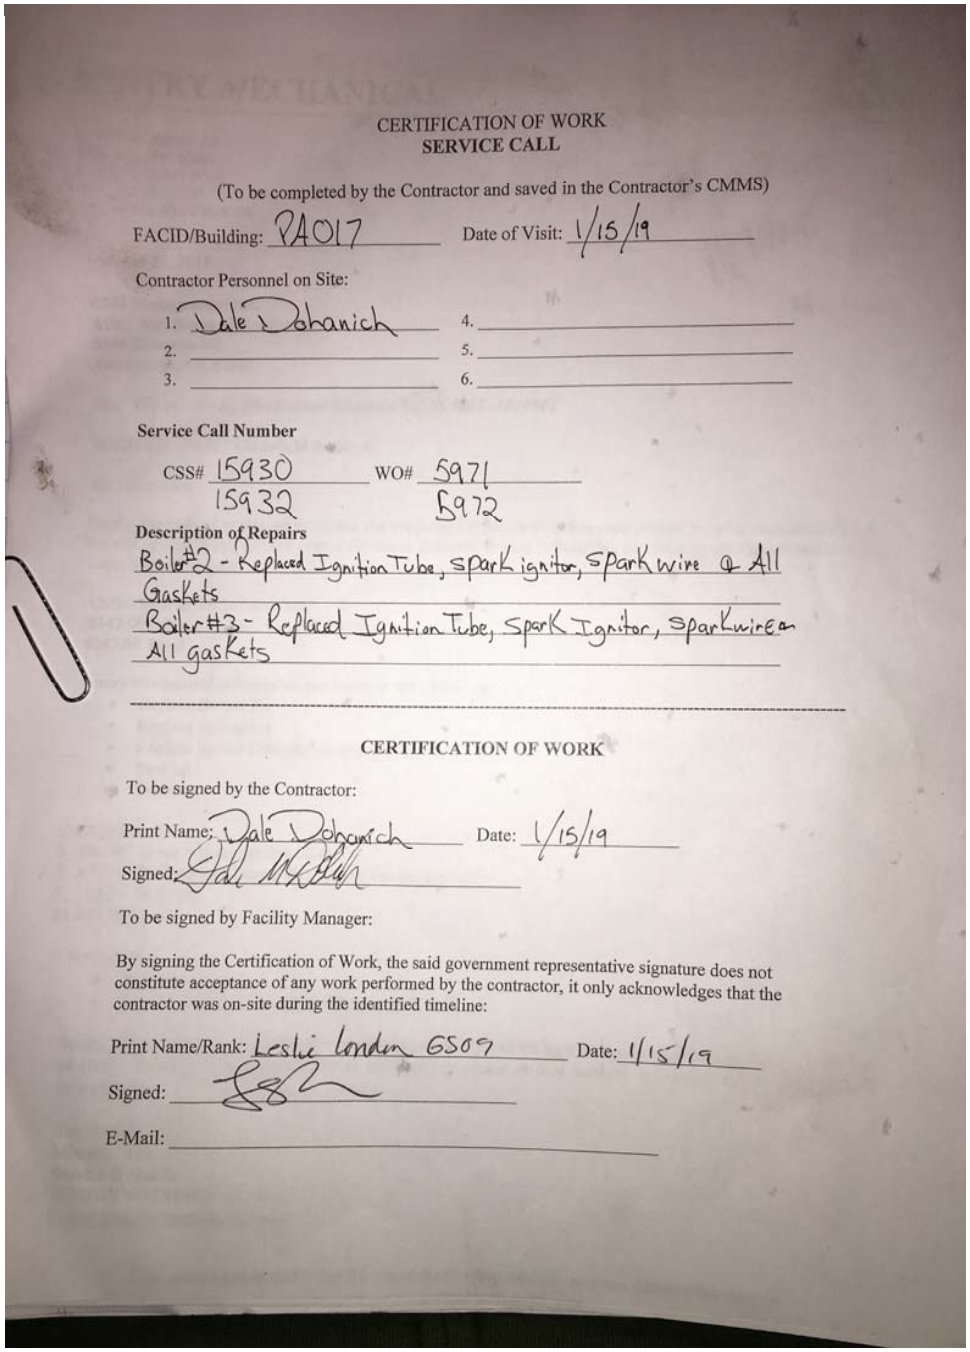

CERTIFICATION OF WORK
SERVICE CALL

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: PA017 Date of Visit: 1/15/19

Contractor Personnel on Site:

1. Dale Dobanich
2. _____
3. _____
4. _____
5. _____
6. _____

Service Call Number

CSS# 15930 WO# 5971
15932 5972

Description of Repairs

Boiler #2 - Replaced Ignition Tube, spark ignitor, Spark wire & All Gaskets
Boiler #3 - Replaced Ignition Tube, Spark Ignitor, Sparkwire & All gaskets

---

CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: Dale Dobanich Date: 1/15/19

Signed: _____

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: Leslie London GS09 Date: 1/15/19

Signed: _____

E-Mail: _____