

**CERTIFICATION OF WORK
PREVENTIVE MAINTENANCE**

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: Pa166-03 Date of Visit: 6-20-19

Contractor Personnel on Site:

- | | |
|--------------------------|----------|
| 1. <u>Dominic Stango</u> | 3. _____ |
| 2. _____ | 4. _____ |

Work Performed:

Preventive Maintenance - Services Completed (Annual, Quarterly, Monthly, equipment identification, etc.)

- | |
|--------------------------------|
| 1. <u>WO# 9148, 9432, 9102</u> |
| 2. _____ |
| 3. _____ |
| 4. _____ |
| 5. _____ |

CERTIFICATION OF WORK

To be signed by the Contractor:

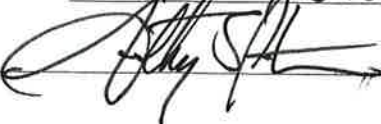
Print Name: Dominic Stango Date: 6-21-19

Signed: 

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: Timothy J Peters Date: 21 June 2019

Signed: 

E-Mail: _____

PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST
EXHAUST FANS

SITE AND BLDG #: Pa166-03

MECHANIC SIGNATURE: [Signature]

DATE: 6-20-19

LOCATION/RM #: 1057 WO# 9107 ASSET # 3483

START TIME: 10

FINISH TIME: 10:18

CHECK POINT	CHECKPOINT DESCRIPTION	TASK COMPLETE		SPECIAL INSTRUCTIONS	NOTES/ACTIONS (IF TASK COMPLETE IS CHECKED NO, PROVIDE EXPLANATION)
		YES	NO		
1	In addition to the procedure(s) outlined in this standard, the equipment manufacturer's recommended maintenance procedure(s) and/or instruction(s) shall be strictly adhered to.	✓			
2	Schedule shutdown with operating personnel, as needed.	✓			
3	Follow lock out/tag out procedures at all times. De-energize or discharge all hydraulic, electrical, mechanical, or thermal energy prior to beginning work.	✓			
TO BE PERFORMED AT EACH INSPECTION SERVICE					
1	Clean unit, especially fan blades.	✓			
2	Inspect pulleys, belts, couplings, etc.; adjust tension and tighten mountings as necessary. Change badly worn belts. Multiple belts should be replaced with matched sets.	✓			
3	Perform required lubrication and remove old or excess lubricant.	✓			
4	Clean motor with vacuum or low pressure dry air (less than 40 psig). Check for obstructions in motor cooling and air flow.	✓			
5	Check structural members, vibration eliminators, and flexible connections. Check fan housing to ensure there is no damage and the housing is tight.	✓			
6	Start unit and check for vibration and noise.	✓			
7	Remove all trash and debris.	✓			

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and direct material cost) per PM occurrence. For any deficiencies found exceeding \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed description of the deficiency.

To be performed by: General Maintenance Worker

Additional Notes: