

Boiler
Contactor

120v



CHILLED WATER SUP. 

CHILLED WATER RET. 

ATC

RELAY




WARRANTY
VALVE SEAL BRONZE

98



ACCESSIBLE
EXIT

Boiler

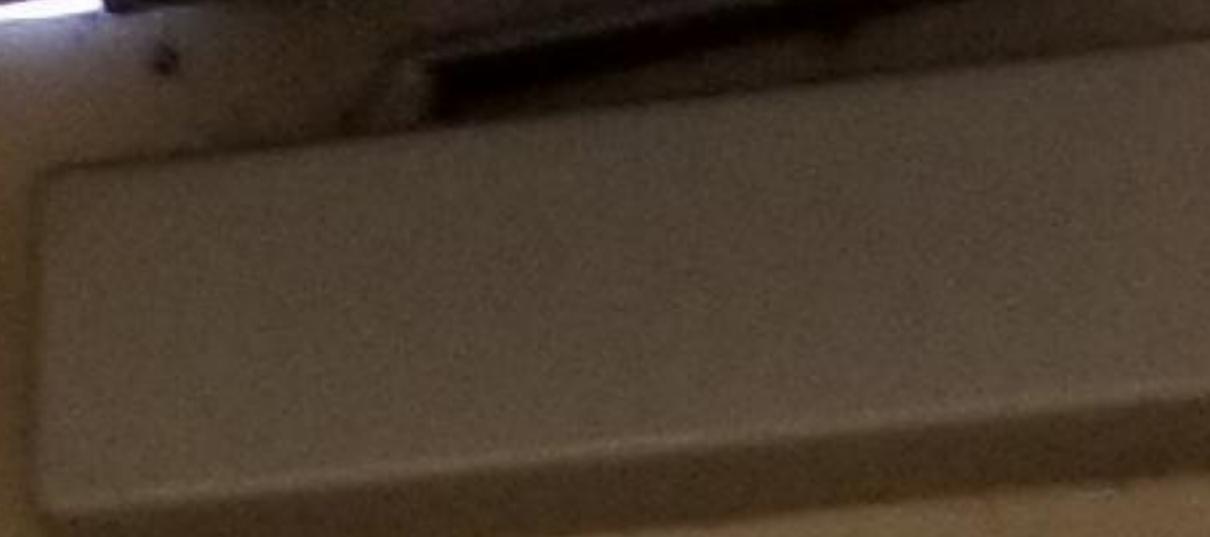

DOUG MOORE

CERTIFICATION OF WORK

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: DE007

Date of Visit: 10/1/19

Contractor Personnel on Site:

1. Doug Moore
2. _____
3. _____
4. _____
5. _____
6. _____

Service Calls – Service Call Number and Description

1. W0# 6466 C55# 16631 Boiler room shut-Down Buttons
2. _____
3. _____

CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: Doug Moore Date: 10/1/19

Signed: Doug Moore

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: D. Bennett, CW Date: 10/1/19

Signed: D. Bennett

E-Mail: _____

759.50