

## CERTIFICATION OF WORK SERVICE CALL

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: NY052 Date of Visit: 12-04-18

Contractor Personnel on Site:

- |                          |                      |
|--------------------------|----------------------|
| 1. <u>Isaac Hartig</u>   | 4. <u>Mike Allen</u> |
| 2. <u>Jeremy Wachley</u> | 5. _____             |
| 3. <u>Krite</u>          | 6. _____             |

Service Call Number

CSS# 16200 WO# 6414

Description of Repairs

Changed out Pressure reducing valve (fill valve)  
and changed out Bearing assembly and gaskets  
on circulator pump.

## CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: Jay Tranello Date: 12/5/18

Signed: J. Tranello


To be signed by Facility Manager:


By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:



Print Name/Rank: \_\_\_\_\_ Date: \_\_\_\_\_

KAWSKI.SCOTT.WILLIAM.10175311  
Digitally signed by  
KAWSKI.SCOTT.WILLIAM.1017531154  
Date: 2018.12.05 11:49:05'00'  
Signed: 54

E-Mail: \_\_\_\_\_

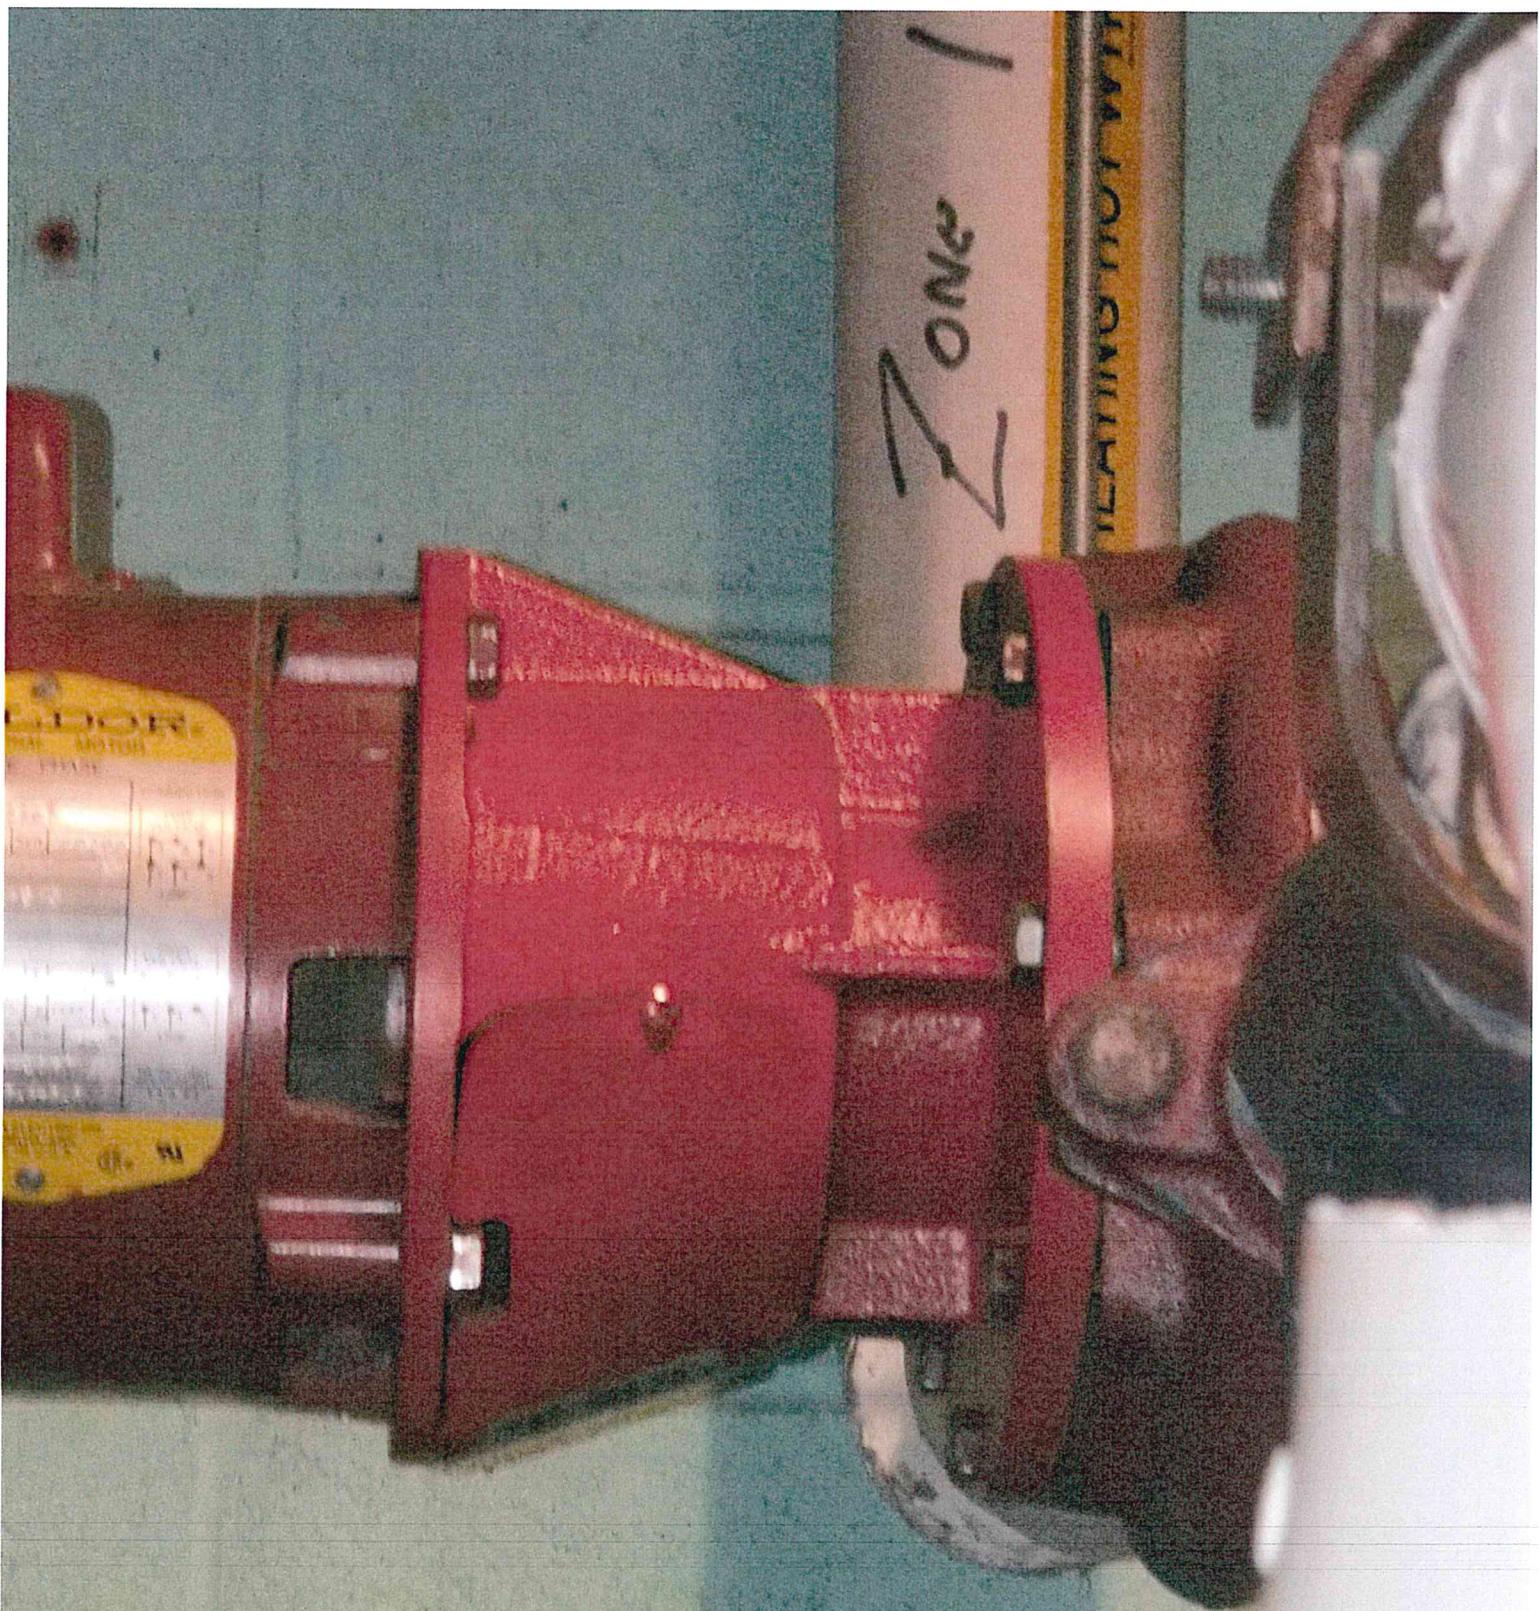

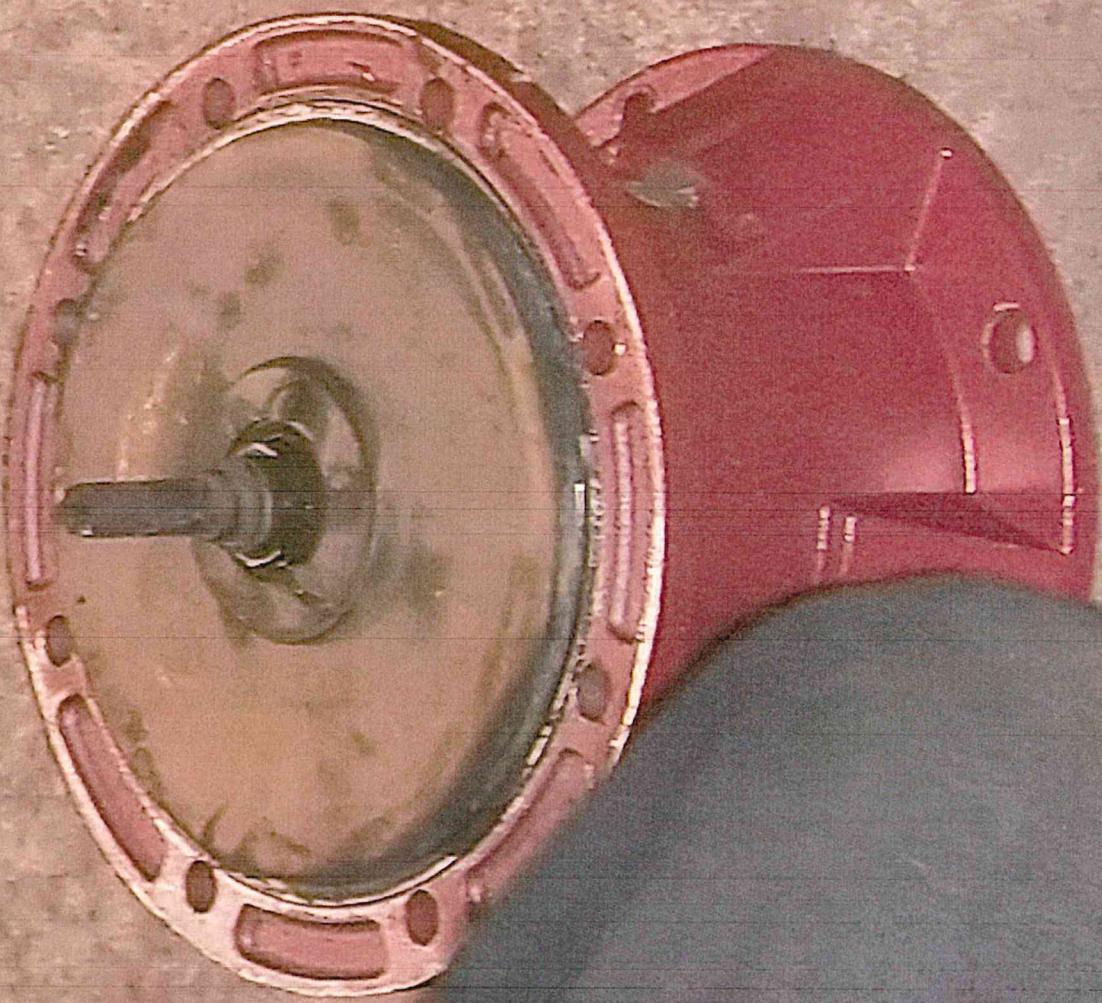

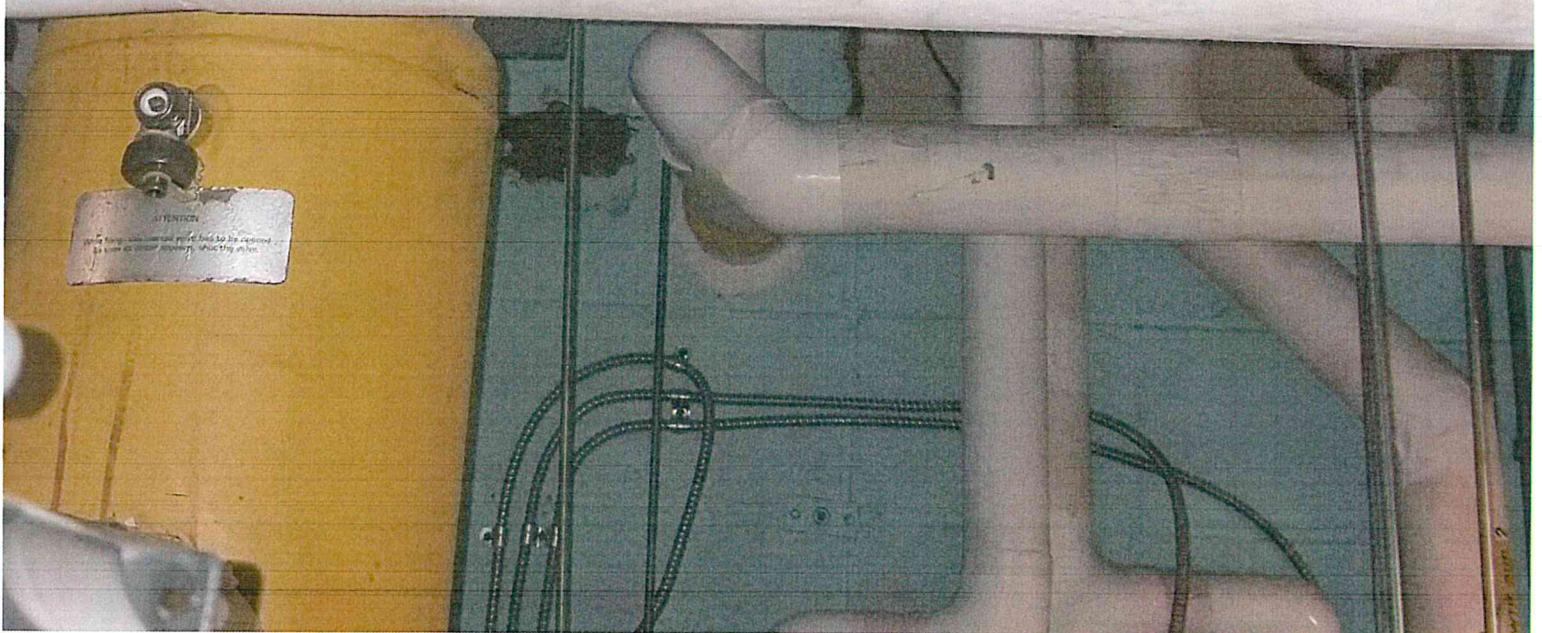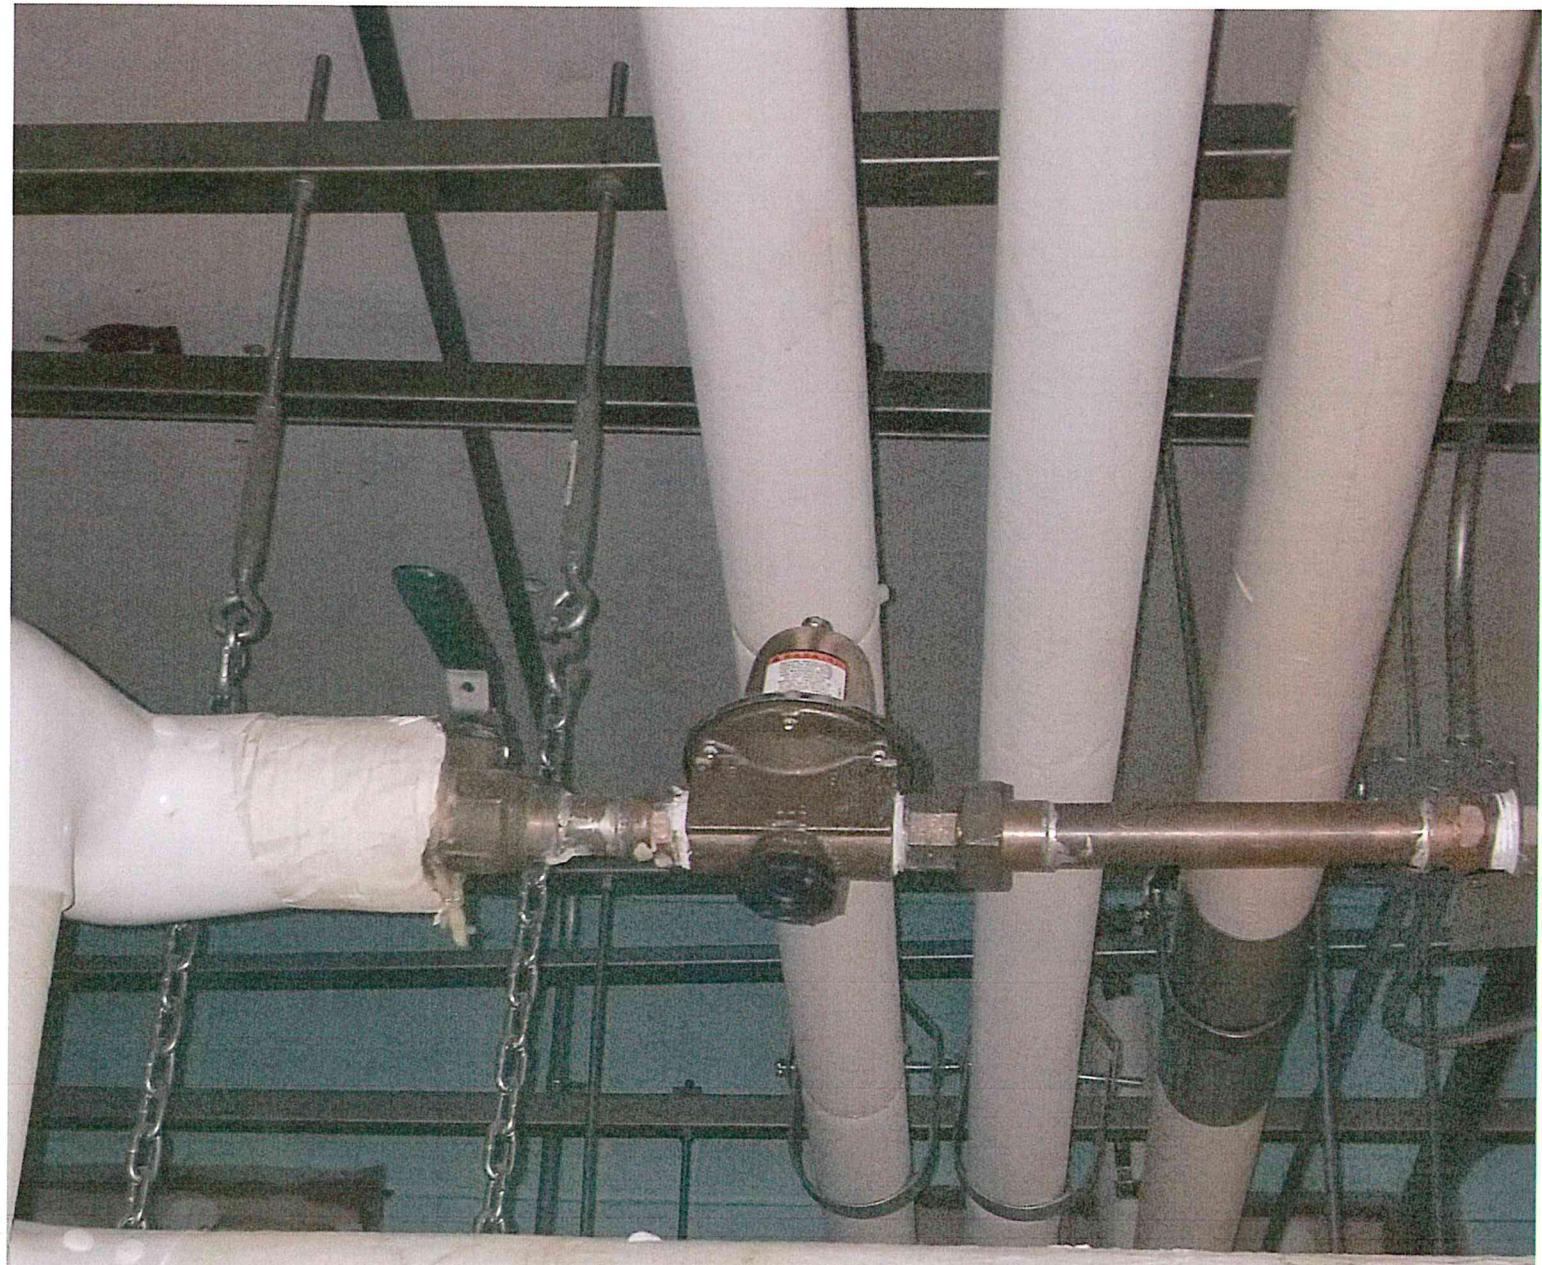



Bell & Gos  
a xylem l

Morton Grove, IL USA



MONROE PIPING & SHEET METAL  
SERVICE/MAINTENANCE

Phone: 482-0200

Tech  
P/C  
PV  
PV  
PV

Work Performed

Date	
10-31-11	Fall PM
11-1-11	Fall PM
11-1-11	Replaced pump seal
11-1-13	PM (bad pump)
11-13-13	Replaced bearing
11-13-13	Assembly charged
11-13-13	comp tank to 12psi

**mp&sm**  
LLC

Monroe Piping & Sheet Metal, LLC  
Mechanical Contractors  
For SERVICE Call (585) 482-0200

