

## Additional Funding Request

<b>DE001</b>	<b>CSS# 16880 WO# 6882 Asset# 1702</b>																			
Description of Repairs	Labor and materials to replace motor in electric Heater.																			
Diagnosis: Initial Work Order	DE001 B-2 bad motor found in electric heater																			
Diagnostic Fee	\$0																			
Additional Labor Cost to Perform Repairs	<p>\$ 400</p> <p>TW Labor \$80/hr x 5</p>																			
Additional Material Cost to Perform Repairs	<p>\$273.46</p> <table border="1"> <tr> <td>New Motor for Electric Heater - NS3900-2032-000</td> <td>1</td> <td>\$233.15</td> <td>\$233.15</td> </tr> <tr> <td>Capacitor Run Oval - G36-259</td> <td>1</td> <td>\$3.48</td> <td>\$3.48</td> </tr> <tr> <td>Freight</td> <td></td> <td></td> <td>\$25.00</td> </tr> <tr> <td>Sales Tax</td> <td></td> <td></td> <td>\$11.83</td> </tr> </table>				New Motor for Electric Heater - NS3900-2032-000	1	\$233.15	\$233.15	Capacitor Run Oval - G36-259	1	\$3.48	\$3.48	Freight			\$25.00	Sales Tax			\$11.83
New Motor for Electric Heater - NS3900-2032-000	1	\$233.15	\$233.15																	
Capacitor Run Oval - G36-259	1	\$3.48	\$3.48																	
Freight			\$25.00																	
Sales Tax			\$11.83																	
<b>PM Credit</b>	<b>(\$250)</b>																			
<b>Total Cost of Repair</b>	<b">\$ 423.46</b">																			



# WORK ESTIMATE

CSS #:

Work Order #:

Emergency

Urgent

Routine

Company Name:	Tidewater, Inc.	Facility ID:	DE001
Contractor POC:	Adam Colopy		
Telephone No:	740-819-6207	Building/Location; (e.g., Classroom/Room #)	Building 2
E-Mail Address:	<a href="mailto:adam.colopy@tideh2o.net">adam.colopy@tideh2o.net</a>		
Assigned Technician(s):	John Brown		

## DESCRIPTION of WORK and EXPLANATION for REPAIRS or REPLACEMENT

Labor and materials to replace bad motor found in electric heater.

LABOR/MATERIAL		MATERIAL/ SUB UNIT DOLLAR AMOUNT	LBR/HR \$80	LINE ITEM TOTAL DOLLAR AMOUNT
ITEM	QUANTITY			
Labor			5	\$400.00
New Motor for Electric Heater - NS3900-2032-000	1	\$233.15		\$233.15
Capacitor Run Oval - G36-259	1	\$3.48		\$3.48
Freight				\$25.00
Sales Tax				\$11.83
<b>SUB-TOTAL COSTS:</b>		<b>Materials Total</b>	<b>\$273.46</b>	<b>Labor</b> \$400.00
			<b>TOTAL</b>	<b>\$673.46</b>



# JOHNSTONE SUPPLY

**REMIT TO:**  
Johnstone Supply  
P.O. Box 9003  
Quakerstown, PA 18951-9003  
610-258-5651  
[JohnstoneSupply.com](http://JohnstoneSupply.com)

**Main Office** 2605 Dearborn Street • Easton, PA 18045 • 610-258-5651  
**Branch Locations:**  
 Reading 3300 N. 5th Street Hwy • Reading, PA 19605 • 610-373-3855  
 Harrisburg 2221 Sycamore Street • Harrisburg, PA 17111 • 717-233-7593  
 Lancaster 340 W. Roseville Rd • Lancaster, PA 17603 • 717-286-0301  
 Rosedale 9100 Yellow Brick Rd Suites A-C3 • Rosedale, MD 21237 • 410-391-5495  
 Arbutus 1660 Sulphur Spring Rd • Arbutus, MD 21227 • 410-565-7390  
 Alexandria 6584 Fleet Drive • Fleet Industrial Park • Alexandria, VA 22310 • 703-719-7770  
 Manassas 8680 Virginia Meadow Drive • Manassas, VA 20109 • 703-530-8990  
 Gaithersburg 9172 Gaffney Road • Gaithersburg, MD 20877 • 301-321-3500

**PRICE QUOTE**

**Page 1**

Printed 01/16/19 CCW

**Quoted**

TIDEWATER, INC  
6625 SELNICK DR  
ELKRIDGE MD 21075  
Buyer: John brown  
Tel: 410-540-8700 Fax: 410-579-1685

**Ship To**

SAME

Quote #	Quote Date	Exp Date	Customer #	Customer P/O #	Ship Via	Writer
<b>Q507677</b>	01/16/2019	01/26/2019	0008752	DELAWARE 01	PICK UP	CCW
Job ID	Customer Terms			Salesman		
NET 10 DAYS PROX						
Product	Description	UM	Quant	Unit Price	Extension	
NS3900-2032-000	3900-2032-000	EA	1	194.29	194.29	
G36-259	* Above is a special order & * * Non-Returnable item x: _____ TOCF3 CAPACITOR RUN OVAL TOCF3 3MFD 440/370V	EA	1	2.90	2.90	
<b>X:</b> <b>(Accepted by)</b>	<b>Sub Total</b> <b>Freight</b> <b>Misc Charges</b> <b>Tax Amount</b>	<b>\$197.19</b> <b>\$25.00</b> <b>\$0.00</b> <b>\$11.83</b>	<b>Total</b>	<b>\$234.02</b>		

**MESSAGE**

Johnstone Supply reserves the right to amend this quote as to the quantity and/or price due to market fluctuations & interruptions in the supply chain and other factors beyond its control.

Johnstone Supply will not be held liable for a) incomplete information provided by the customer b) improper or incorrect system matchups  
Price is based on quoted quantities.

**TERMS**


CAUTION - HAZARD OF ELECTRIC SHOCK. MORE THAN ONE  
DISCONNECT SWITCH MAY BE REQUIRED TO DE-ENERGIZE  
THE EQUIPMENT FOR SERVICING. DO NOT OPERATE  
WITHOUT FRONT COVER IN PLACE.

ATTENTION - RISQUE DE CHOC ÉLECTRIQUE. PLUSieurs  
SECTIONNEURS PEUVENT TRE REQUIS POUR METTRE LE  
MATERIEL HORS TENSION POUR L'ENTRETIEN. NE PAS  
UTILISER SI LE PANNEAU FRONTAL N'EST PAS EN PLACE.

3502-2566-0

CODE

1101

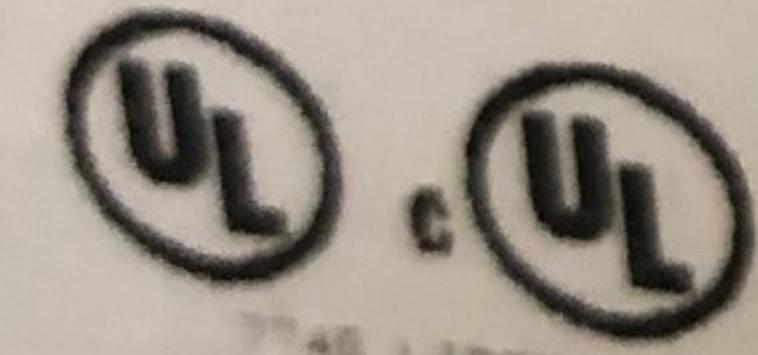

7746 LISTE  
ROUEN MÉTAL

DATE

0 DE

MAXIMA DE

APPEL

Hz  
60  
60

TYPE

00-100

00-100

00-100

S/N 1201 127

3502-2864-000

MOD. NO **S93505203FFB**

DWO

DATE CODE

**1101**

VOLTS **208** KW **5** PH **3** HZ **60**

RATED LINE AMPS: **13.9**

AMPERAJE NOMINAL DE LA LINEA  
PUISANCE NOMINALE DE LA LIGNE, A

RATED LINE AMPS ARE MAXIMUM IN ANY LINE OF CIRCUIT.

EL AMPERAJE NOMINAL DE LAS LINEAS ES EL MAXIMO DE  
CUALQUIER LINEA DEL CIRCUITO.

LA PUISSANCE NOMINALE DE LA LIGNE (A) EST LE MAXIMIM DE  
TOUTES LES LIGNES DU CIRCUIT.

MOTOR

\*1

\*2

AMPS  
1.2

VOLTS  
208

HP  
1/8

PHASE  
1

Hz

60

60

MOTORS ARE THERMALLY PROTECTED.

LOS MOTORES TIENEN PROTECCION TERMICA.


LES MOTEURS SONT MUNIS D'UNE PROTECTION THERMIQUE.

ATTENTION  
NE PAS UTILISER DE FILTRE SI INSTALLE AU PLAFOND.

ATTENTION  
NE PAS UTILISER DE FILTRE SI INSTALLE AU PLAFOND.

ATTENTION  
NE PAS UTILISER DE FILTRE SI INSTALLE AU PLAFOND.

STOCK  
4104-0100-014

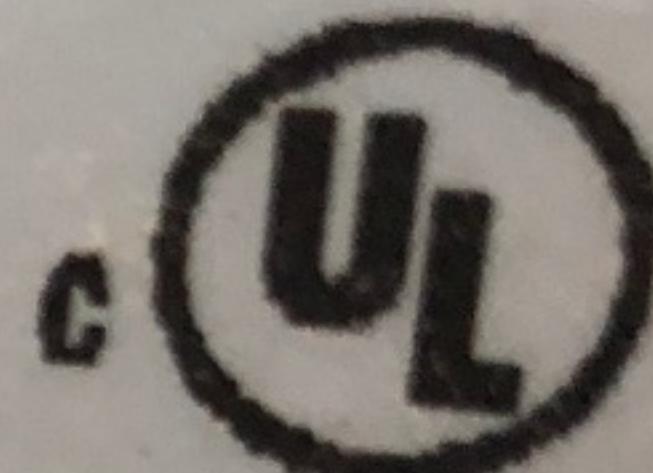

7746 LISTE  
ROOM HEATE

CHANGED WIRING  
FROM 3 $\phi$  TO 1 $\phi$   
INSTALLED 2-5-02

LOW

OFF

AUTO