

CERTIFICATION OF WORK

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: DE 07

Date of Visit: 5/14/2020

Contractor Personnel on Site:

1. BRIAN DAVIS

2.

Work Performed:

Preventive Maintenance - Services Completed (Annual, Quarterly, Monthly, equipment identification, etc.)

1. WO#

12175. CSS: 73820

Service Calls - Service Call Number and Description

1. CSS# Installed PM Kit in boiler needs pressure
2. CSS# Switch replaced.
3. CSS#


CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: BRIAN DAVIS

Date: 5/14/2020

Signed:

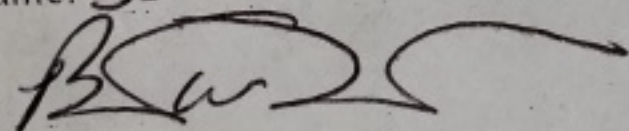

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank:

Date:

Signed:

E-Mail:

This Boiler is a Direct Vent Boiler for
Installations on Non-Combustible Floors Only

Fulton Gas Fired Pulse Combustion Boiler

Type of Gas: ☒ Natural ☐ Propane

Boiler Model No. PHW-1000

Boiler National Board No. 109874

Year 2010

Min. BTU Input/Hr. 200K Min. BTU Output/Hr. 180K

Max. BTU Input/Hr. 1000K Max. BTU Output/Hr. 900K

Design Pressure 160 PSI

Minimum Relief Valve Capacity: 900 Pounds/Hr.

Manifold Gas Pressure: 5.0 Inches W.C.

Maximum Gas Supply Pressure: 14 Inches W.C.

Minimum Permissible Gas Supply Pressure for Purpose of
Input Adjustment: ☒ 7 Inches W.C. ☐ 11 Inches W.C.

Electrical Ratings: 120 V/60 Hz/Less than 15 Amps

☒ Low Pressure Steam and Hot Water Boiler

ANSI Z21.13 B2010 • CSA 4.9 B2010

☐ High Pressure Steam Boiler

AGA Requirements 3-89

Wall Thickness Through Which Vent System May
Be Installed: 3¹/₄ Inches Min. / 20 Inches Max.

Minimum Clearance to Combustibles:

1 Inch (Sides) / 24 Inches (Top, Front & Rear)

 **Fulton**

Manufactured by
Fulton Heating Solutions, Inc.
Pulaski, New York 13142

