

CERTIFICATION OF WORK

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: DEB002

Date of Visit: 6/26/20

Contractor Personnel on Site:

1. CASEY DAVIS

4. \_\_\_\_\_

2. \_\_\_\_\_

5. \_\_\_\_\_

3. \_\_\_\_\_

6. \_\_\_\_\_

Service Calls – Service Call Number and Description

1. WO# 12165

CSS# 24797

Boiler repair

2. WO# 12025

CSS# 24525

Ex Hose propose

3. \_\_\_\_\_

CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: \_\_\_\_\_

CASEY DAVIS  
[Signature]

Date: \_\_\_\_\_

6/27/20

Signed: \_\_\_\_\_

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: Wilfred Handel

Date: 25 Jun 2020

Signed: \_\_\_\_\_

[Signature]

E-Mail: \_\_\_\_\_

wilfred.c.handel.civ@mail.mil



**Wm WIL-McLAIN**

For replacement order part number 383-600-162  
Control Panel Number 511-330-290

**WARNING**

EXPLOSION HAZARD  
CAN CAUSE SERIOUS INJURY OR DEATH  
This device can malfunction if it gets wet. Never attempt to use this device if it has been wet - REPLACE IT!

**AUTO IGNITION SYSTEM**

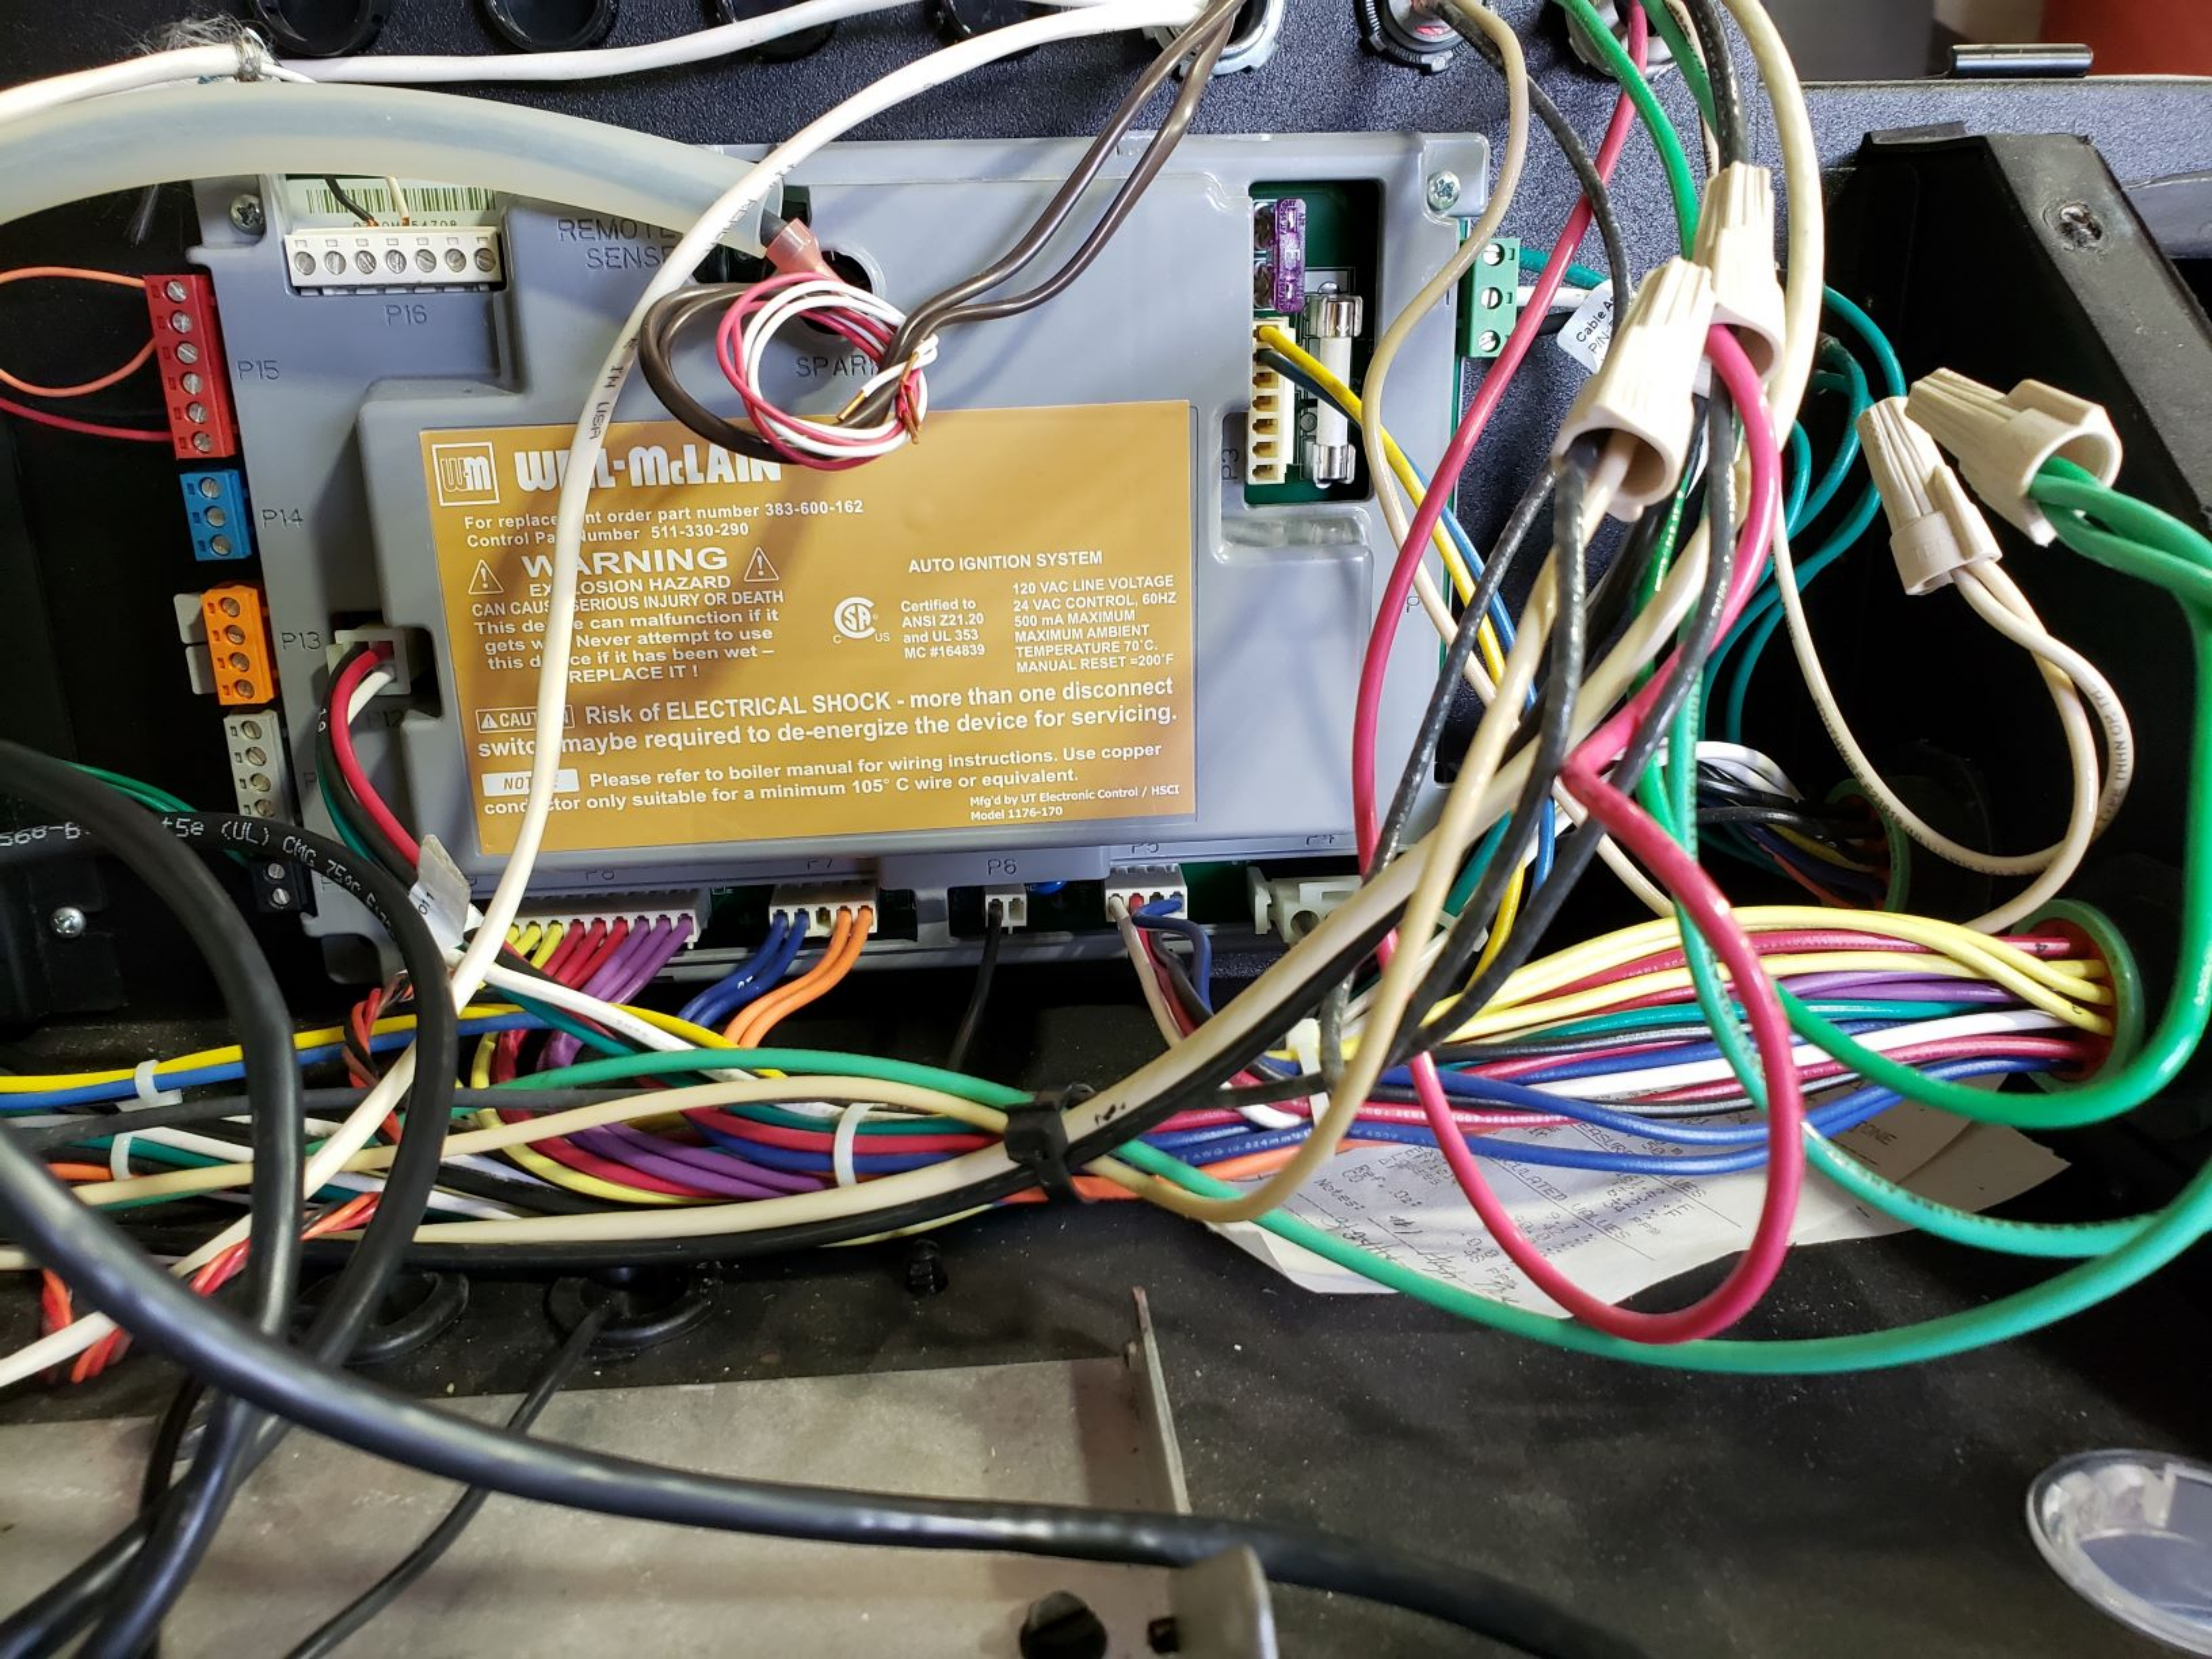
Certified to ANSI Z21.20 and UL 353 MC #164839

120 VAC LINE VOLTAGE  
24 VAC CONTROL, 60HZ  
500 mA MAXIMUM  
MAXIMUM AMBIENT TEMPERATURE 70°C  
MANUAL RESET = 200°F

**CAUTION** Risk of ELECTRICAL SHOCK - more than one disconnect switch maybe required to de-energize the device for servicing.

**NOTES** Please refer to boiler manual for wiring instructions. Use copper conductor only suitable for a minimum 105° C wire or equivalent.

Mfg'd by UT Electronic Control / HSCI  
Model 1176-170













**WEIL-McLAIN**  
10:44AM 6/25/20  
**BOILER ID:** SLM750  
 **MODULATION:**   
**BLR TEMP:** 144 °F  
**SYS TEMP:** NONE  
**STATUS:** FIN **BASE:** -2  
**DEMAND:** 2  
NEXT▶

