

CERTIFICATION OF WORK

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: MD-02 Date of Visit: 6/25/2021

Contractor Personnel on Site:

- | | |
|---------------------------|----------|
| 1. <u>Jeremy Sneathen</u> | 4. _____ |
| 2. _____ | 5. _____ |
| 3. _____ | 6. _____ |

Service Calls – Service Call Number and Description

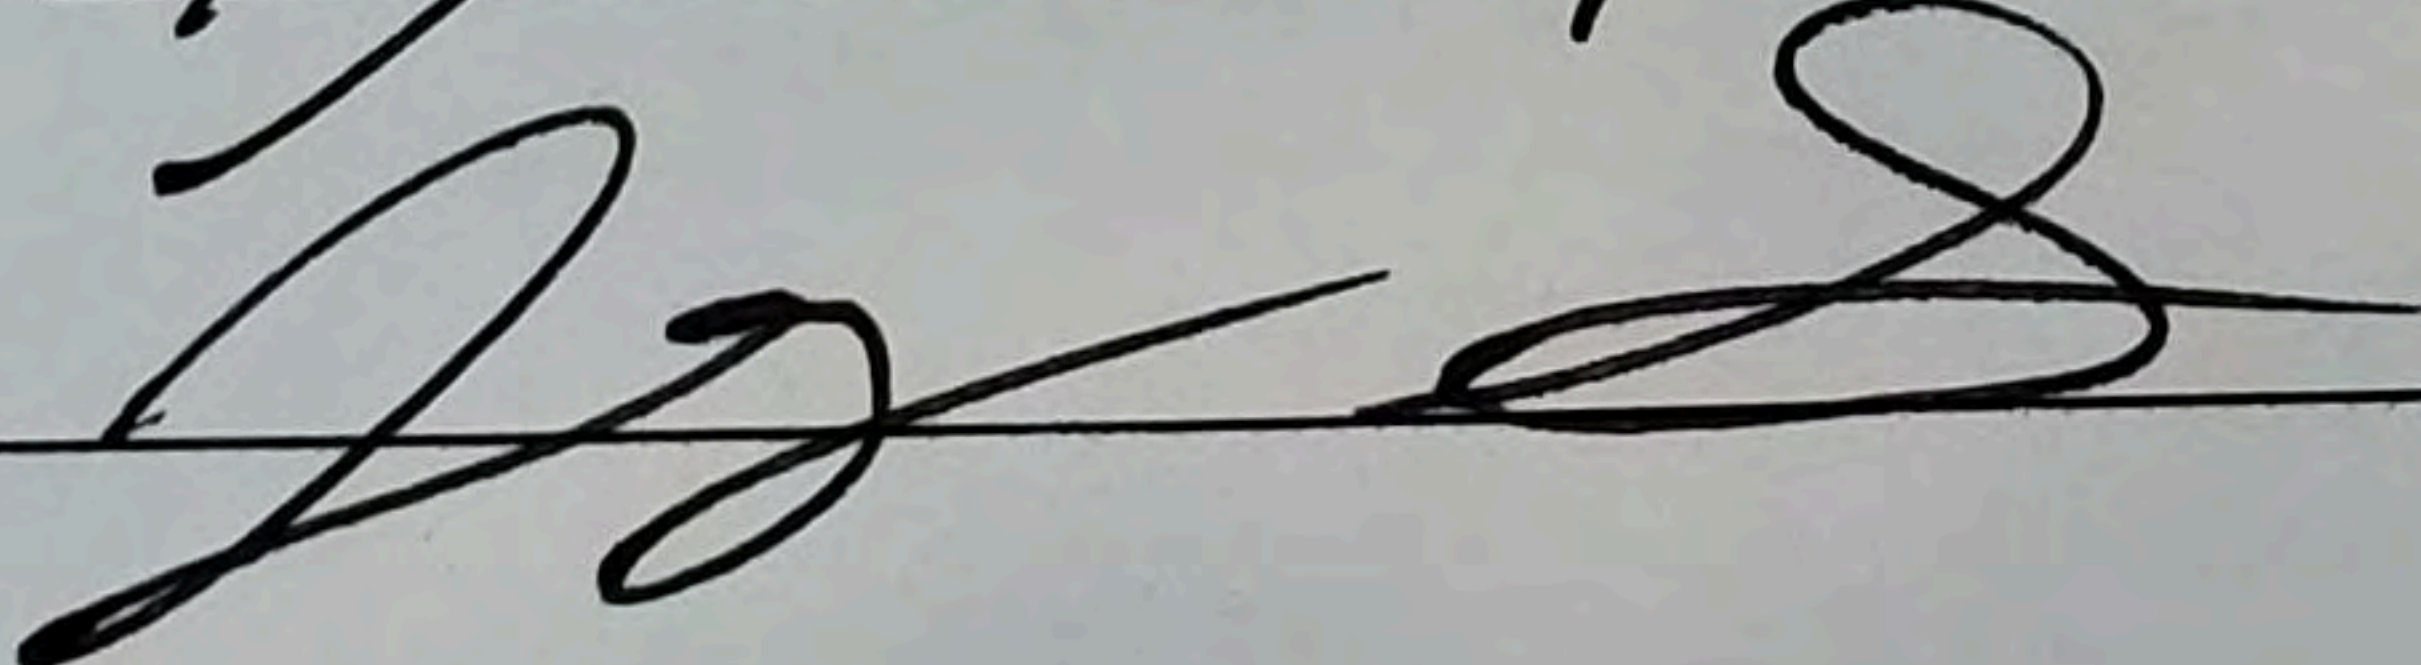
- | |
|--|
| 1. <u>Repair Surge logic device for LP2 Panel.</u> |
| 2. <u>Replaced 3 bad contactors to fix problem</u> |
| 3. _____ |

WO # 14160 CSS # 25886

CERTIFICATION OF WORK

To be signed by the Contractor:

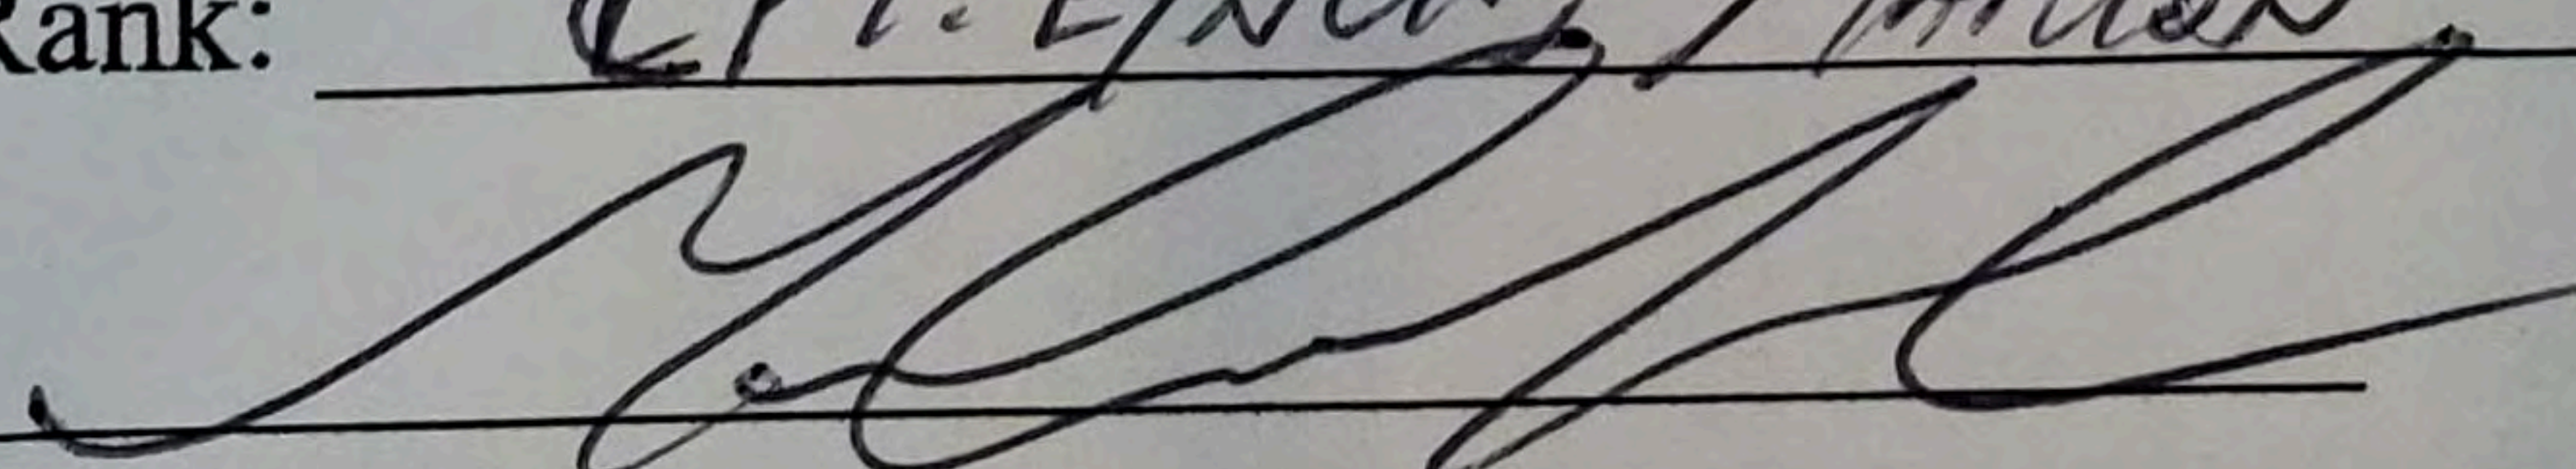
Print Name: Jeremy Sneathen Date: 6/25/2021

Signed: 

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: CPT. Lynell M. Menden Date: 20210625

Signed: 

E-Mail: Menden.Lynell.M.L@Marl.Md

SURGELOGIC™
Surge Protective Device

☀ = OK ● = Replace / Sustituir / Remplacer

Type MA / Tipo MA

Dispositivo de Protección contra Sobretensiones Transitorias
Dispositif de Protection contre les Surtensions

www.SquareD.com 8222-0001A
Made in USA / Hecho en E.U.A. / Fabriqué aux E.-U.

SURGELOGIC®
Surge Protective Devices

☀ = OK ● = Replace / Sustituir / Remplacer

Type MA / Tipo MA

Dispositivo de Protección contra Sobretensiones Transitorias
Dispositif de Protection contre les Surtensions

www.SquareD.com 8222-0001 REV 01
Made in Mexico/ Hecho en México/ Fabriqué au Mexique

SURGELOGIC™
Surge Protective Device

☀ = OK ● = Replace / Sustituir / Remplacer

Type MA / Tipo MA

Dispositivo de Protección contra Sobretensiones Transitorias
Dispositif de Protection contre les Surtensions

www.SquareD.com 8222-0001A
Made in USA / Hecho en E.U.A. / Fabriqué aux E.-U.

Phase Ground Phase Neutral Phase C

120V

REMOVE TAG
REMOVE THIS TAG
FAILURE TO FOLLOW INSTRUCTIONS
FAILURE TO FOLLOW INSTRUCTIONS
FAILURE TO FOLLOW INSTRUCTIONS

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH
PELIGRO DE DESCARGA ELÉCTRICA, EXPLOSIÓN O DESTELLO POR ARQUEO
RISQUE D'ÉLECTROCUTION, D'EXPLOSION OU D'ÉCLAIR D'ARC

Failure to follow the instructions will result in death or serious injury.
Confirm the SPD voltage rating is the same as the operating voltage of the module or nameplate label.

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH
PELIGRO DE DESCARGA ELÉCTRICA, EXPLOSION O DESTELLO POR ARQUEO
RISQUE D'ÉLECTROCUTION, D'EXPLOSION OU D'ÉCLAIR D'ARC

