

Region: 5

Location: MD002

CSS #: 25886

Maximo Work Order No.: 14160

Asset #:

Date Issued: 12/28/20

Original Description: Repair "SurgeLogic" device attached to LP2 breaker panel. 2nd Floor common area, bldg 001.

Repairs Needed:

S&S proposes to replace (3) contactors in the SurgeLogic device in building 1. S&S will then complete a system check to ensure everything is working properly.

RS Means Line Buildup and Labor Summary (Data Version 2017, Q4):

Quantity	Line Item Number	Description	Labor Hours	Labor Rate/Hr	Materials	Equipment	Total
--	NA	Materials (See attached detail)	--	--	\$2,299.38	--	\$2,299.38
--	NA	S&S Labor (Includes Diagnostic)	8	\$100.00	--	--	\$800.00
--	NA	TWI Coordination	4	\$80.00	--	--	\$320.00

Estimate Summary:

Labor Hours	Labor Cost	Material Cost	Equipment	Total Cost	CE Factor	Total Estimate
12	\$1,120.00	\$2,299.38		\$3,419.38	106%	\$3,624.54



S&S Mechanical
4831 South Crain Highway
Upper Marlboro, MD 20772

Tel. 1 - (301) 574-1555
Fax. 1 - (301) 574-1558
www.sandsmidatlantic.com

CUSTOMER QUOTATION NO. 638

Tidewater, Inc.
Tidewater, Inc
6625 Selnick Dr.
Suite A
Elkridge MD 21075

Quote Name: 14160
Quote No: 638
Site: MD002 Ordnance Road
Site Contact:
Salesperson: Lindsay Ruby
Created Date: 06/10/2021
Valid For: 30 Day(s)

WO#: 14160

CSS Ticket Number: 25886

Problem: Repair "SurgeLogic" device attached to LP2 breaker panel. 2nd Floor common area, bldg 001.

S&S herby proposes to replace (3) contactors in the SurgeLogic device in bldg 001.

S&S will then complete a system check to ensure everything is now working properly.

Service

Item	Quantity	Unit Price	Total
SQD MA4IMA16 277v	3.00	\$766.46	\$2,299.38
Diagnosis Fee	1	\$200.00	\$200.00
Electrical Labor Rate	6	\$100.00	\$600.00
Sub-Total ex Tax			\$3,099.38
Tax			\$0.00
Total inc Tax			\$3,099.38
Labor			\$800.00
Materials			\$2,299.38
Sub-Total ex Tax			\$3,099.38
Tax			\$0.00
Total inc Tax			\$3,099.38

Quotation

CAPITAL ELECTRIC
600 W HAMBURG ST
BALTIMORE,MD 21230-2682
410-752-4080

nichon.skinner@capitalelectricsupply.com

QUOTE TO:
 S&S FABRICATORS INC.
 4845 SOUTH CRAIN HWY
 UPPER MARLBORO, MD 20772-3109
 240-882-1660

SHIP TO:
 S&S FABRICATORS INC.
 4845 SOUTH CRAIN HWY
 UPPER MARLBORO, MD 20772-3109
 240-882-1660

QUOTE DATE	QUOTE NUMBER
06/10/21	S044614440
PAGE NO.	
1 of 1	

CUSTOMER NUMBER		CUSTOMER ORDER NUMBER		JOB NAME		QUOTED TO	
132423		MD 002				Brian	
SALESPERSON		SHIP VIA		FREIGHT ALLOWED		EXPIRATION DATE	
NICHON SKINNER		OT OUR-TRUCK		No		11:59pm ET 07/10/21	
ORDER QTY	UPC	DESCRIPTION			UNIT PRICE	U	EXT PRICE
3ea	78590129298	SQD MA4IMA16 277V 160KA SRG SUPRS			638.720	e	1916.16



TERMS & CONDITIONS

OUR PRODUCTS AND SERVICES ARE SUBJECT TO, AND GOVERNED EXCLUSIVELY BY, OUR TERMS AND CONDITIONS OF SALE, WHICH ARE INCORPORATED HEREIN AND AVAILABLE AT www.capitalelectricsupply.com/terms. ADDITIONAL OR CONFLICTING TERMS ARE REJECTED, VOID, AND OF NO FORCE OR EFFECT. WIRE & PIPE PRICES ARE ONLY GOOD FOR THE CURRENT DAY.

TAXES NOT INCLUDED

Subtotal	1916.16
S&H CHGS	0.00
Amount Due	1916.16

Made in USA / Hecho en E.U.A. / Fabriqué aux É.-U. www.SquareD.com



 = OK  = Replace Module / Sustituya el módulo / Remplacer le module



Push-to-Test / Botón de prueba / Bouton pousser pour vérifier



Counter /
Contador /
Compteur

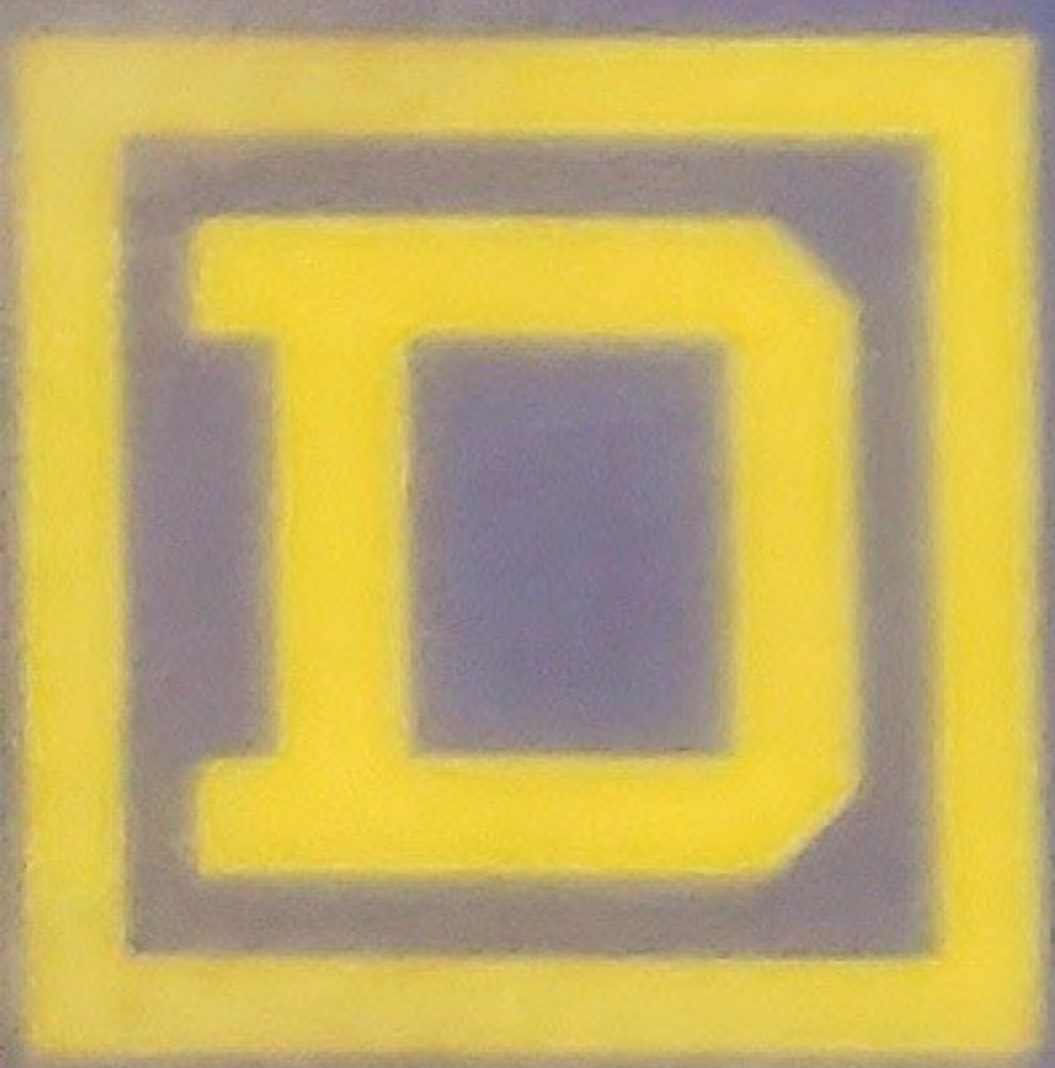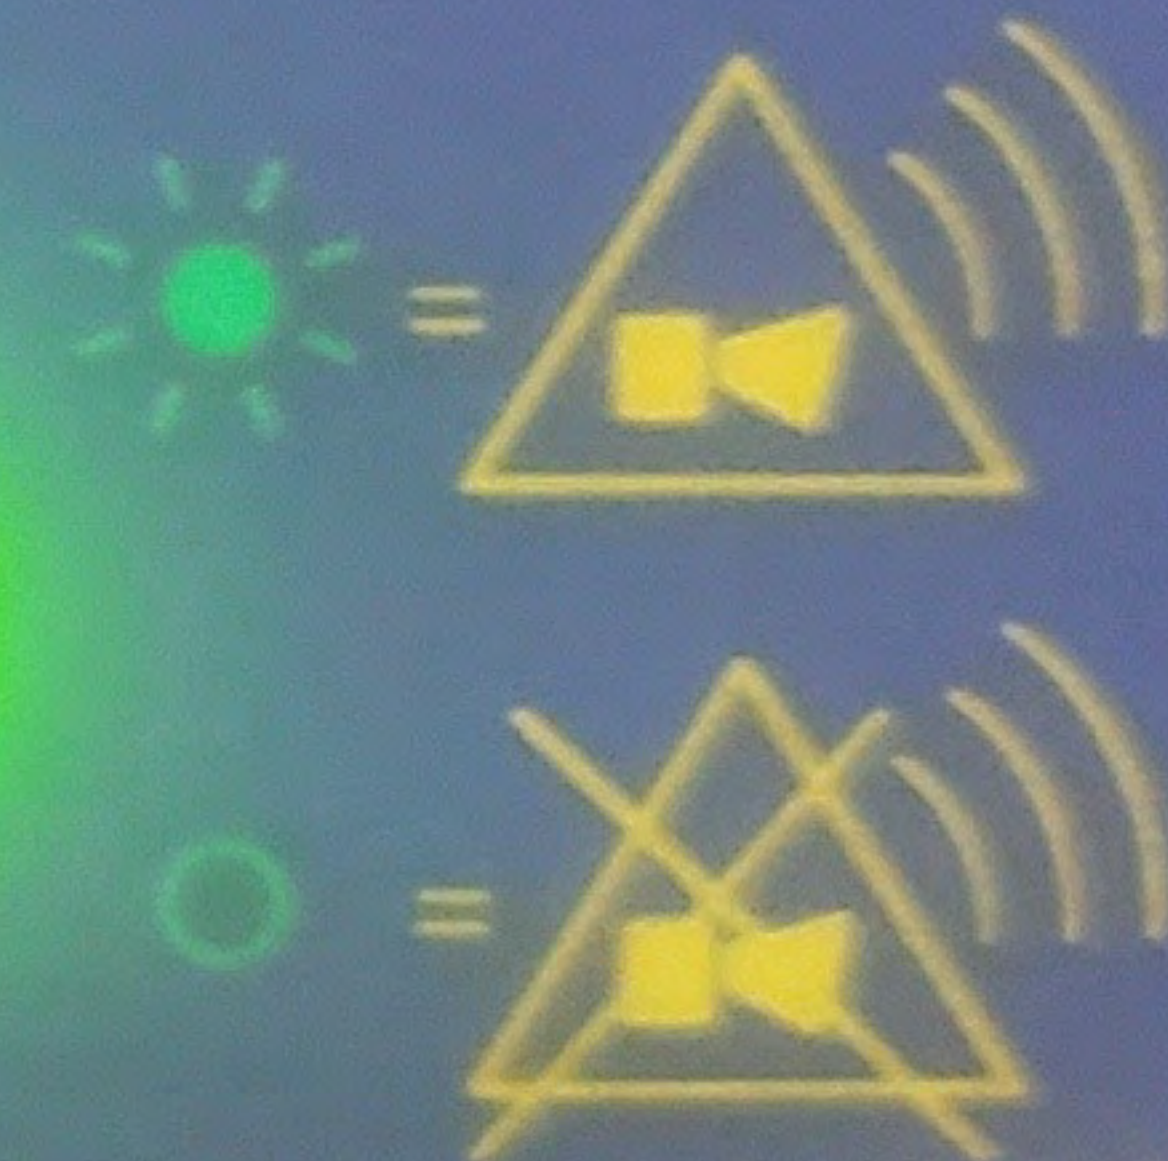

SURGELOGIC™
Surge Protective Device

Dispositivo de Protección contra
Sobretensiones Transitorias /
Dispositif de Protection contre
les Surtensions

8222-0007B