

Additional Funding Request

VA048	CSS26185 WO# 12612 Asset# NA							
Description of Repairs	Remove and install new PTAC unit. Test to make sure system is operational.							
Diagnosis: Initial Work Order	Air conditioning (PTAC) not working in room 208.							
Diagnostic Fee	\$ 160 Labor \$80/hr x 2							
Additional Labor Cost to Perform Repairs	\$ 480 Labor \$80/hr x 6							
Additional Cost	\$ 971.20 <table border="1" style="width: 100%; border-collapse: collapse; margin-top: 5px;"> <tr> <td style="width: 45%;">New PTAC unit</td><td style="width: 10%; text-align: center;">1</td><td style="width: 20%; text-align: right;">\$971.20</td><td style="width: 25%; text-align: right;">\$971.20</td></tr> </table>				New PTAC unit	1	\$971.20	\$971.20
New PTAC unit	1	\$971.20	\$971.20					
Total Cost of Repair	\$ 1,611.20							



WORK ESTIMATE

CSS #: Work Order #:
Emergency Urgent Routine

Company Name:	Tidewater, Inc.	Facility ID:	VA048
Contractor POC:	Adam Colopy		
Telephone No:	740-819-6207	Building/Location; (e.g., Classroom/Room #)	Room 208
E-Mail Address:	adam.colopy@tideh2o.net		
Assigned Technician(s):	Richard Walker		

DESCRIPTION of WORK and EXPLANATION for REPAIRS or REPLACEMENT

Replace PTAC unit

LABOR/MATERIAL		MATERIAL/ SUB UNIT DOLLAR AMOUNT	LBR/HR \$80	LINE ITEM TOTAL DOLLAR AMOUNT	
ITEM	QUANTITY				
Diagostic			2	\$160.00	
PTAC Unit and cord	1	\$971.20		\$971.20	
Labor			6	\$480.00	
SUB-TOTAL COSTS:		Materials Total	\$971.20	Labor	\$640.00
TOTAL			\$1,611.20		



QUOTATION

Trane U.S. Inc.
MIDLOTHIAN PARTS SUPPLY
14000 Justice Rd
Midlothian, VA 23113-6912
USA
PH: 804-893-5777
Midlothian@tranesupply.com

Order Number	
13200614	
Order Date	Page
9/1/2020 14:15:10	1 of 1

Quote Expires On 11/30/2020

Prepared For:

TIDEWATER INC
6625 SELNICK DR SUITE A
ELKRIDGE, MD 21075
USA

Ship To:

TIDEWATER INC
6625 Selnick Dr
Elkridge, MD 21075-6220
USA

4105408700

Requested By: richard walker, 5406232587

P21 ID: 1035611
Payment Terms: N30
National Account ID:

Internal Account: 3880885
Customer No: 237607

PO Number	Ship Route	Quoted By:
		Samantha Cranmer

Unit Info: Make / Model / Serial

Quantities					Item ID	Pricing	Unit	Extended
Ordered	Allocated	Remaining	UOM	Disp.	Item Description	UOM	Price	Price
			Unit Size	Weight		Unit Size	Store Pickup	HazMat
1	0	1	EA		PTHF1501HAA	EA	775.00	775.00
			1.0	143.00	UNIT; PTHF; TRANE PROSPACE PTAC, 15,000 BTU, HEAT PUMP ONLY WITH ELECTRIC HEAT, 208/230 VOLT, R410A	1.0	N	N
1	0	1	EA		PWR00286	EA	34.33	34.33
			1.0	2.00	POWERCORD; PROSPACE PTAC, 230V, 15 AMP, NEMA 6-15P, DYX01	1.0	N	N

Total Lines: 2	SUB-TOTAL	809.33
	MARYLAND TAX	48.56
	QUOTE TOTAL	857.89
	U.S. Dollars	

This is a quote, not an invoice. Prices quoted are valid for 30 days from the day of the quote unless otherwise indicated. Tax is an estimate and is subject to changes in shipping address and applicable tax rates. Shipping and Handling charges will be applied if necessary at the time of the order. Quoted items are subject to availability and are not guaranteed to be in stock. Returned parts may be subject to restocking fees and Special Order parts may not be returnable.
All purchases are subject to Trane Parts and Supplies terms of sale, www.trane.com/PartsTermsOfSale


asset#2295 pc18

Move To 202
#A



Fan



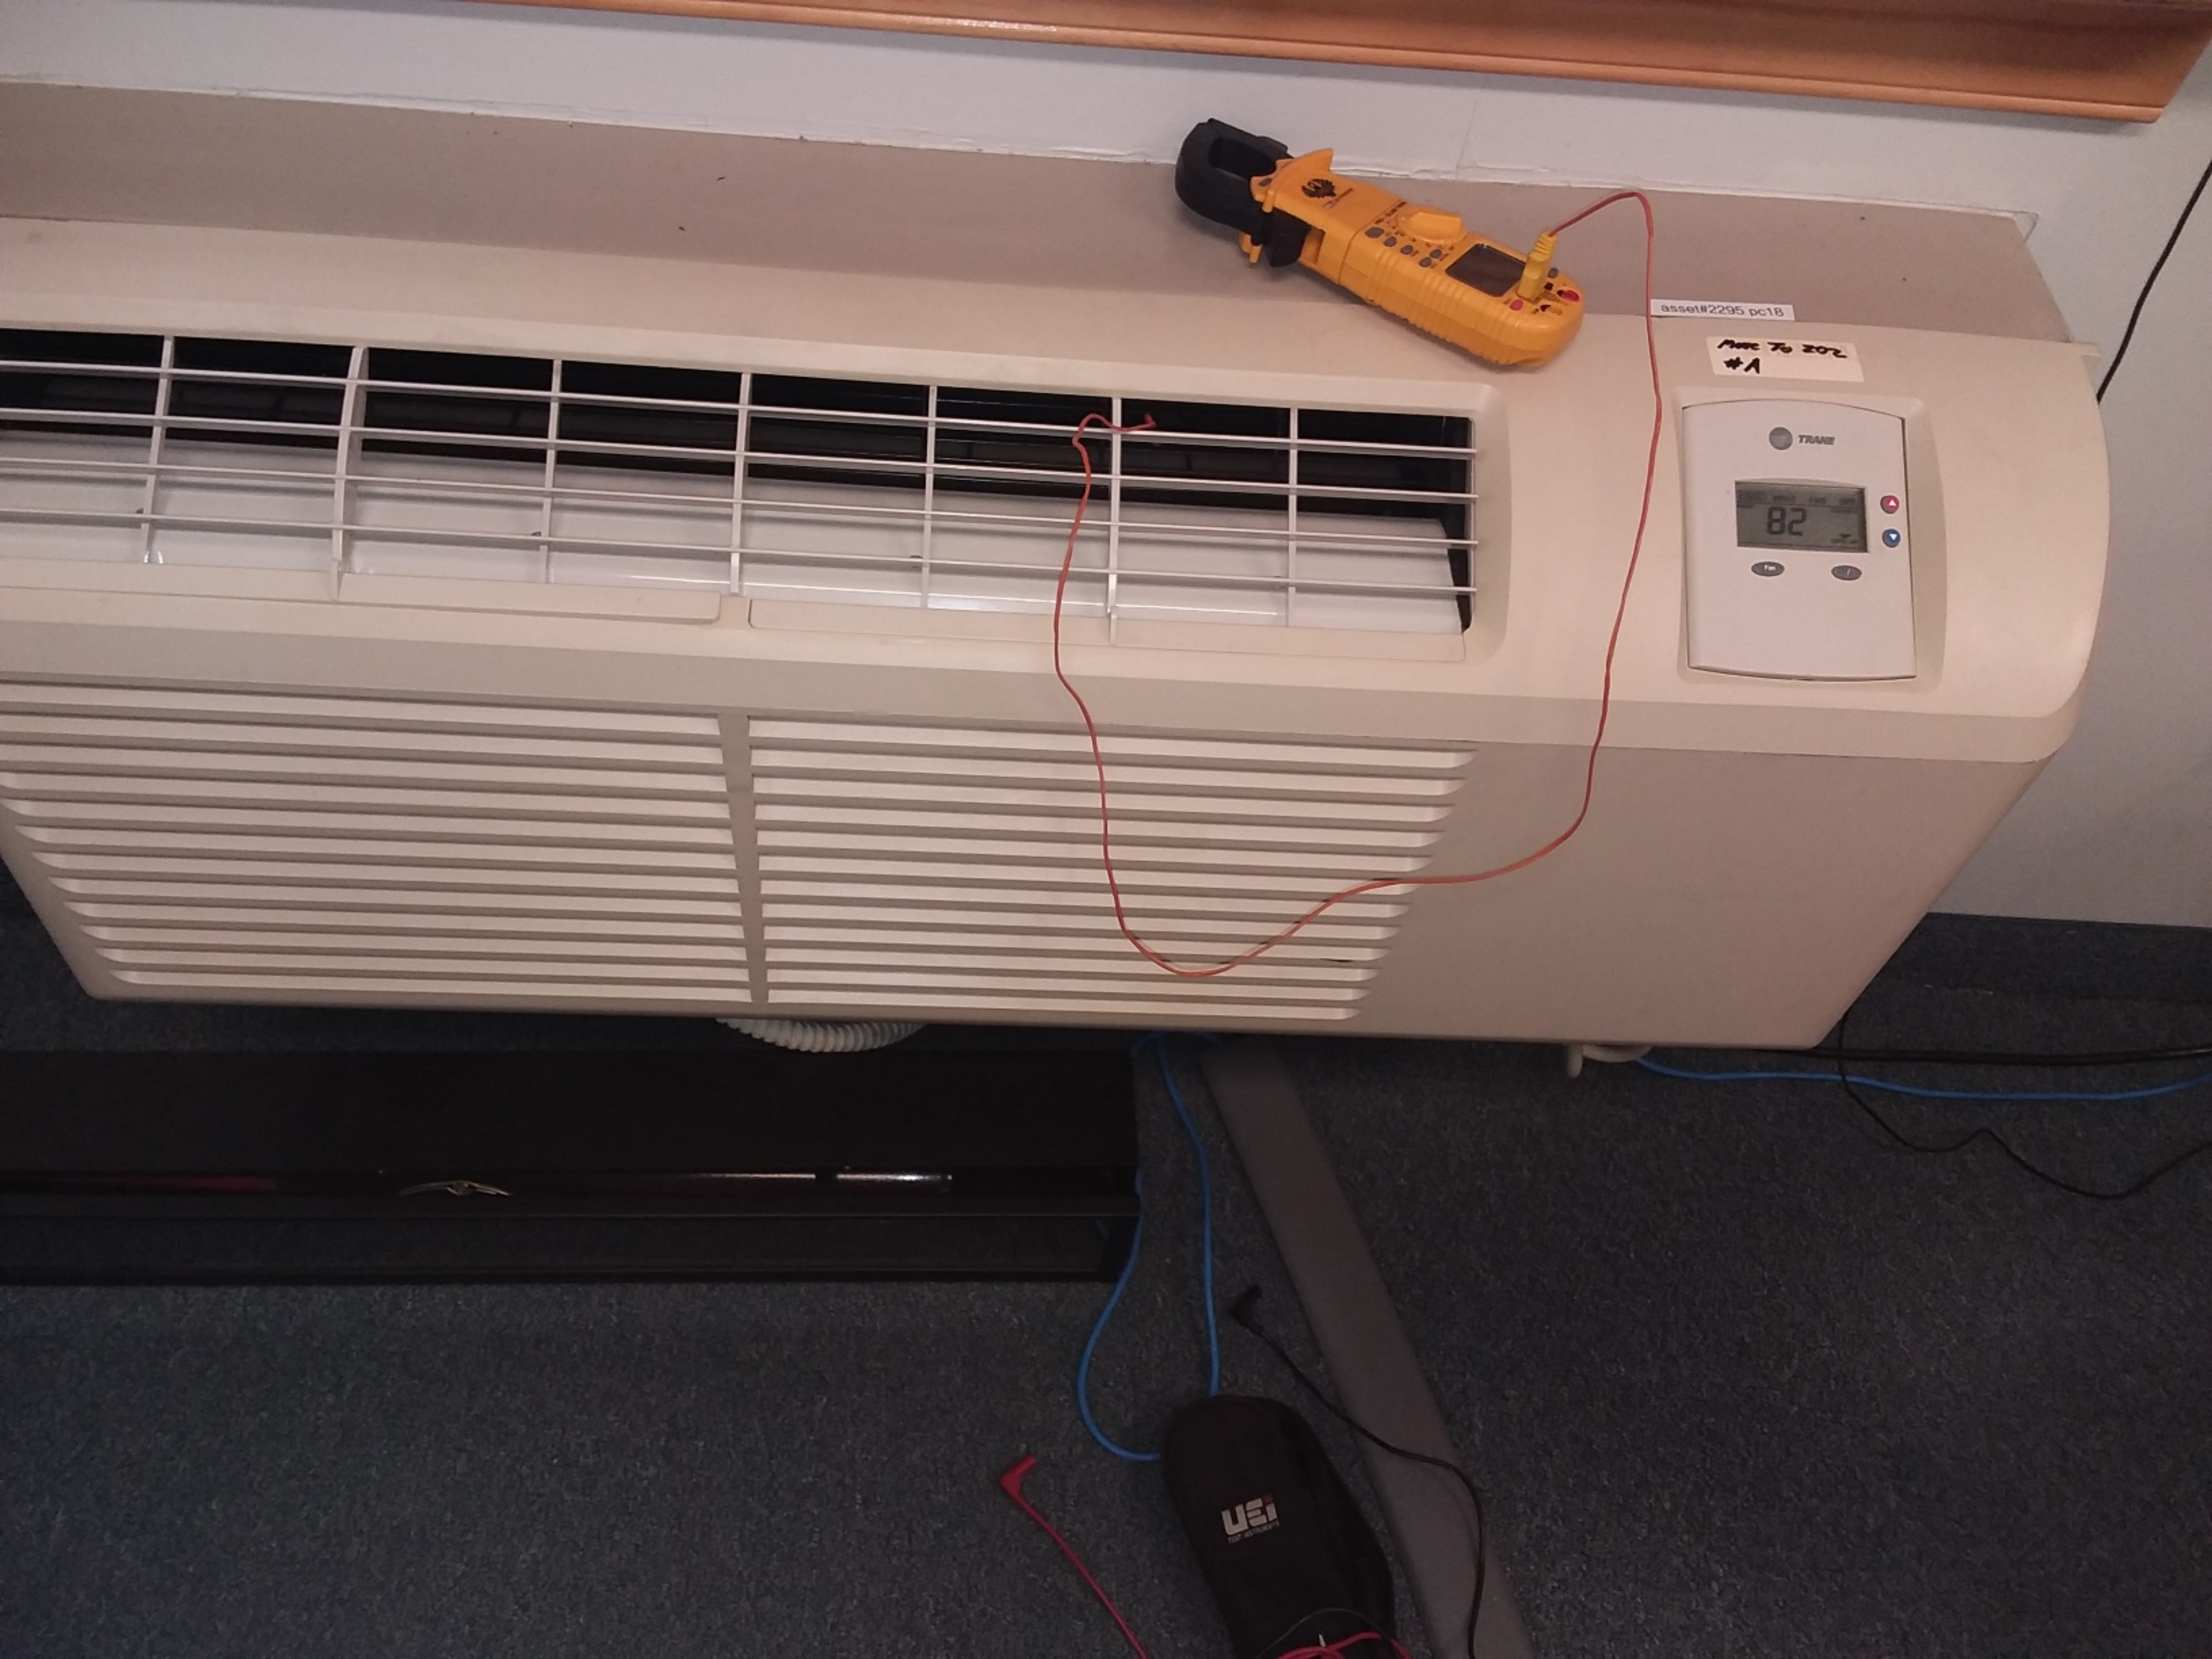

asset#2295 pc18

Asset To 202
#A

TRANE


82

UEI
TEST EQUIPMENT

OF PACKAGED TERMINAL AIR CONDITIONER
(SA28468)

AUXILIARY HEATERS - 230/208 VOLT
MARK UNIVERSAL POWER CORD INSTALLED

HEATER	HEATER KW	HEATER CURRENT	MIN CIR CAPACITY	MAX FUSE SIZE
08	2 0/1 6	8 9/7 9	11 4	15
09	3 0/2 4	13 4/11 8	17 0	20
03	5 0/4 0	22 2/19 7	28 0	30

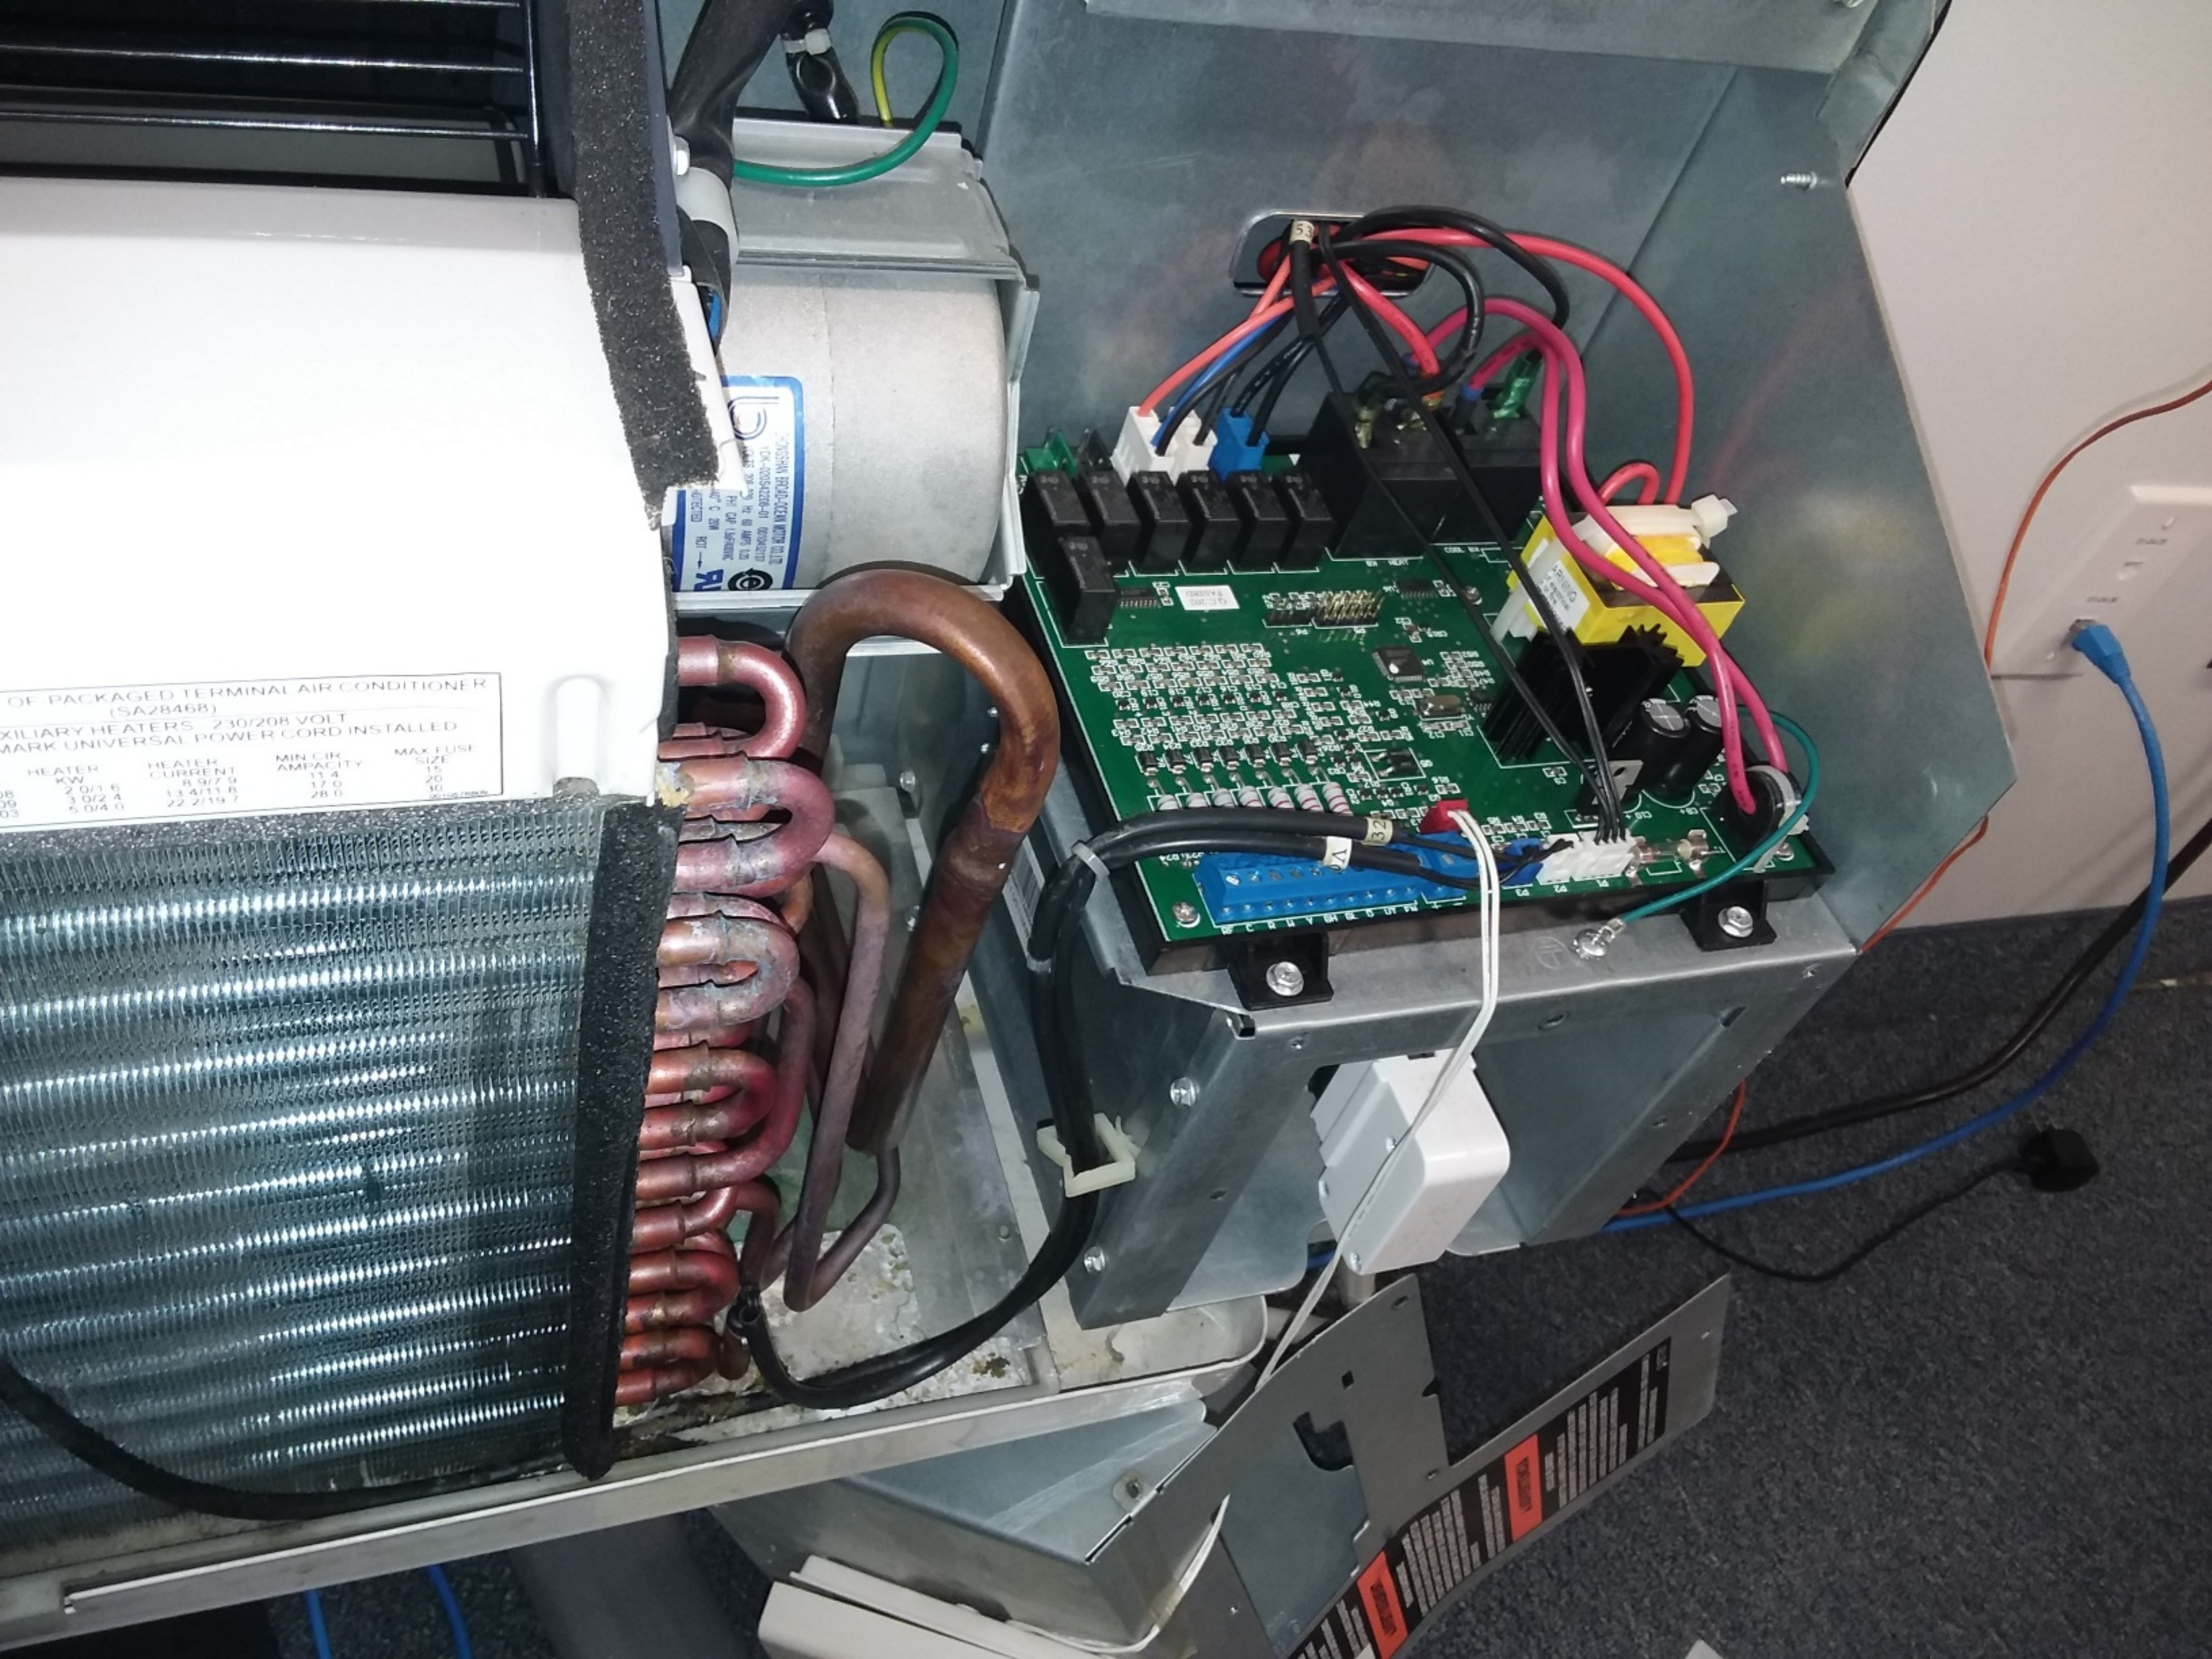

These accessories are required to complete installation of
PTHE**01U*** models:

Wall Sleeve - BAYWSLV00*

Outdoor Louver - BAY*AG00*

Power Cord - BAYPCRD008, 9, or 3*

Display Module - BAY**DM00* or Escutcheon Cover - BAY*CVR001

These accessories are optional and may be used with this installation.

Subbase - BAYSUB001

Power Switch - BAYPSW001

Power Vent Door - BAYPVD001

Hard Wire - BAYHWRK001 and Hard Wire Connector - BAYCNHK011, 2, or 3

Condensate Pump - BAYCPMP001

Circuit Breaker - BAYCBKR001, 2, or 3

Electrical Receptacle - BAYSCKT001 or 2

0010578005

