

Additional Funding Request

NY127	CSS# 27517 WO# 10695 Asset# NA
Description of Repairs	Labor and materials to replace boiler pump #2
Diagnosis: Initial Work Order	Boiler Pump #2 is burned out and needs to be replaced immediately.
Diagnostic Fee	\$80
Additional Labor Cost to Perform Repairs	\$480 TW Labor 6 hours @ \$ 80/hr
Additional Material Cost to Perform Repairs	\$1895.06 Armstrong Pump
Total Cost of Repair	\$2,455.06



WORK ESTIMATE

CSS #:

Work Order #:

Emergency

Urgent

Routine

Company Name:	Tidewater, Inc.		Facility ID:	NY127
Contractor POC:	Adam Cology			
Telephone No:	740-819-6207		Building/Location; (e.g., Classroom/Room #)	Mech Room
E-Mail Address:	adam.cology@tideh2o.net			
Assigned Technician(s):	Patrick Brown		Subcontractors	

DESCRIPTION of WORK and EXPLANATION for REPAIRS or REPLACEMENT

Labor and materials to replace boiler pump #2

LABOR/MATERIAL		MATERIAL/ SUB UNIT DOLLAR AMOUNT	LBR/HR \$80	LINE ITEM TOTAL DOLLAR AMOUNT
ITEM	QUANTITY			
Labor			6	\$480.00
Armstrong Circ Pump	1	\$1,895.06		\$1,895.06
				\$0.00
Diagnostic Labor			1	\$80.00
SUB-TOTAL COSTS:		Materials Total	\$1,895.06	Labor \$560.00
TOTAL			\$2,455.06	

F.W. Webb Company
6792 Townline Road
Syracuse, NY 13211
TEL# (315-476-9322)
FAX# (315-472-4139)

Quote
Number
09/22/20
68671933

To:
TIDEWATER, INC.
6625 SELNICK DRIVE

ELKRIDGE MD 21075

SAME
6625 SELNICK DRIVE

ELKRIDGE, MD 21075

(410-540-8700) Fax# (410-579-1685)

Cust #	Customer Po#	Rel#	Writer	Date Req
198314	ARMSTRONG PUMP	PAT B	BTW	09/22/20

PAGE 1 OF 1

Quoted By: BRIAN WOLFORD

Quantity	Description	Net Price	Exten	Ln#
1	#ARMSTRONG PUMP 1.5X1.5X6-4 + ASG438015X15X64P (S3966420) 8 WEEKS ARO PLUS FRT	1480.520	1480.52	(1)
		Sub Total:	1480.52	
		Total:	1480.52	


*** NUMBER OF DAYS QUOTE VALID IS 10 ***

PLEASE REFERENCE QUOTE # 68671933 FOR INQUIRIES OR ORDER OF ABOVE MATERIAL

+ THIS PRODUCT IS A SPECIAL ITEM. RESTOCKING FEES MAY APPLY.

BP-2-T

CIRCULATING PUMP - BOILER, PUMP

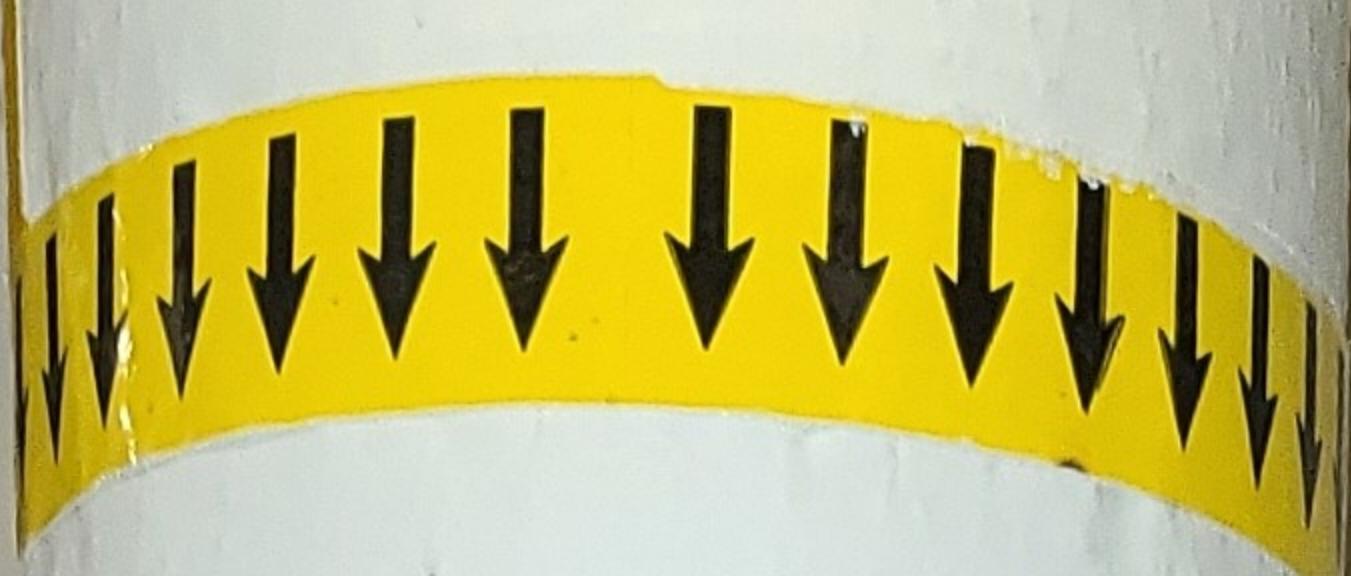

CAUTION
HIGH GAS