

CERTIFICATION OF WORK

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: DE-007 Date of Visit: 2/10/2021

Contractor Personnel on Site:

- | | |
|---------------------------|----------|
| 1. <u>Jeremy Sneathen</u> | 4. _____ |
| 2. _____ | 5. _____ |
| 3. _____ | 6. _____ |

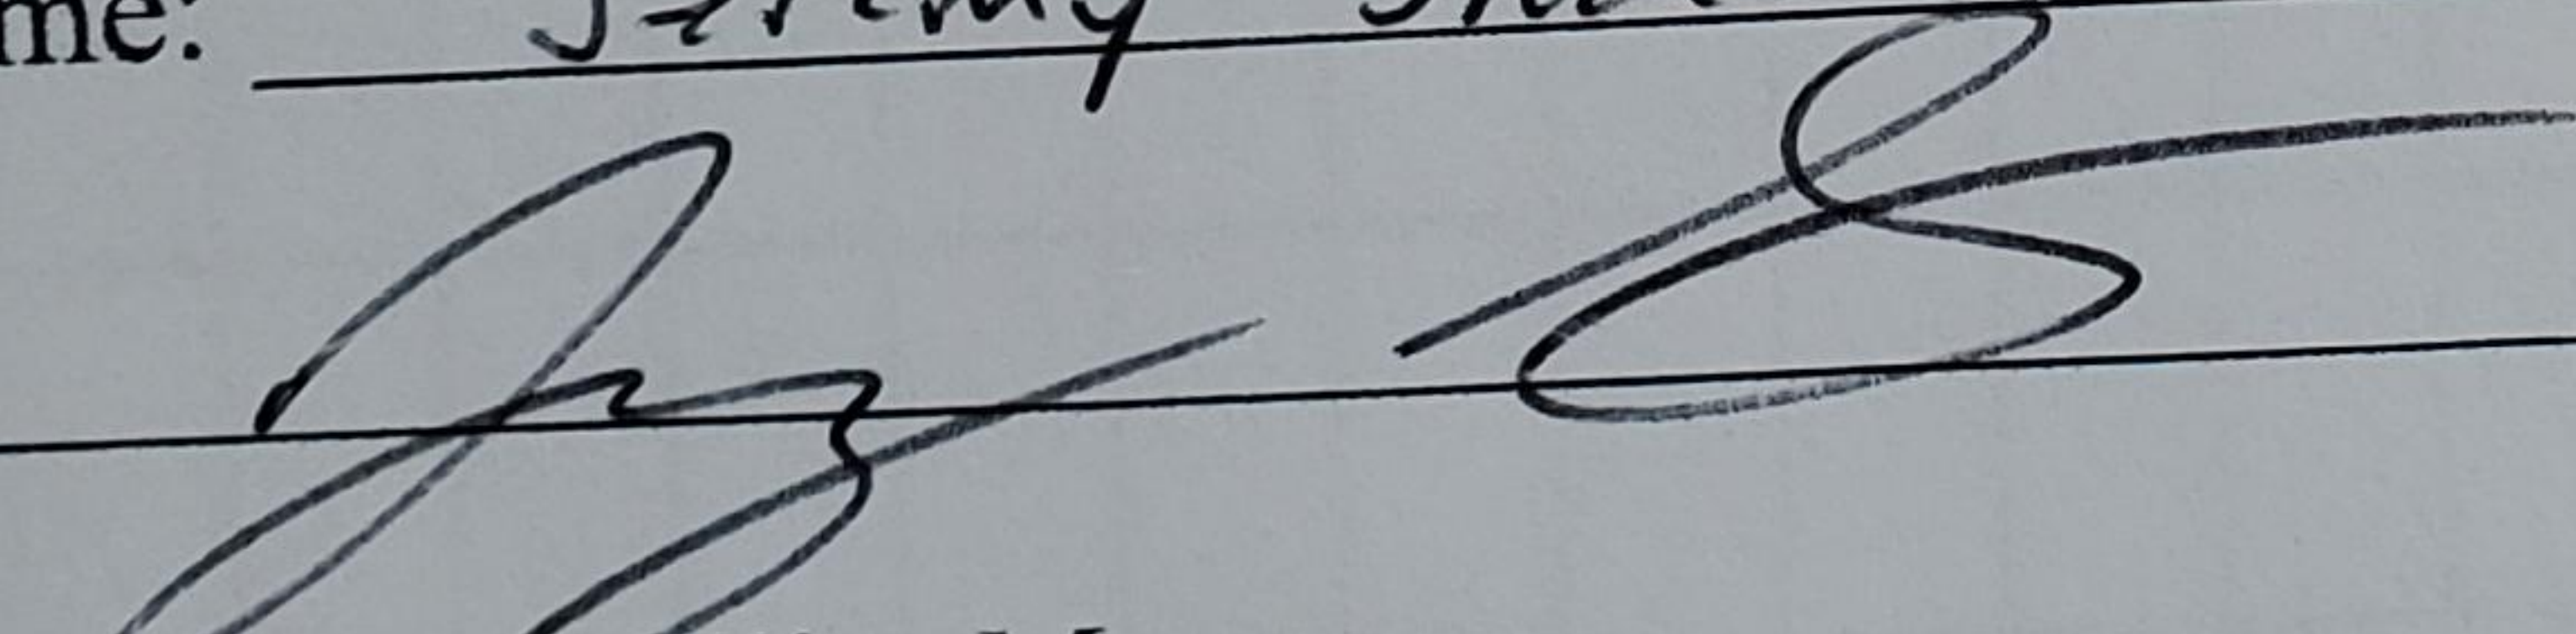
Service Calls – Service Call Number and Description

- | | |
|---|---------------------|
| 1. <u>C55 # - 28151</u> | <u>WO # - 13621</u> |
| 2. <u>Boiler controller replacement & E-Stop rewiring</u> | |
| 3. _____ | |

CERTIFICATION OF WORK

To be signed by the Contractor:

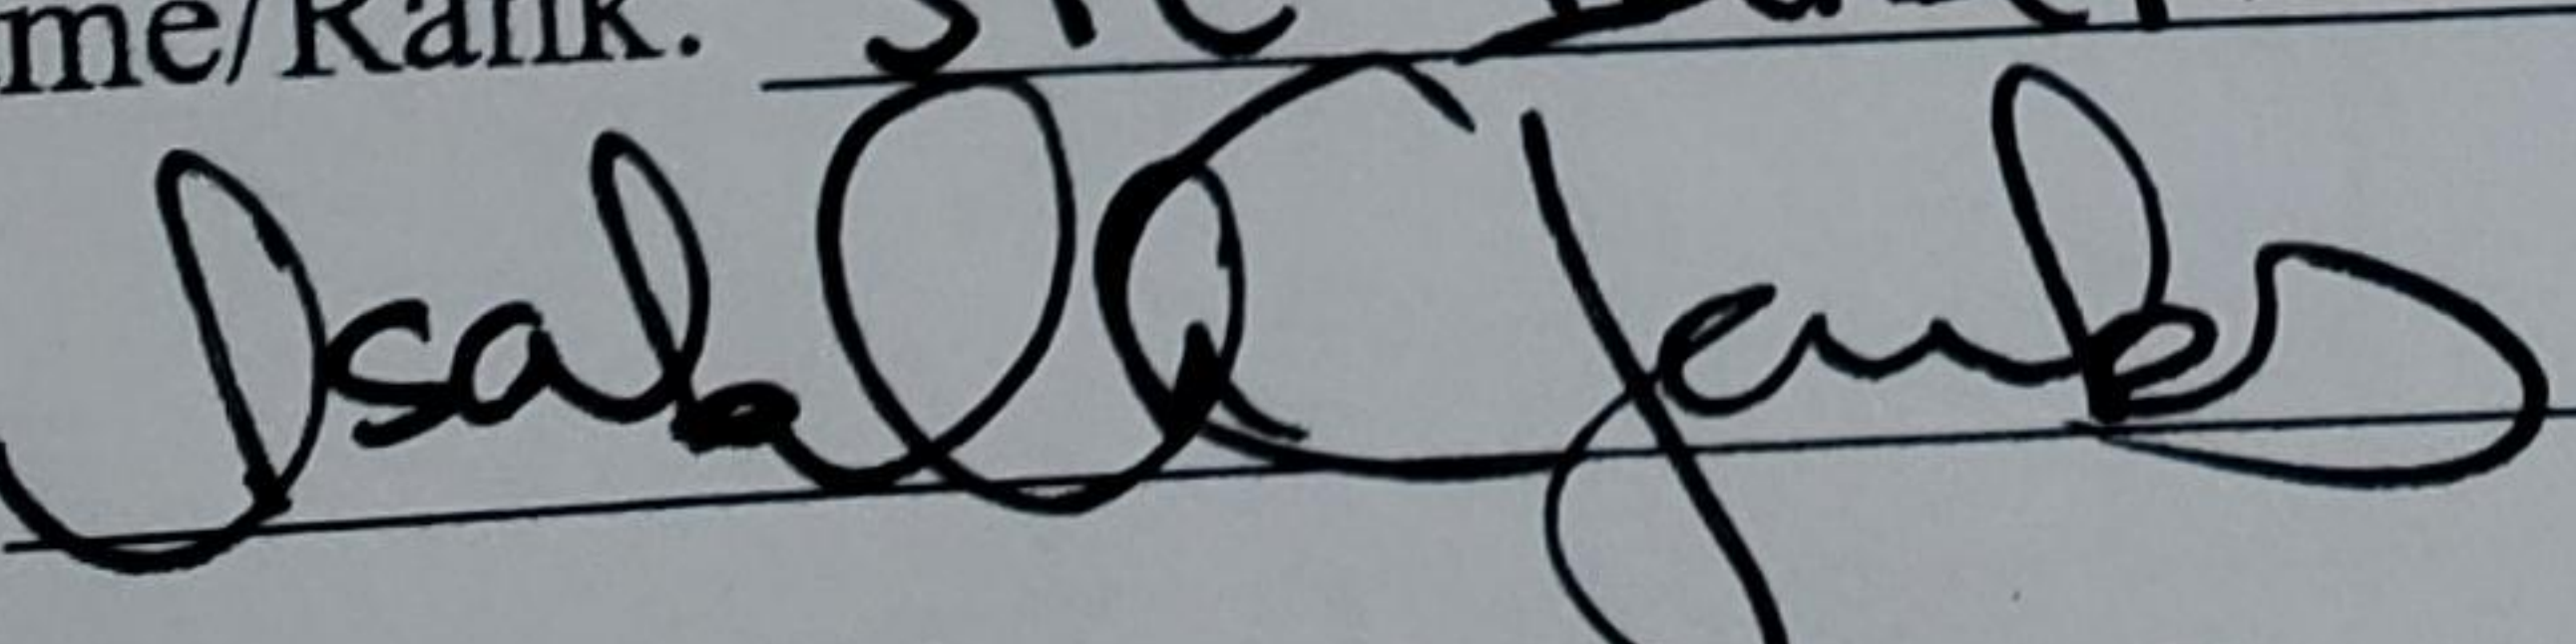
Print Name: Jeremy Sneathen Date: 2/10/2021

Signed: 

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified time line:

Print Name/Rank: SFC Isabella Jacobs Date: 10 Feb 2021

Signed: 

E-Mail: isabella.e.jacobs2.mil@mail.mil

PULSE

COMBUSTION



◦ B-2 ◦



 **Fulton**



Annual Replacement parts for Fulton's
PulseHW 300-1400



PULSE COMBUSTION



◦ B-1 ◦



Argent Inspections

Form AI-08 Boiler Inspection Certificate

Expiration Date 10/31/2019	Inspection Date 10/31/2019	Next Water/Side/Fireside 2019/2019	Next Strength Test Q	Regional Board # 110930
Customer JPRC Newark DE-007		Serial # Fulton	Property # B-1	Installation #
Building # Boiler Room	Capacity 2,000,000 BTU/Hr	Safety Valves Fulton	Programmer Mfr Fulton	Burner Mfr Fulton
Pressure Allowed 150 psi		Inspection Types Performed		
✓ Internal		✓ Watersides		
✓ External/Operational		✓ Firesides		
✓ Pressure Test		Strength		
Inspection # 13314		Inspector Craig H. Bennett		
Signature <i>C. H. Bennett</i>		Fuel Types Certified to Use		
		☒ Coal		
		☒ Light Fuel Oil		
		☒ Heavy Fuel Oil		
		☒ Natural Gas		
		☒ Wood		

POST THIS CERTIFICATE UNDER GLASS ON OR NEAR CERTIFIED BOILER

Fulton



STONE SERVICES, INC.
HEATING - AIR CONDITIONING
REFRIGERATION - PLUMBING
410-919-0804

