

**CERTIFICATION OF WORK
SERVICE CALL**

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: VA099 Date of Visit: 7/15/22

Contractor Personnel on Site:

- | | |
|------------------------------|----------|
| 1. <u>Moore's Mechanical</u> | 4. _____ |
| 2. _____ | 5. _____ |
| 3. _____ | 6. _____ |

Service Call Number

CSS# 284 WO# 17330

Description of Repairs

Picked up material and drove to site, checked in with staff onsite before shutting down hydronic boiler and installing safety valve on the outlet side of boiler piping. After install I returned water and purged lines of air to complete job and plugged off the old location of the safety valve

CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: Moore's Mechanical Date: 7/15/22

Signed: _____

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:




Print Name/Rank: Don Huson Date: 7/28/22

Signed: Donald L Huson

E-Mail: _____



WATER RECIRCULATION

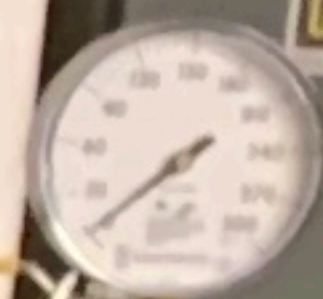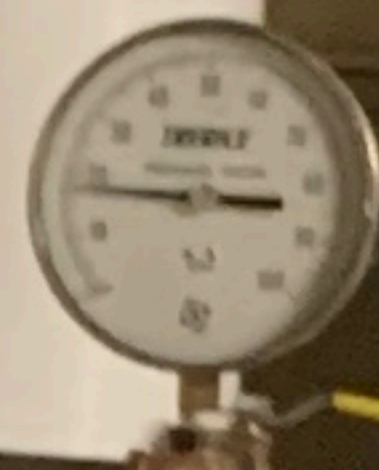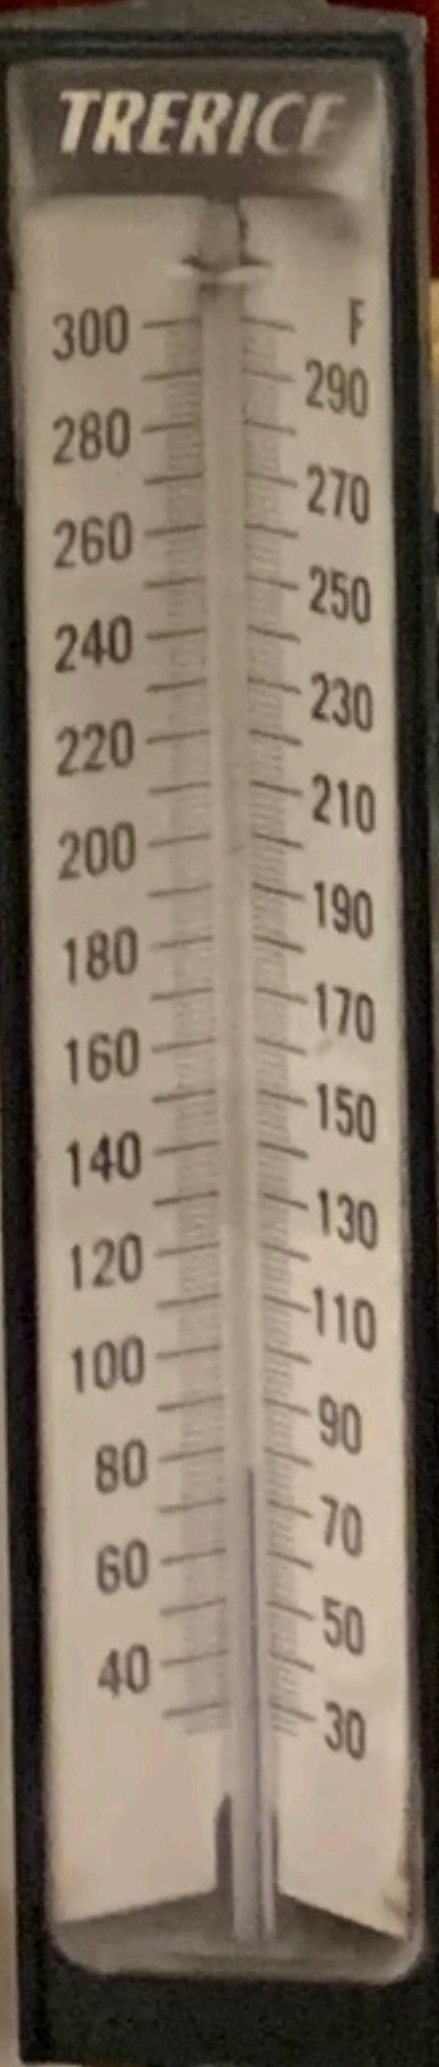

HOT WATER RETURN

WATER SUPPLY

BOTLER
ENABLE



Lochinvar

PHWP-2
Ball & Gossett
ITT Industries

HOT WATER

13 18.36 EXT