

**CERTIFICATION OF WORK  
SERVICE CALL**

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: Bedford Date of Visit: 5/17/22

Contractor Personnel on Site:

1. Tyson Bell
2. \_\_\_\_\_
3. \_\_\_\_\_
4. \_\_\_\_\_
5. \_\_\_\_\_
6. \_\_\_\_\_

Service Call Number

CSS# \_\_\_\_\_ WO# 17333

**Description of Repairs**

Arrived on site checked in with Donald and began troubleshooting unit. I found the unit low on charge so I will be quoting a leak search and repair.

---

---

**CERTIFICATION OF WORK**

To be signed by the Contractor:

Print Name: Tyson Bell Date: 5/17/22

Signed: Tyson Bell


To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: \_\_\_\_\_ Date: \_\_\_\_\_

Signed: \_\_\_\_\_

E-Mail: \_\_\_\_\_

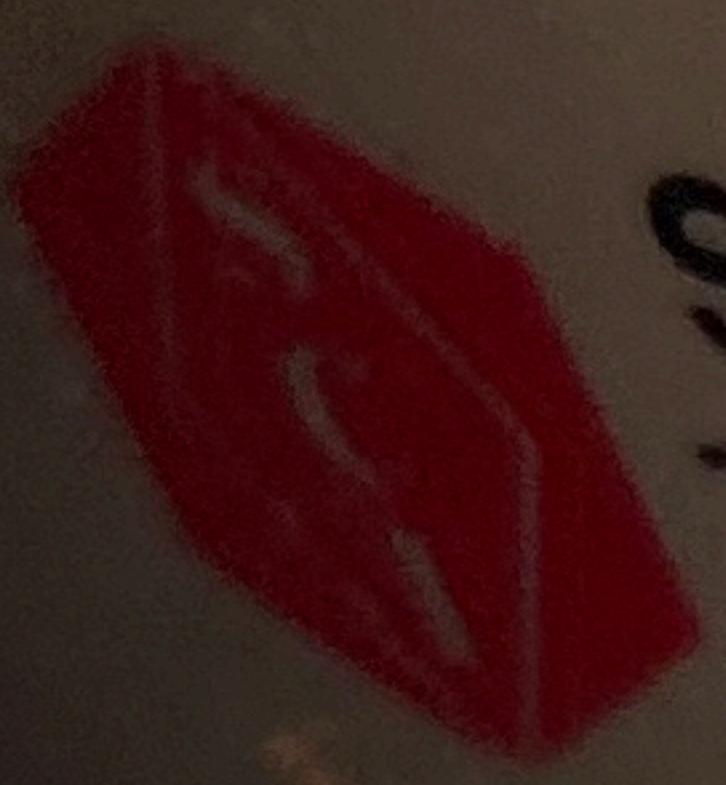

SIAM COMPRESSOR INDUSTRY



MITSUBISHI ELECTRIC GROUP

REFRIGERANT COMPRESSOR

MODEL **ANB33FCTM**

MANUFACTURING DATE

15092012

POWER SOURCE

220-230V 3~ 50-375Hz

d.c. INVERTER

INPUT 3240 W AT

180 Hz

A

REFRIGERANT

R-410A

1.40 L

4.15

15.8


MPa  
MPa

CE

RoHS



MITSUBISHI-ELECTRIC-TAGS

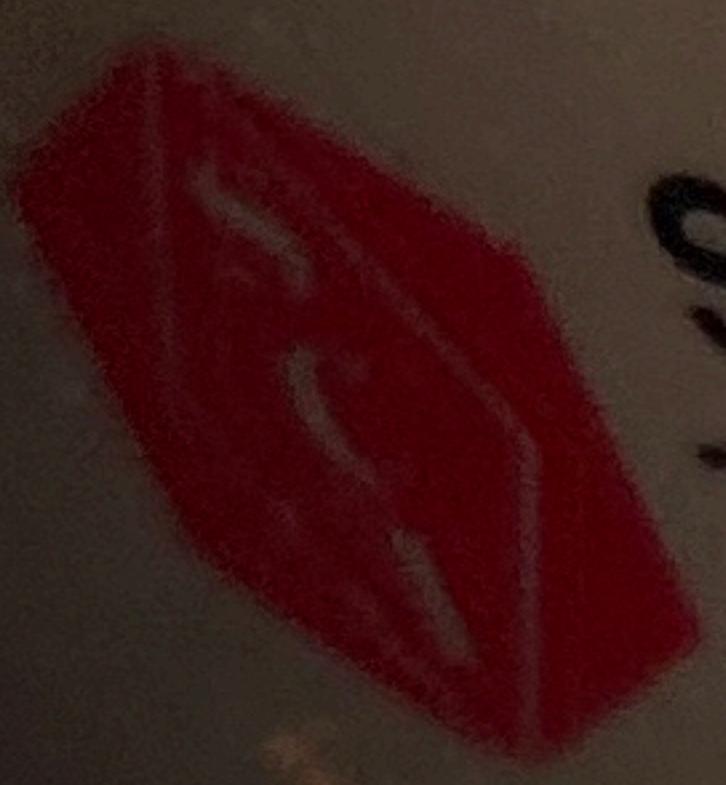

SIAM COMPRESSOR INDUSTRY



MITSUBISHI ELECTRIC GROUP

REFRIGERANT COMPRESSOR

MODEL **ANB33FCTM**

MANUFACTURING DATE

15092012

POWER SOURCE

220-230V 3~ 50-375Hz

d.c. INVERTER

INPUT 3240 W AT 180 Hz

R-410A

1.40 L

4.15

15.8

MPa  
MPa

CE

RoHS



MITSUBISHI-ELECTRIC-TAGS