

**CERTIFICATION OF WORK
SERVICE CALL**

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: USARC VA049 Date of Visit: 9 July 2021

Contractor Personnel on Site:

1. <u>Brandon Curtis</u>	4. _____
2. _____	5. _____
3. _____	6. _____

Service Call Number

CSS# 31138 WO# 14393

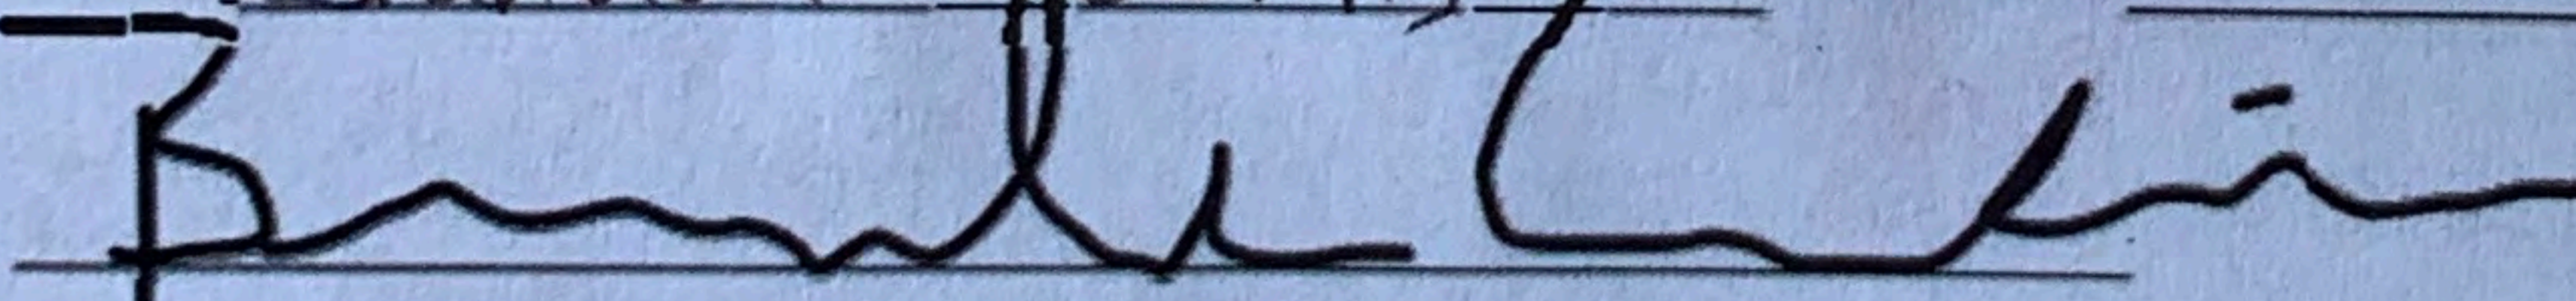
Description of Repairs

Replaced the pressure reducing valve on
the make up water. Tested for any leaks and
couldn't verify pressure due to boilers not running
properly. Also had let them know boilers need
to be locked AT.

CERTIFICATION OF WORK

To be signed by the Contractor:

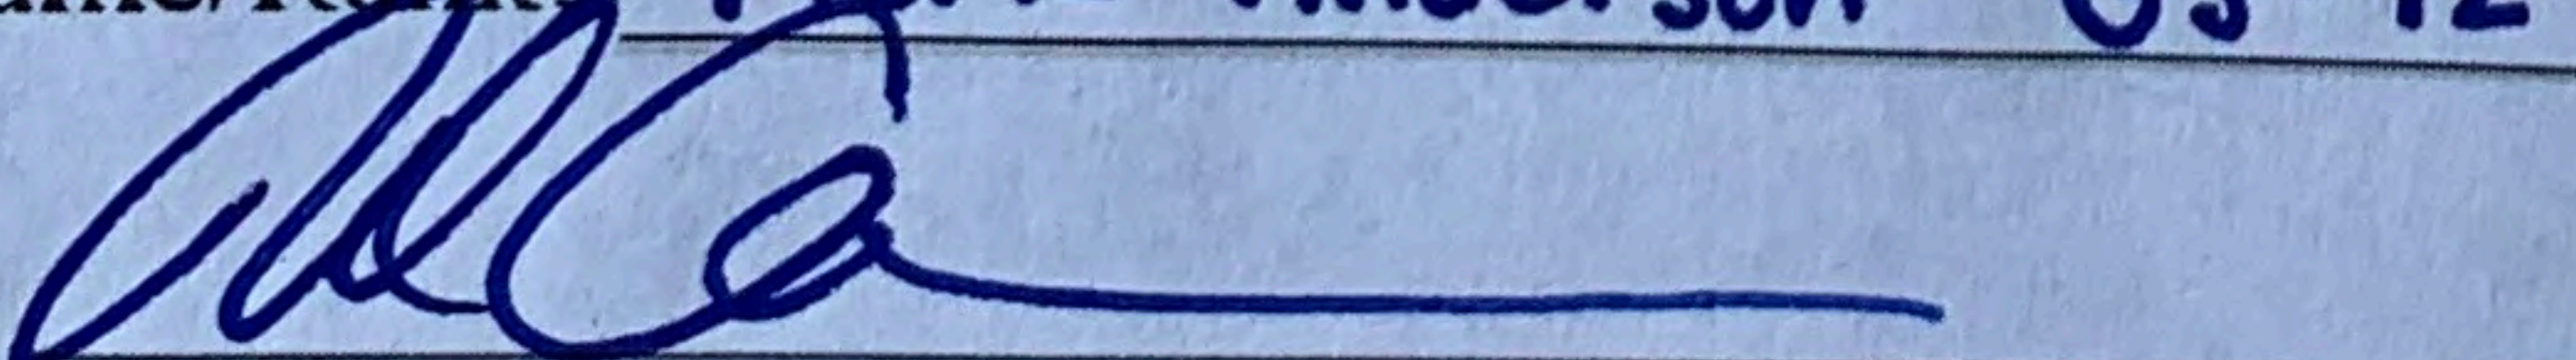
Print Name: Brandon Curtis Date: 9 July 2021

Signed: 

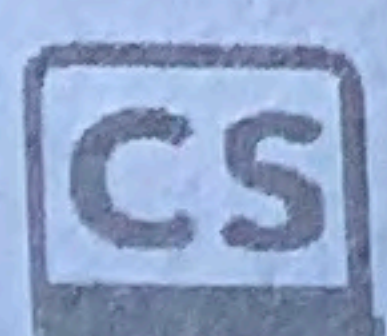
To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: Mark Anderson GS-12 Date: 9 July 2021

Signed: 

E-Mail: mark.s.anderson7.mil@mail.mil





WARNING
BEFORE INSTALLING,
USING OR SERVING
THIS PRODUCT, READ
THE WARNING NOTES
AND INSTRUCTIONS
IN INSTRUCTION
MANUAL. FAILURE TO
DO SO MAY RESULT
IN SERIOUS INJURY
OR PROPERTY DAMAGE.