

## Additional Funding Request

<b>NY051</b>	<b>CSS# 31380 WO# 13992</b>											
Description of Repairs	Labor and materials to replace 2 wall packs with close match, original model and parts no longer available. NOTE: upon Patrick's investigation, all emergency exit signs were working, but it was found that 2 wall pack lights are not.											
Diagnosis: Initial Work Order	Repair all emergency exit signs in drill hall.											
Diagnostic Fee	<p>\$ 160</p> <p>Labor \$80/hr x 2</p>											
Additional Labor Cost to Perform Repairs	<p>\$ 480</p> <p>Labor \$80/hr x 6</p>											
Additional Material Cost to Perform Repairs	<p>\$ 500.60</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="padding: 2px;">120/277V Halogen Emergency LightW.</td> <td style="padding: 2px;">2</td> <td style="padding: 2px;">250.30</td> <td style="padding: 2px;">500.60</td> </tr> <tr> <td style="padding: 2px;">White Steel, Nickel Cadmium Battery Chemistry</td> <td></td> <td></td> <td></td> </tr> </table>				120/277V Halogen Emergency LightW.	2	250.30	500.60	White Steel, Nickel Cadmium Battery Chemistry			
120/277V Halogen Emergency LightW.	2	250.30	500.60									
White Steel, Nickel Cadmium Battery Chemistry												
Total Cost of Repair	\$ 1,140.60											



# WORK ESTIMATE

CSS #: **31380**

Work Order #: **13992**

Emergency

Urgent

Routine

Company Name:	Tidewater, Inc.	Facility ID:	NY051
Contractor POC:	Adam Colopy		
Telephone No:	740-819-6207	Building/Location; (e.g., Classroom/Room #)	
E-Mail Address:	<a href="mailto:adam.colopy@tideh2o.net">adam.colopy@tideh2o.net</a>		
Assigned Technician(s):	Patrick Brown		

## DESCRIPTION of WORK and EXPLANATION for REPAIRS or REPLACEMENT

Labor and materials to replace 2 wall packs with close match, original model and parts no longer available. NOTE: upon Patrick's investigation, all emergency exit signs were working, but it was found that 2 wall pack lights are not.

ITEM	QUANTITY	MATERIAL/ SUB UNIT DOLLAR AMOUNT	LBR/HR \$80	LINE ITEM TOTAL DOLLAR AMOUNT
Diagnostic			2	\$160.00
120/277V Halogen Emergency LightW, White Steel, Nickel Cadmium Battery Chemistry	2	\$250.30		\$500.60
Labor			6	\$480.00
<b>SUB-TOTAL COSTS:</b>		<b>Materials Total</b>	<b>\$500.60</b>	<b>Labor</b> \$640.00
			<b>TOTAL</b>	<b>\$1,140.60</b>



# Cart

Item	Quantity	Total Price	Item Availability
 <b>BRADY 120/277V Halogen Emergency Light</b> , White Steel, Nickel Cadmium Battery Chemistry Item #15Y798 Your Price: <b>\$195.55</b>	2	<b>\$391.10</b>	Expected to arrive <b>Fri. Jul 23</b> using standard ground shipping (additional shipping options available at Checkout.)



A MANUAL TEST:  
DE TERMINATED AT ANY  
Y DEPRESSING AND RE-  
ELECT" AND "TEST"  
Y (RESET)

OR CONDITION:  
ITION THAT CAUSED THE  
AND RELEASE BOTH THE  
TTONS SIMULTANEOUSLY  
RILURE INDICATION

ATOR DIRECTORY


LOCATE DEFECTIVE  
CTIVE LAMP(S)

TONS. IF O.K.

CE CHARGER BOARD

011282 REV 1

CHLORIDE EMERGENCY LIGHTING      MODEL: 12NMF25WAD  
INPUT: 120/277VAC, 60HZ, .06/.03A MAX  
OUTPUT: 12VDC, 25W  
DISCHARGE TIME: 1.5 HOURS  
REPL BATTERY: 100-3-A064

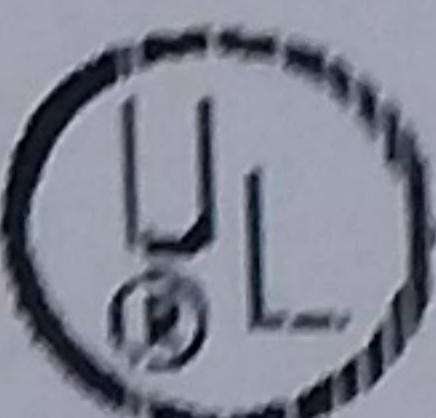

LISTED  
871C

(914-2-1652)

0210050247C

CAUTION: SEE INSTRUCTION MANUAL FOR INSTALLATION,  
OPERATING AND MAINTENANCE INSTRUCTIONS.  
THIS EQUIPMENT IS NOT INTENDED FOR USE WITH RIGID  
CONDUIT TO UL508. USE FLEXIBLE CONDUIT & RECOGNIZED  
CONNECTOR OR NON-METALLIC SHEATHED CABLE ONLY.

MAY 14 2004

(914-1-310)

## SELF DIAGNOSTICS USER GUIDE

AFTER ENERGIZING AC POWER TO THE UNIT ALL  
LEDS WILL FLASH YELLOW. WHEN BATTERY  
VOLTAGE REACHES AN ACCEPTABLE LEVEL ALL  
LEDS WILL TURN GREEN. MANUAL TESTING CAN  
NOW BE PERFORMED.

NOTE: LEAVE AC CONNECTED FOR A MINIMUM OF  
24 HOURS BEFORE PERFORMING ANY ABBREVIATED  
TESTING. FULL RECHARGE OF BATTERIES MAY TAKE  
UP TO ONE WEEK.

### INITIATING A MANUAL TEST:

- 1) DEPRESS AND RELEASE THE "SELECT" BUTTON  
UNTIL THE INDICATOR FOR THE DESIRED TEST  
IS ILLUMINATED YELLOW.
- 2) DEPRESS AND RELEASE THE "TEST" BUTTON TO  
BEGIN THE MANUAL TEST. THE EMERGENCY LAMPS  
WILL ILLUMINATE FOR THE SELECTED TEST PERIOD.  
THE ASSOCIATED TEST INDICATOR WILL FLASH  
YELLOW DURING THE TEST. FOR UNITS EQUIPPED  
WITH THE OPTIONAL ALARM FEATURE, AN ALARM  
TONE WILL BE HEARD AT THE START OF THE  
MANUAL 90 MINUTE TEST.

### CANCELING A MANUAL TEST:

- 3) A MANUAL TEST CAN BE TERMINATED AT ANY  
TIME DURING TESTING BY DEPRESSING AND RE-  
LEASING BOTH THE "SELECT" AND "TEST"  
BUTTONS SIMULTANEOUSLY (RESET).

### CLEARING AN ERROR CONDITION:

- 4) FIRST CORRECT THE CONDITION THAT CAUSED THE  
FAILURE. THEN DEPRESS AND RELEASE BOTH THE  
"SELECT" AND "TEST" BUTTONS SIMULTANEOUSLY  
WHICH WILL CLEAR THE FAILURE INDICATION  
(RESET).

## STATUS INDICATOR DIRECTORY

### 1) LAMP INDICATOR RED

MANUALLY TEST UNIT TO LOCATE DEFECTIVE  
LAMP(S). REPLACE DEFECTIVE LAMP(S).

### 2) BATTERY INDICATOR RED

CHECK BATTERY CONNECTIONS. IF O.K.  
REPLACE BATTERY.

### 3) CHARGE INDICATOR RED

CIRCUIT FAILURE. REPLACE CHARGER BOARD.

9140011282 REV 1