

**CERTIFICATION OF WORK
SERVICE CALL**

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: 80th tr.command Date of Visit: 7/12/21

Contractor Personnel on Site:

- | | |
|-------------------------|----------|
| 1. <u>Mark Anderson</u> | 4. _____ |
| 2. _____ | 5. _____ |
| 3. _____ | 6. _____ |

Service Call Number

CSS# 31551 WO# 14549

Description of Repairs

Tried to measure inlet gas pressure but no pressure port. Installed pressure port, measured pressure, gas is ok.

Boilers 2 and 4 have defective touchscreens, cant see any error codes. Tidewater co will replace them.

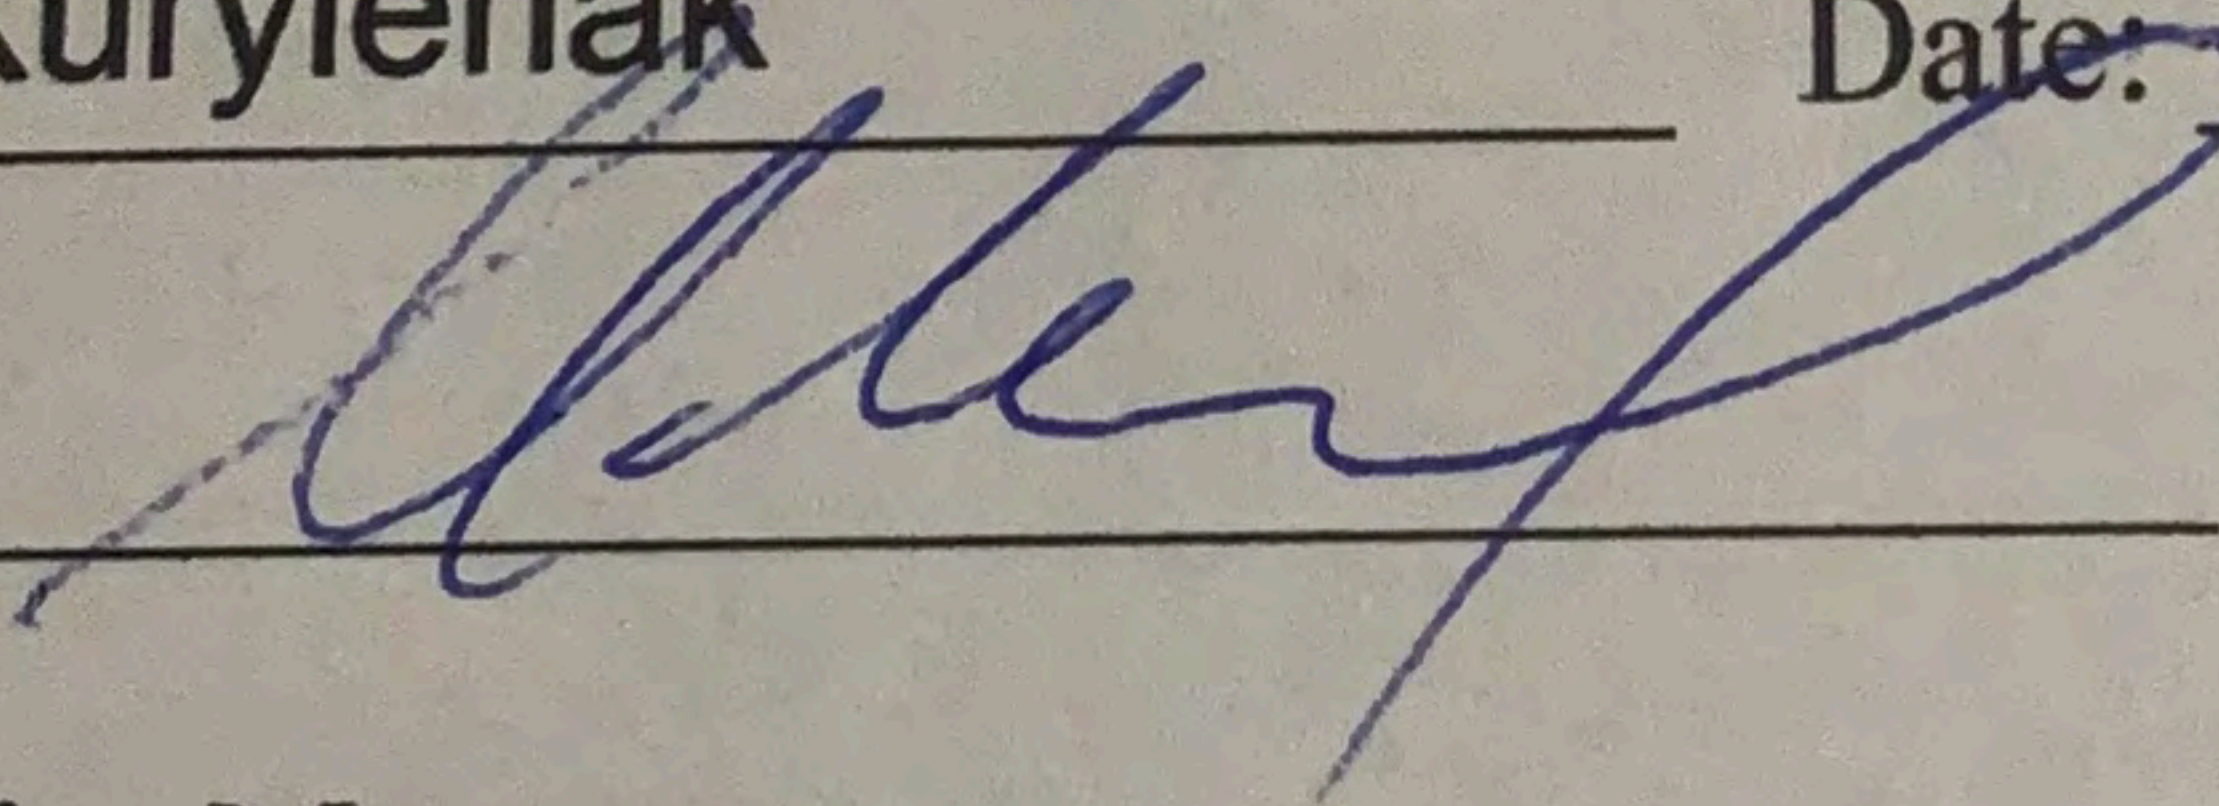
Have to call manufacturer about boiler 1, some issue with modulation.

Boiler 3 runs cant ignite. Checked gas, air, cleaned ignitor and flame sensor but still dont ignite. Will come back.

CERTIFICATION OF WORK

To be signed by the Contractor:

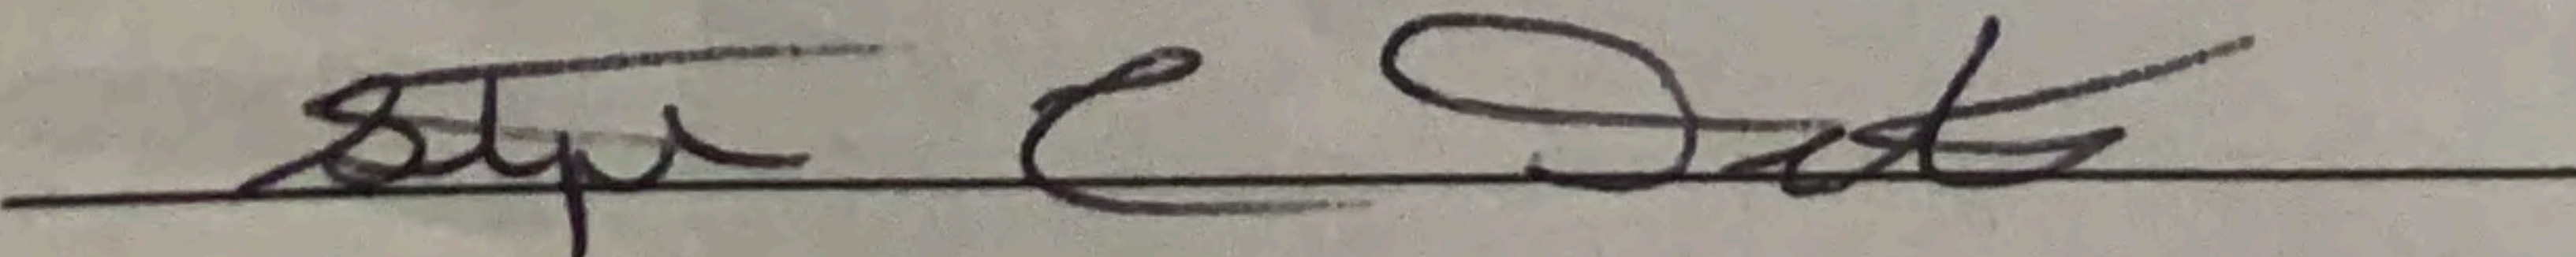
Print Name: Mike Kurylenak Date: 7/12/21

Signed: 

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: Stephen C. Detrick MSG Date: 7/12/21

Signed: 

E-Mail: Stephen.C.Detrack.mil@mail.mil





