

**CERTIFICATION OF WORK
SERVICE CALL**

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: VA049

Date of Visit: 6/28/2022

Contractor Personnel on Site:

1. PETER LANGSTON

2. RICK DARDEN

3. _____

4. _____

5. _____

6. _____

Service Call Number

CSS# 32297

WO# 15004

Description of Repairs

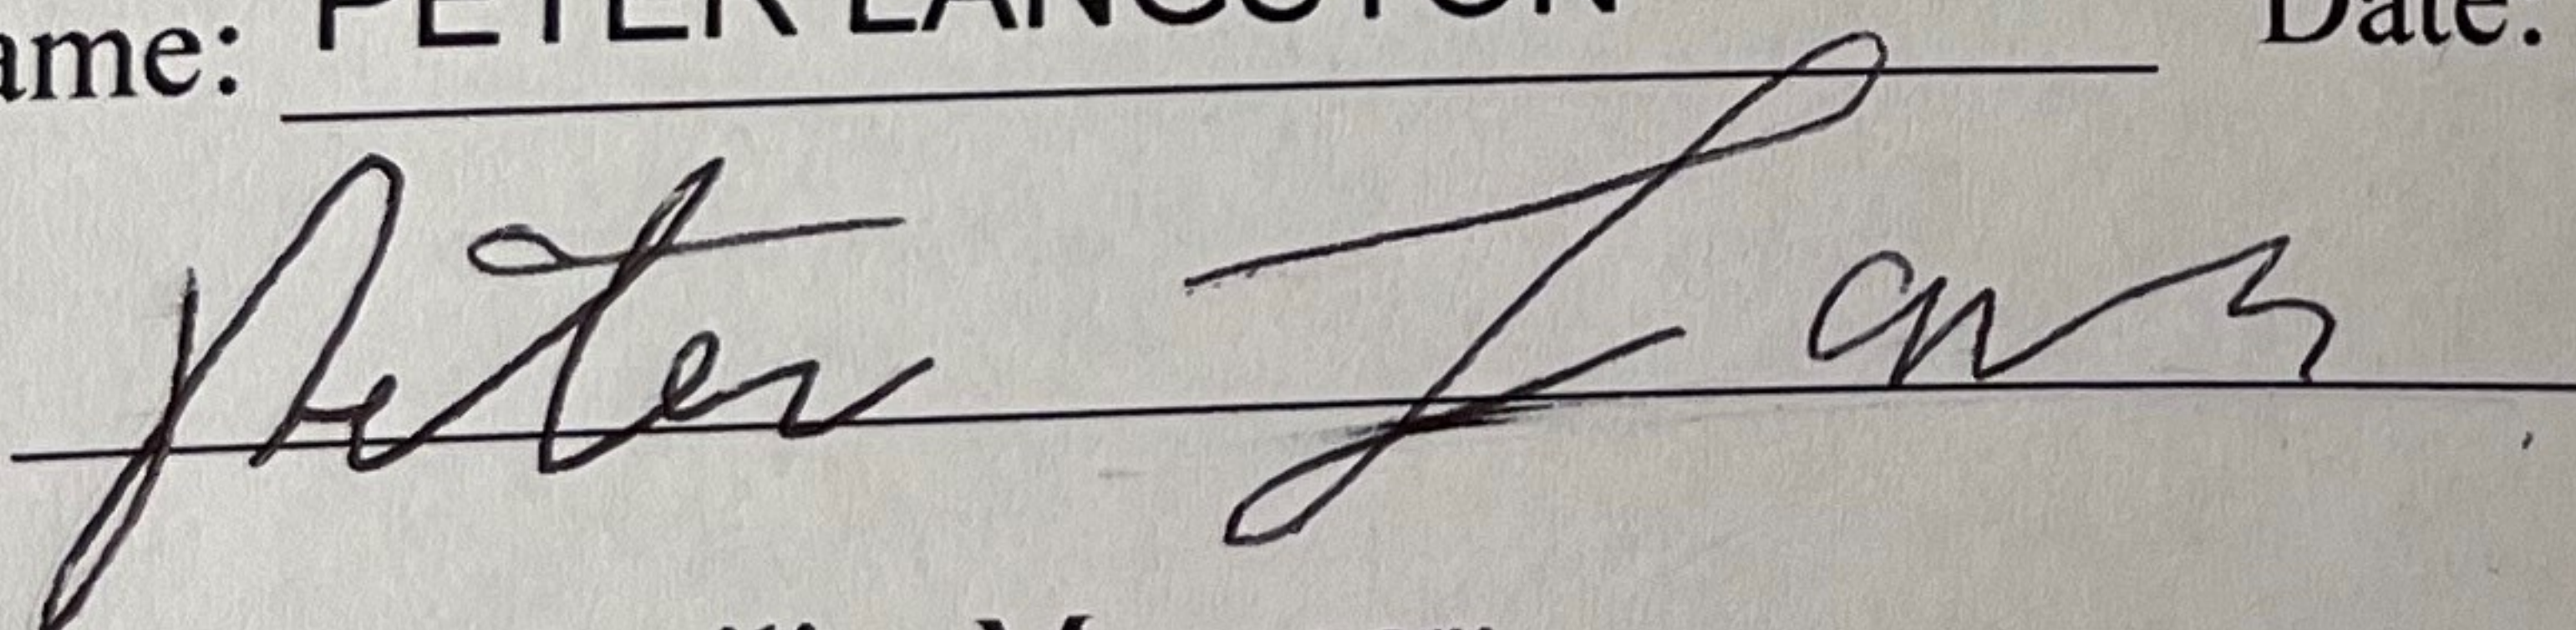
HVAC REPLACEMENT UNIT 3 TON

CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: PETER LANGSTON

Date: 6/28/2022

Signed: 

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: _____ Date: _____

Signed: _____

E-Mail: _____

SERIAL NUMBER

722E17143

PRODUCT NUMBER

5HCE436AP051011

MODEL NUMBER

5HCE436A510



METERING TXU 57 PISTON
DEVICE INDOOR OUTDOOR

FACTORY CHARGED R410A
7.67 LBS 3.48 KG

INDOOR TXU SUB COOLING 11 °F

POWER SUPPLY 208/230 VOLTS AC
3 PH 60 HZ

PERMISSIBLE VOLTAGE AT UNIT
253 MAX 187 MIN

SUITABLE FOR OUTDOOR USE

COMPRESSOR 208/230 VOLTS AC
3 PH 60 HZ
8.46 RLA 70.0 LRA

FAN MOTOR 208/230 VOLTS AC
1 PH 60 HZ
1/5 HP 1.10 FLA

DESIGN/TEST PRESSURE GAGE
HI 450 PSI 3103 KPA
LO 250 PSI 1724 KPA

MAX DESIGN/WORKING PRESSURE
700 PSIG 4826 KPA

MINIMUM CIRCUIT AMPS 11.7

MAX FUSE 20 A MAX CKT-BKR 20 A

Short Circuit Current: 5kA rms, symmetrical, 230V

DATE OF MANUFACTURE FEB 2022



HEAT PUMP 3R39



Manufactured in USA from domestic and foreign parts

Carrier Corporation
7310 West Morris St.
Indianapolis, IN 46231

341212-4032

THIS EQUIPMENT COMPLIES WITH THE EFFICIENCY
REQUIREMENTS OF ASHRAE 90.1-2016

3







180-001

Carrier

3

180-001

180-001

180-001

180-001