

**CERTIFICATION OF WORK
SERVICE CALL**

(To be completed by the Contractor and saved in the Contractor's CMMs)

FACID/Building: USARC VA006 Date of Visit: 2-28-22

Contractor Personnel on Site:

1. MOORES Electric
2. _____
3. _____
4. _____
5. _____
6. _____

Service Call Number

CSS# 34455 WO# 16432

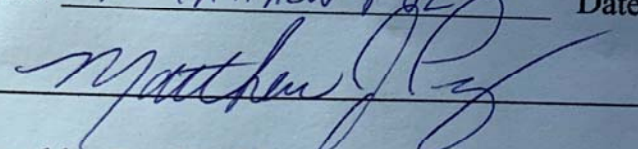
Description of Repair:

Removed Both LWCO Sensors on Boiler 1+2
Replaced w/ new ones. Replaced P+T gauge also
as per quote - Tested operation Both Boilers
WORK CORRECTLY @ this Time. Both LWCO are
Lite and Function properly.

CERTIFICATION OF WORK

To be signed by the Contractor:


Print Name: Matthew Puz Date: 2-28-22

Signed: 


To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor. it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: Michael A. Geren CW4 Date: 2/28/2022

Signed: 

E-Mail: michael.a.geren4.mil@Army.mil



TEST

POWER

LOW WATER

Service if Blinking

LOW WATER CUT OFF

HOLD LINE 15 MIN SET



AIR PRESS
SWITCH

TEST
POWER OFF
LOW WATER
SERVICE if Blinking

Y R