CERTIFICATION OF WORK
SERVICE CALL

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: VA099 Date of Visit: 3-07-2022

Contractor Personnel on Site:

1. Samuel McCartney
2. Zach Weast
3. _____
4. _____
5. _____
6. _____

Service Call Number

CSS# COM0275404 WO# 16752

Description of Repairs

Kitchen Fan KEF-1 NOT WORKING.
checked voltage, pulled control relay in and replaced relay; FAN Working at this time.
-Recomned ANSIL system tech check further.-

CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: Samuel L McCartney Date: 3-07-2022

Signed: Samuel L McCartney

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: Richard Murphy SFC Date: 20220307

Signed: _____

E-Mail: richard.b.murphy16.mil@army.mil

Schneider Electric
LC1 D09
13 NO 21 NC A1
14 NO 22 NC A2
TeSys
Allen-Bradley
120V AC
CAT
700-HA32A1-3
SER-D
To MUA Control
Supply
EXHAUST
Fan
KLEIN TOOLS
CL700
Hz%
A~
V≂
OFF
NCV
SEL
RANGE
MAX MIN
6000 Counts
600A AC Digital Clamp Meter
AUTO
True RMS
TOUGH METER
CAT III 1000V
CAT IV 600V
COM
Hz % Temp

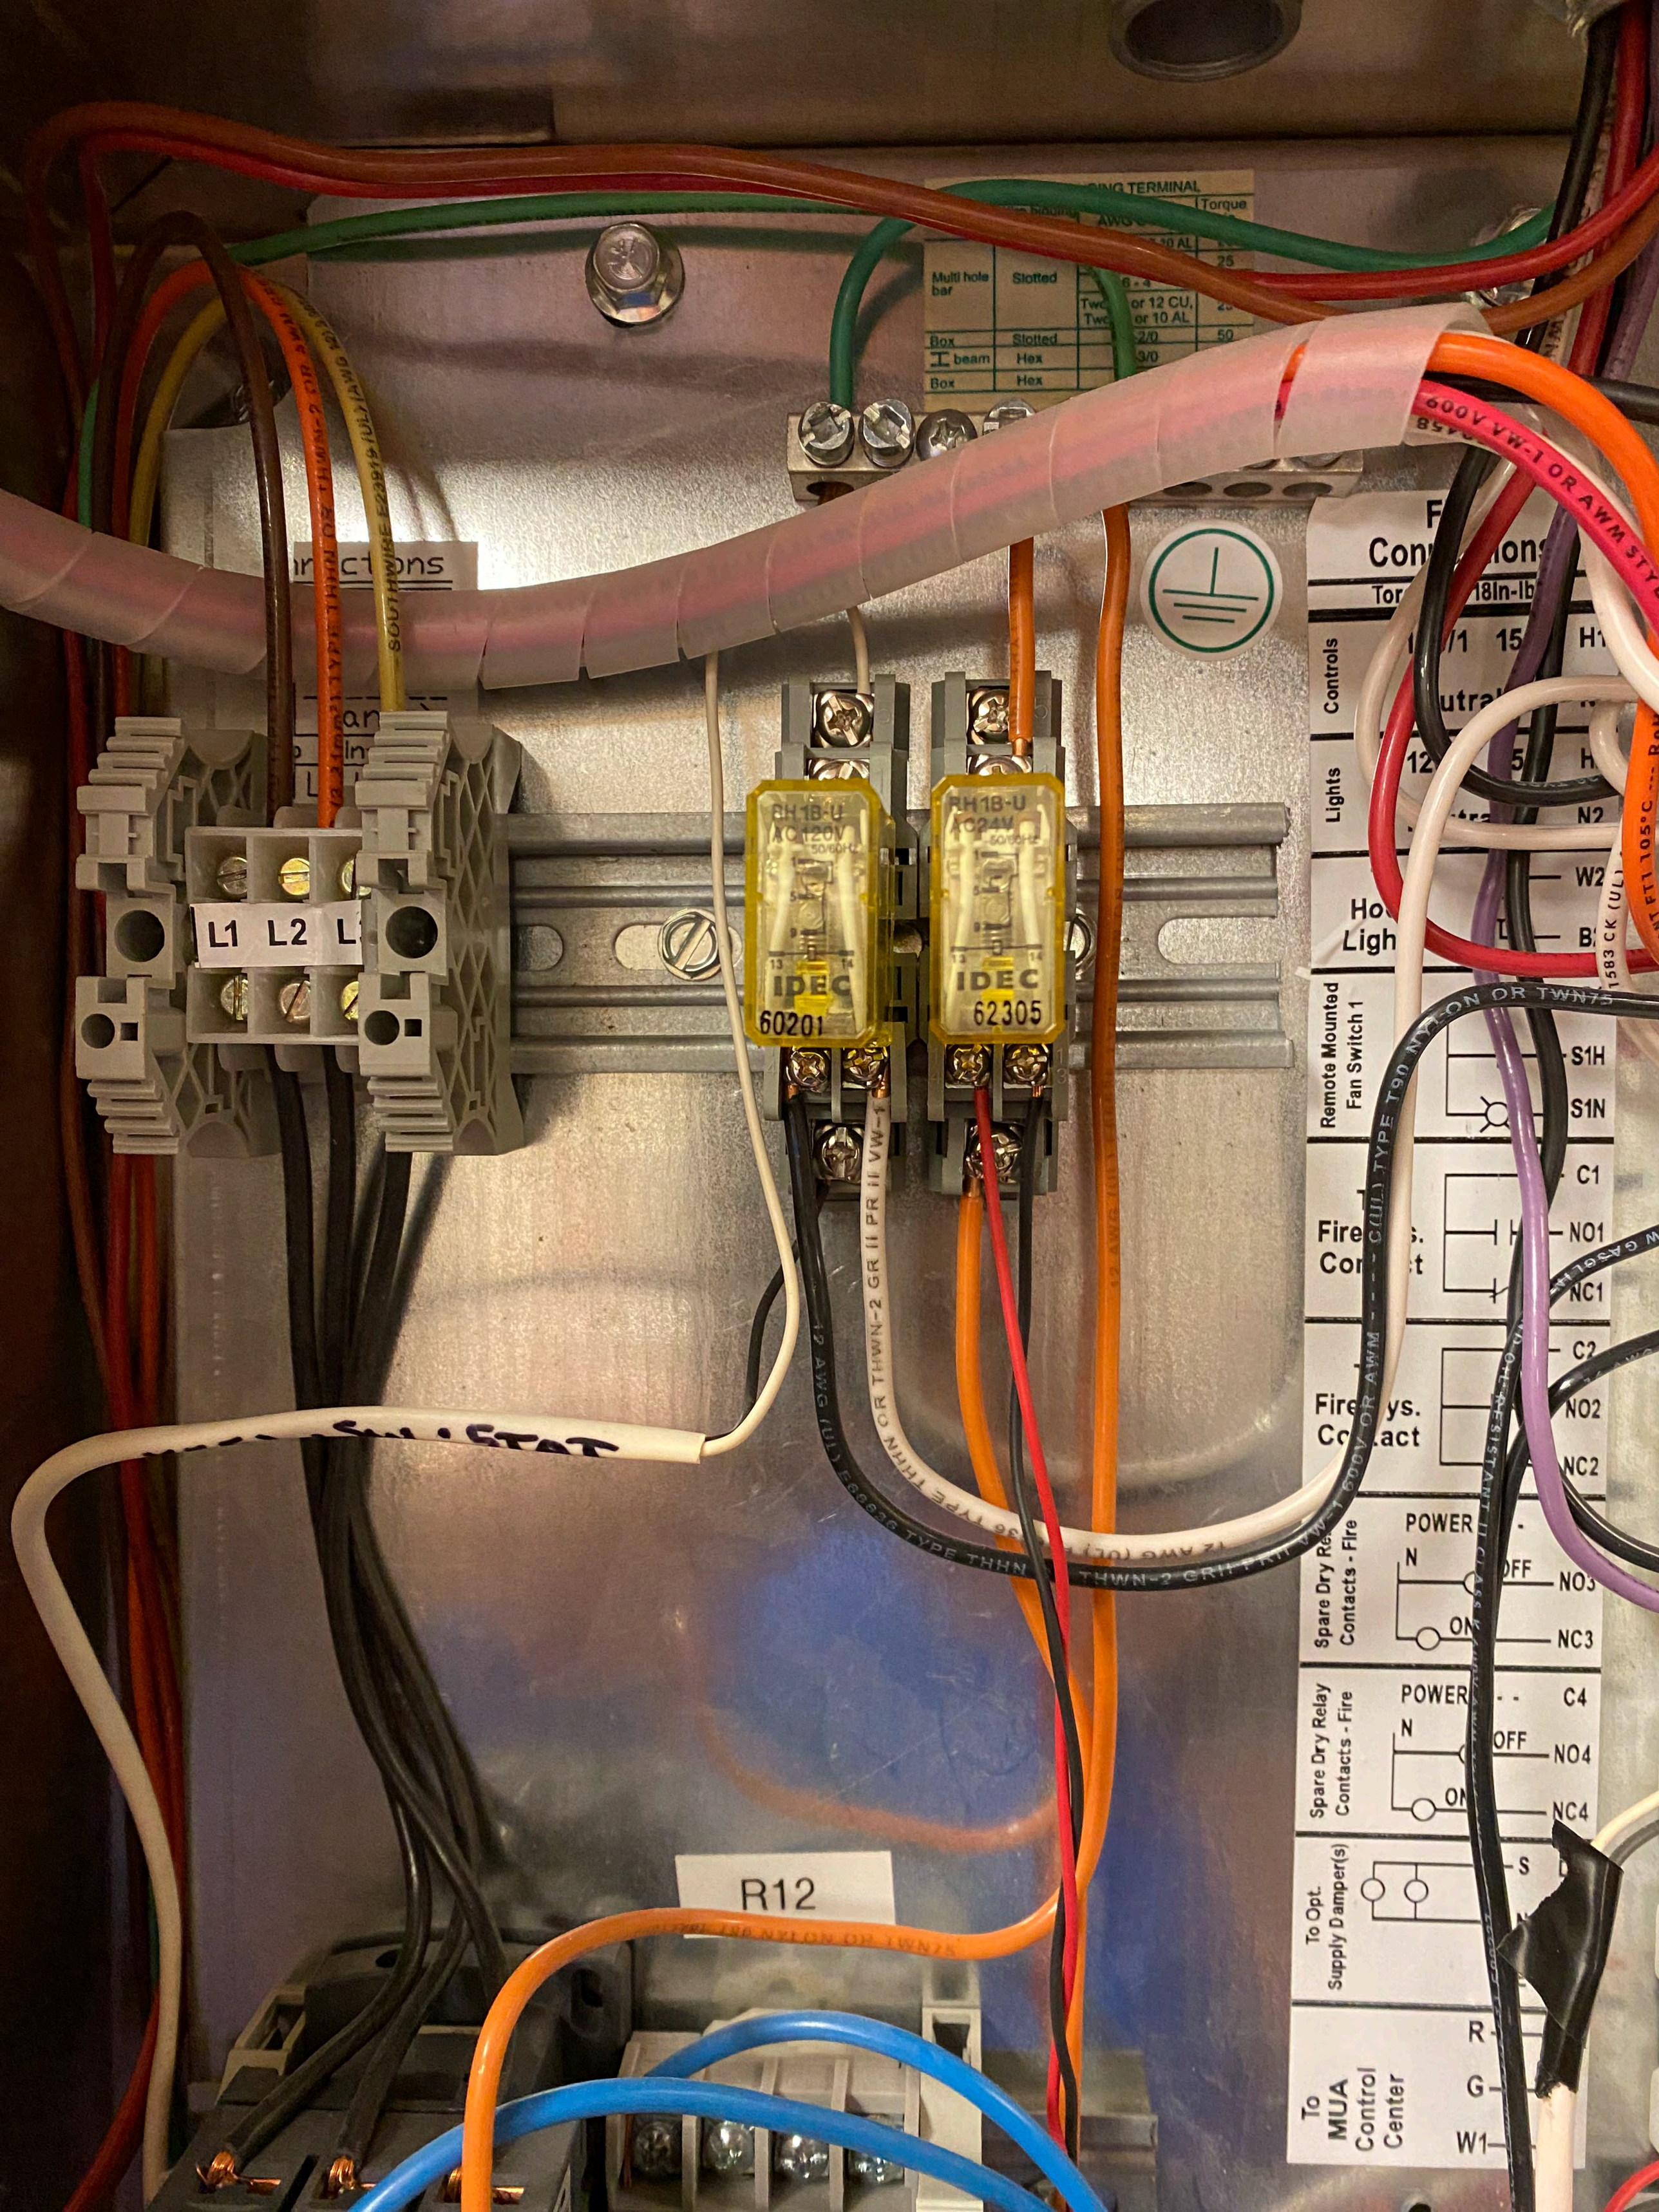
Multi hole bar
Slotted
Box
Slotted
I beam
Hex
Box
Hex
Torque
25
50
or 12 CU,
or 10 AL
2/0
3/0
L1 L2 L3
RH1B-U
AC120V
50/60Hz
60201
RH1B-U
AC24V
50/60Hz
62305
IDEC
600V VW-1 OR AWM STYLE
Controls
Lights
Remote Mounted Fan Switch 1
S1H
S1N
C1
NO1
NC1
C2
NO2
NC2
POWER
N
OFF
ON
NO3
NC3
C4
NO4
NC4
Spare Dry Relay Contacts - Fire
To Opt. Supply Damper(s)
To MUA Control Center
R
G
W1
R12

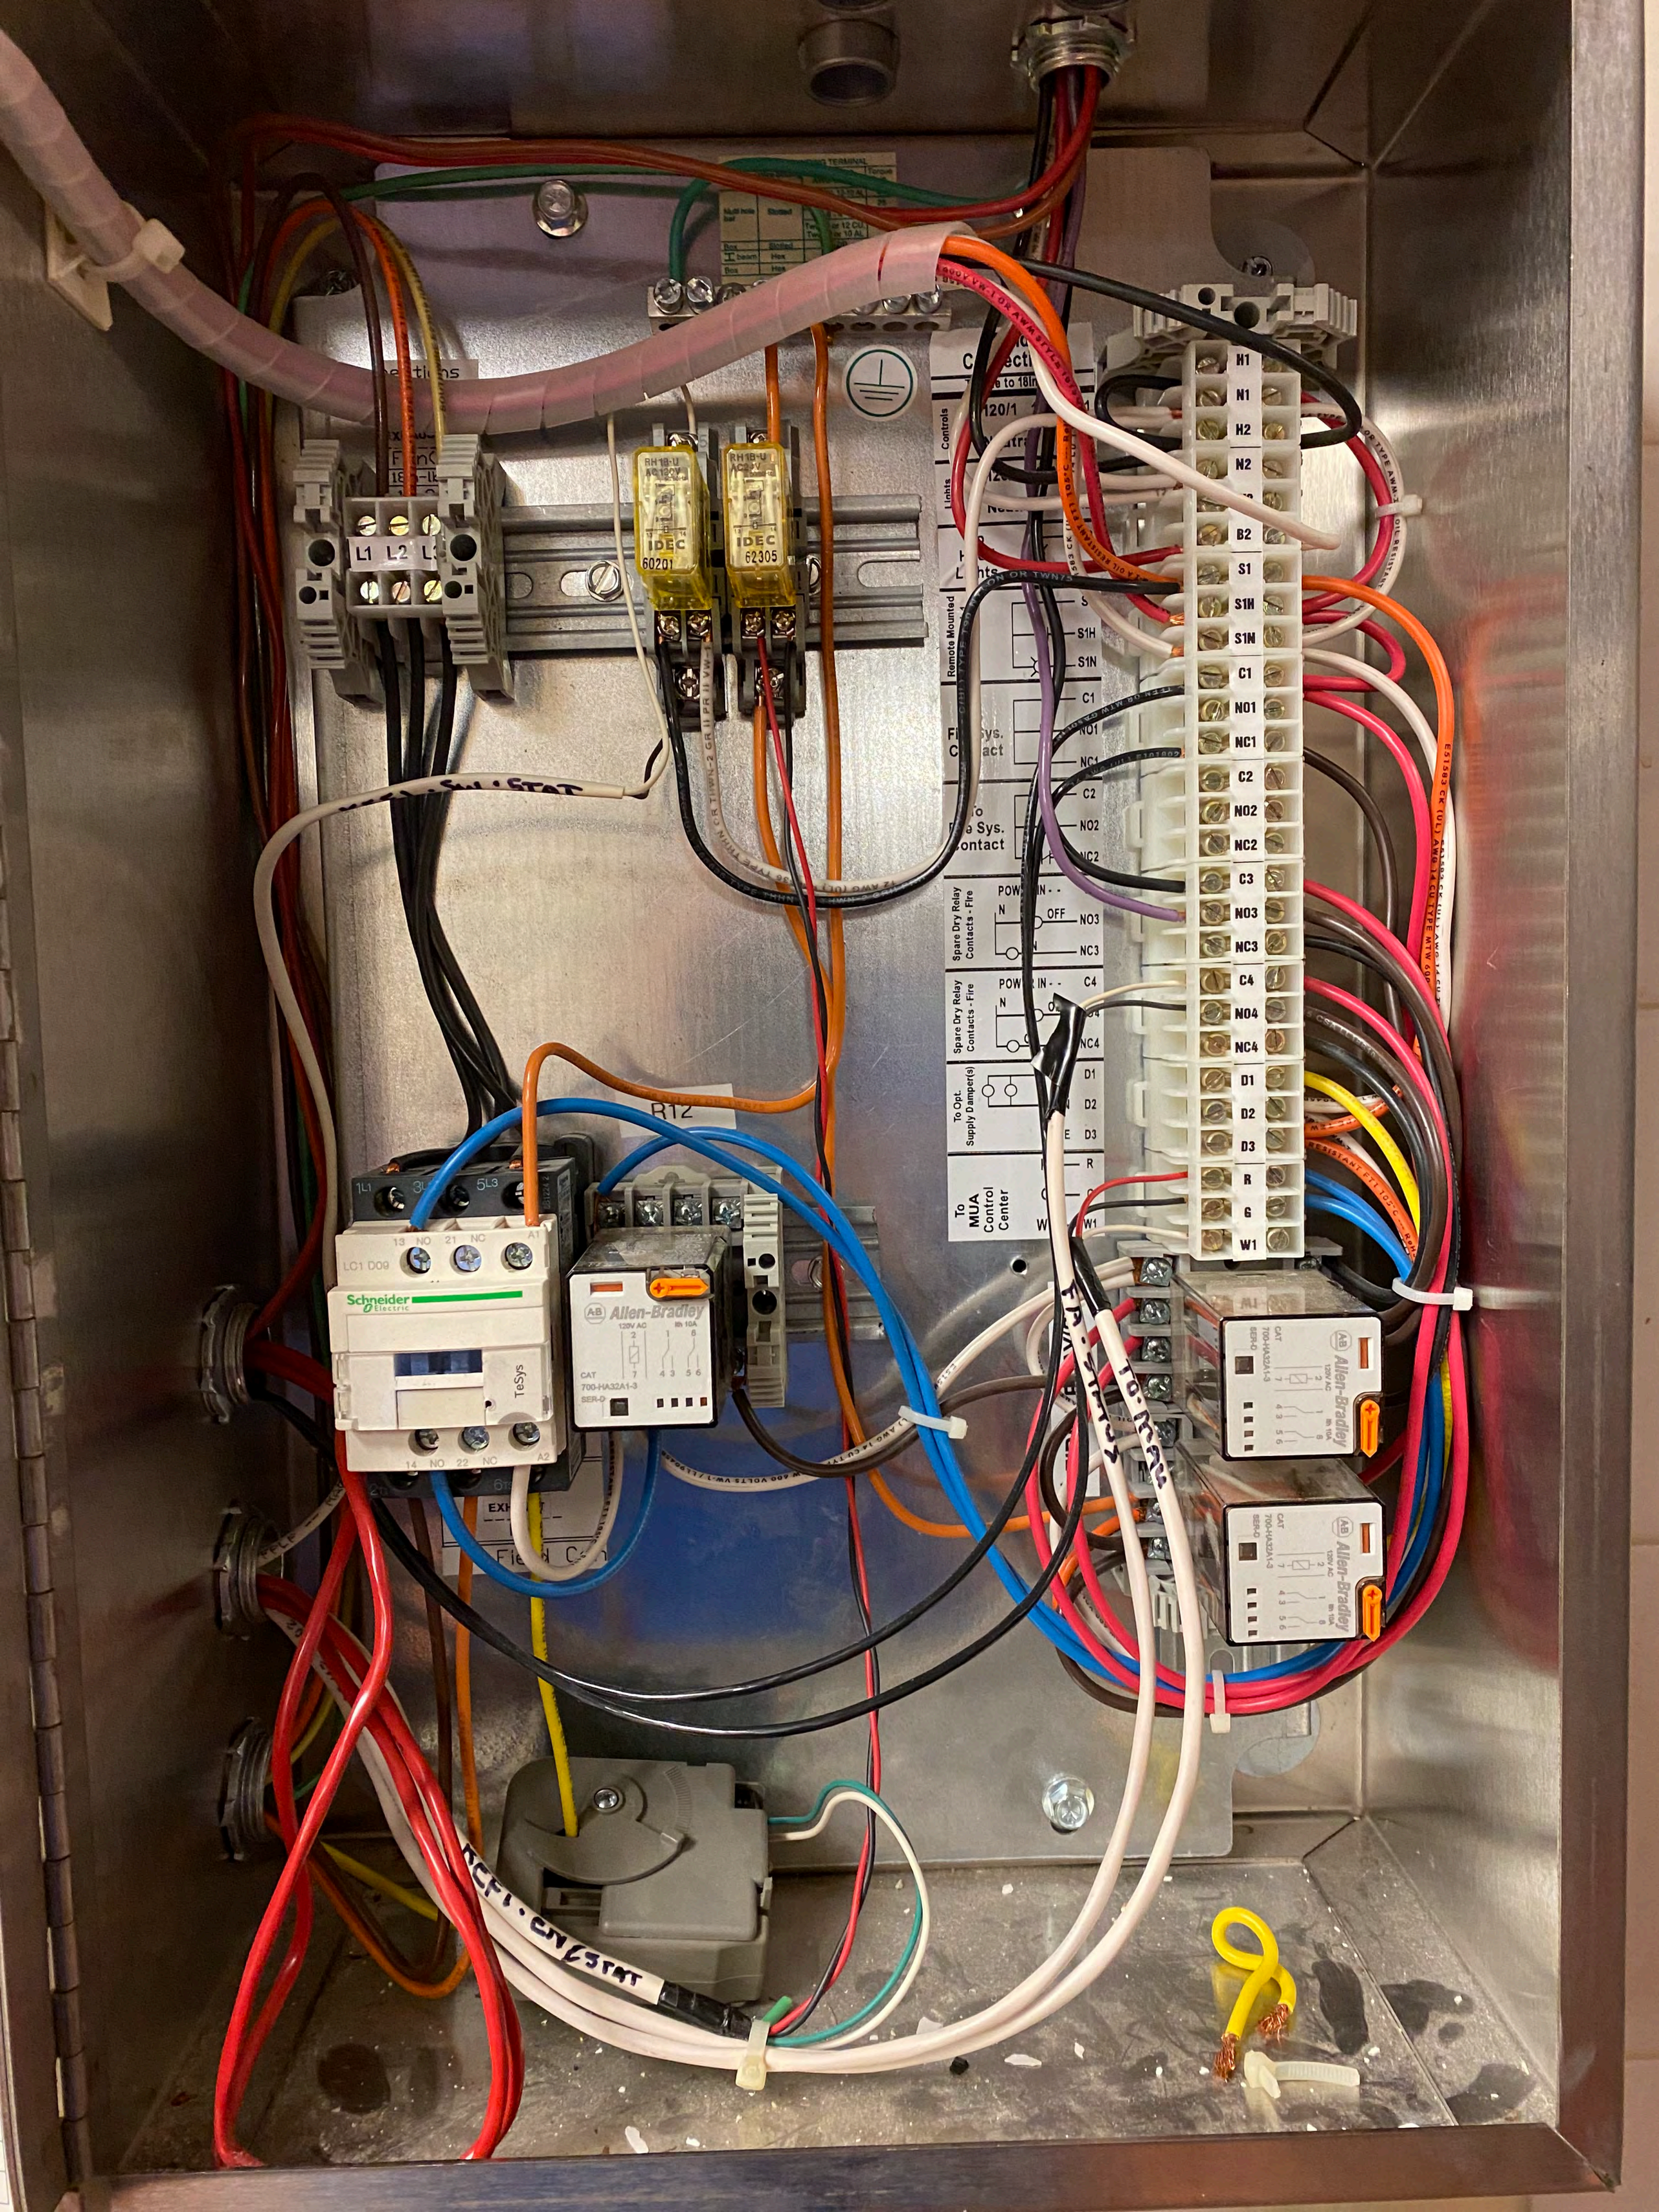
L1 L2 L3
IDEC
60201
IDEC
62305
H1
N1
H2
N2
B2
S1
S1H
S1N
C1
NO1
NC1
C2
NO2
NC2
C3
NO3
NC3
C4
NO4
NC4
D1
D2
D3
R
G
W1
Remote Mounted
Controls
Lights
To MUA Control Center
Spare Dry Relay Contacts - Fire
To Opt. Supply Damper(s)
R12
LC1 D09
Schneider Electric
TeSys
Allen-Bradley
700-HA32A1-3
SER-D
EXHAUST
Field Con
FR-SMK
TO-MAU
RCFI-CNTSTAT

GREENHECK

LIGHTS

FAN

KEF-1

IN CASE OF FIRE

DO NOT

TURN OFF FAN

LABEL NO. 11692

WARNING

TO AVOID SERIOUS INJURY OR DEATH, DISCONNECT ELECTRICAL POWER PRIOR TO SERVICING.

453292