

CERTIFICATION OF WORK
(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID Building: MDC20

Date of Visit: 10-17-18

Contractor Personnel on Site:

- | | |
|-----------------------|----------|
| 1. <u>Jim Moltz</u> | 4. _____ |
| 2. <u>Pat Davison</u> | 5. _____ |
| 3. _____ | 6. _____ |

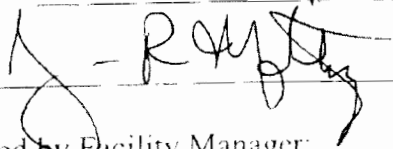
Service Calls – Service Call Number and Description

- | |
|--|
| 1. <u>Annual Changeover, Summer, Winter</u> |
| 2. _____ |
| 3. <u>Energized & cleaned 4 Boilers.</u> |
| <u>w/o numbers 5936, 37, 38, 39</u> |

CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: James Moltz Date: 10-17-18

Signed: 

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: Clayton A. White, LTC Date: 20181017

Signed: 

E-Mail: clayton.a.white.mil@mail.mil

PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST BOILER - ELECTRIC, GAS, OIL

SITE AND BLDG #:

Riverside MD 20630

MECHANIC SIGNATURE:

[Signature]

DATE:

10/23/18

LOCATION/RM #:

Mechanical Room

WO#

5938

ASSET #

2065

START TIME:

12:45

FINISH TIME:

12:45

1	In addition to the procedure(s) outlined in this standard, the equipment manufacturer's recommended maintenance procedure(s) and/or instruction(s) shall be strictly adhered to	☒	<i>Done</i>
2	Verify that the annual inspections for the boiler have been satisfactorily performed	☒	<i>Inspection Sched. for 10/23 w. August</i>
3	Follow Lock out Tag out procedures at all times. De-energize or discharge all hydraulic, electrical, mechanical, or thermal energy prior to beginning work. Wear appropriate respirator, goggles, and gloves while in contact with hazardous materials	☒	<i>Done</i>
4	All automatically and manually operated control devices provided for controlling operation and safety of the vessel, steam or water pressure, hot water temperature, combustion, and boiler water level shall be inspected under operating conditions	☒	<i>all good</i>
5	All associated valves and piping, pressure and temperature indicating devices, metering and recording devices, and all boiler accessories shall be inspected under operating conditions	☒	<i>all good</i>
6	Prepare boiler for internal inspection in the following manner:	☒	<i>Done</i>
7	Fuel supply and ignition system shall be locked out	☒	<i>Done</i>
8	Water shall be drawn off and water side thoroughly washed out	☒	<i>Done</i>
9	Manhole and handhole plates, washout plugs, and inspection plugs in water column connections shall be removed	☒	<i>Done</i>
10	The boiler shall be cooled and thoroughly cleaned	☒	<i>Done</i>
11	All grates or internally fired boilers shall be removed	☒	<i>Done</i>
12	Pressure gage(s) shall be removed and tested	☒	<i>all good</i>
13	Any leakage of steam or hot water into the boiler shall be prevented by disconnecting the pipe or valve at the most convenient point	☒	<i>no leaks visible</i>
14	Before opening the manhole and entering any part of the boiler, the required steam or water system stop valves must be closed, tagged, and padlocked. All drain valves or cocks located between the two valves shall be opened	☒	<i>N/A</i>
15	Inspector will not enter boiler until satisfied that necessary safety precautions and pre inspection preparations have been made	☒	<i>N/A</i>

16	If a boiler has not been properly prepared for an internal inspection, the inspector should decline to make the inspection.	/		Peric
17	If materials to be worked on are known or suspected to contain asbestos, check the building's asbestos management plan to see if they have been tested for asbestos. If they are suspect but have not been tested, have them tested. Manage asbestos in accordance with the plan.	N/A		
18	Account for all tools, materials, and equipment before closing boiler.	/		
1	Check boiler room for ventilation in accordance with the American Gas Association (AGA) burner requirements.	/		Good
2	Check operation of all gas controls and valves including manual gas shutoff, petal gas regulator, safety shutoff valve (solenoid), automatic gas valve, petal solenoid valve, butterfly gas valve, motor, and linkage to air handler, safety petal solenoid (if used).	/		all good
3	Check flue connections for tight joints and minimum resistance to air flow (combustion chamber, flues, breeching, and chimney are clear before firing).	/		Good
4	Draft regulators require slightly negative pressure in the combustion chamber at maximum input.	/		Good
5	On forced draft burners, gas manifold pressure requirements should correspond with modulating (butterfly) valve in full open position and stable at all other firing rates.	/		Good/ok No flash back
6	Check burner for flashback and tight shutoff of fuel.	/		all good
7	Check operation of automatic controls and combustion flame safeguards.	/		all good
8	Clean and adjust, if necessary.	/		all good
9	Replace fusible plugs, if applicable.	/		all good
9	Operation and adjustments should conform with manufacturer's instructions.	/		all good

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and direct material cost) per PM occurrence. For any deficiencies found exceeding \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed description of the deficiency.

To be performed by: HVAC Technician

Additional Notes:

- Inspect boiler with 3rd party inspector
- Removed Side Panels
- Cleaned burner tubes
- performed Hydrostatic Test on safety valves
- Tested High limit switch
- Tested & drained/refilled Expansion Tanks
- Checked fire end/water sides
- Tuned boiler on for season