

Argent Inspections

Form AI-03


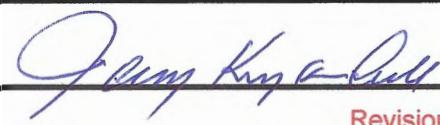
Boiler Inspection Report

Inspection Date 10/8/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2026/2026	Next Strength Test
Inspection Type(s) Performed					
<input checked="" type="checkbox"/> Internal <input type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness					
Customer 99th RSC R4A Z2 NY010 USARC Amherst			Boiler Location Name and/or Building Number Boiler Room 05		
Address 100 North Forest Rd.			Boiler Location Address		
City Amherst	State NY	Zip 14221-5244	City	State	Zip 0
National Board # 503178	Jurisdiction # Asset# 6589	Property # #1	Boiler Use Closed Heating Loop	Fuel Type Natural Gas	
Manufacturer Lochinvar		Model # KBN701		Serial # 2043121515356	Year Built 2020
Capacity 700,000 BTU/HR	Design Pressure 160 psi	Operating Pressure 30 psi	Programmer Manufacturer Lochinvar	Burner Manufacturer Lochinvar	
Number of Safety Valves 1	Combustion Efficiency % CO2	ppm CO	% Excess O2	Flue Gas Temperature Degrees F	
Valve 1	Valve Manufacturer Watts	Size 3/4"	Set Pressure 50 psi	Capacity 1,352,000 BTU/HR	Lift Pressure Hand
Valve 2					Sat
Valve 3:					
Valve 4:					
Safety Devices Tested Flame Rod, Combustion Air Switch by Blower Speed, Flow Switch, Condensate Drain Switch, Operating Temperature Control, Auto Reset High Temperature Limit, High Temperature limit Manual Rest, High Gas Pressure Switch, Low Gas Pressure Switch, The safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1 (d). It lifted freely and reseated with no leakage.					
Reason(s) for Declining Certification No E-Stop installed as required by ASME-CSD-1 CE 110(b) (repeat finding from last years report). Install a lockable disconnect adjacent to boiler as required by ASME-CSD-1 CE 110 (a)					
Comments This Hot Water Heating Boiler was inspected per UFC 3-430-07, and the National Board Inspection Code. Light debris observed on firesides, there was no evidence of leakage with 20 psi applied to watersides. All safety devices tested functioned properly during the inspection process. No E-Stop installed as required by ASME-CSD-1 CE 110(b). This is a repeat finding from the last 2 inspections. No lockable disconnect adjacent to boiler as required by ASME-CSD-1 CE 110 (a). Carbon Monoxide monitor/alarm is installed as required by NBIC Part 1 Section 1.6.9.					
Inspector Commission 13373	Inspector Dale Brooks	Signature <i>Dale O. Brooks</i>			
Attachments Yes 2 Pages	Technical Manager Jerry Kuykendall	Signature <i>Jerry Kuykendall</i>			

Argent Inspections

Form AI-03

Boiler Inspection Report

Inspection Date 10/8/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2027/2026	Next Strength Test
Inspection Type(s) Performed <input checked="" type="checkbox"/> Internal <input type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness					
Customer 99th RSC R4A Z2 NY010 USARC Amherst			Boiler Location Name and/or Building Number Boiler Room 05		
Address 100 North Forest Rd.			Boiler Location Address		
City Amherst		State NY	Zip 14221-5244	City	
State NY		Zip 14221-5244		State	Zip
National Board # 503174	Jurisdiction # Asset# 6606	Property # #2	Boiler Use Closed Heating Loop		Fuel Type Natural Gas
Manufacturer Lochinvar		Model # KBN701		Serial # 2043121515358	Year Built 2020
Capacity 700,000 BTU/HR	Design Pressure 160 psi	Operating Pressure 30 psi	Programmer Manufacturer Lochinvar		Burner Manufacturer Lochinvar
Number of Safety Valves 1	Combustion Efficiency % CO2 ppm CO % Excess O2				Flue Gas Temperature Degrees F
	Valve Manufacturer Watts	Size 3/4"	Set Pressure 50 psi	Capacity 1,352,000 BTU/HR	Lift Pressure Hand
Valve 1					Reseat Pressure Sat
Valve 2					
Valve 3:					
Valve 4:					
Safety Devices Tested Flame Rod, Combustion Air Switch by Blower Speed, Flow Switch, Condensate Drain Switch, Operating Temperature Control, Auto Reset High Temperature Limit, High Temperature limit Manual Rest, High Gas Pressure Switch, Low Gas Pressure Switch, The safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1 (d). It lifted freely and reseated with no leakage.					
Reason(s) for Declining Certification No E-Stop installed as required by ASME-CSD-1 CE 110(b) (repeat finding from last years inspection). Install a lockable disconnect adjacent to boiler as required by ASME-CSD-1 CE 110(a).					
Comments This Hot Water Heating Boiler was inspected per UFC 3-430-07, and the National Board Inspection Code. Light debris observed on firesides. All safety devices tested functioned properly during the inspection process. No E-Stop installed as required by ASME-CSD-1 CE 110(b) . Carbon Monoxide monitor/alarm installed as required by NBIC Part 1 Section 1.6.9.					
Inspector Commission 13373	Inspector Dale Brooks	Signature 			
Attachments Yes 2 Pages	Technical Manager Jerry Kuykendall	Signature 			

Argent Inspections

Form AI-03

Boiler Inspection Report

Inspection Date 10/8/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2026/2026	Next Strength Test	
Inspection Type(s) Performed <input checked="" type="checkbox"/> Internal <input type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness						
Customer 99th RSC R4A Z2 NY010 USARC Amherst			Boiler Location Name and/or Building Number Boiler Room 05			
Address 100 North Forest Rd.			Boiler Location Address			
City Amherst		State NY	Zip 14221-5244	City		
National Board # 503186	Jurisdiction # Asset# 6589	Property # #3	Boiler Use Closed Heating Loop	Fuel Type Natural Gas		
Manufacturer Lochinvar		Model # KBN701		Serial # 2043121515355	Year Built 2020	
Capacity 700,000 BTU/HR		Design Pressure 160 psi	Operating Pressure 30 psi	Programmer Manufacturer Lochinvar	Burner Manufacturer Lochinvar	
Number of Safety Valves 1		Combustion Efficiency % CO2 ppm CO % Excess O2 Flue Gas Temperature Degrees F				
Valve 1	Valve Manufacturer Watts	Size 3/4"	Set Pressure 50 psi	Capacity 1,352,000 BTU/HR	Lift Pressure Hand	Reseat Pressure Sat
Valve 2						
Valve 3:						
Valve 4:						
Safety Devices Tested Flame Rod, Combustion Air Switch by Blower Speed, Flow Switch, Condensate Drain Switch, Operating Temperature Control, Auto Reset High Temperature Limit, High Temperature limit Manual Rest, High Gas Pressure Switch, Low Gas Pressure Switch, The safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1 (d). It lifted freely and reseated with no leakage.						
Reason(s) for Declining Certification No E-Stop installed as required by ASME-CSD-1 CE 110 (b) (repeat finding from last years inspection). Install a lockable disconnect adjacent to boiler as required by ASME-CSD-1 CE 110 (a).						
Comments This Hot Water Heating Boiler was inspected per UFC 3-430-07, and the National Board Inspection Code. Light debris observed on firesides. All safety devices tested functioned properly during the inspection process. No E-Stop installed as required by ASME-CSD-1 CE 110 (b). No lockable disconnect adjacent to boiler as required by ASME-CSD-1 CE 110 (a). Carbon Monoxide monitor/alarm is installed as required by NBIC Part 1 Section 1.6.9.						
Inspector Commission 13373	Inspector Dale Brooks	Signature 				
Attachments Yes 2 Pages	Technical Manager Jerry Kuykendall	Signature 