

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

CERTIFICATION OF WORK

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: NY023-200 Date of Visit: 3/16/20

Contractor Personnel on Site:

1. Deen Rowe 2. _____

Work Performed: Changed the transformer for automatic sink and toilet and replaced batteries at the sink

Preventive Maintenance - (Annual, Quarterly, Monthly, equipment identification, etc.)

Service Orders - Automatic Toilet and Automatic Sink (1½ hrs of diagnostics and 1½ hrs of Labor = 3 hrs total)

3 hrs total For Work

CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: Deenvaughn Rose Date: 3/16/20

Signed: 


By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

To be signed by Facility Manager:

Print Name/Rank: Louis Corzo AFO S Date: 3/17/20

Signed: Daniel L. Corzo


E-Mail: Louis.A.Corzo.CTR@mac.com.mil



ZURN®
LINEAR REGULATED POWER SUPPLY
PART NO : 80501001
MODEL NO : AP7798
INPUT : 120V AC 60Hz
OUTPUT : 5VDC MIN
@2A
1S ON 60S OFF
I/P LEADS WHITE
BLACK
O/P LEADS RED (+)
BLUE (-)
TECHNOLOGIES INC.
HICKSVILLE, NEW YORK
MADE IN TAIWAN

apx

P6000-HW6 WIRING

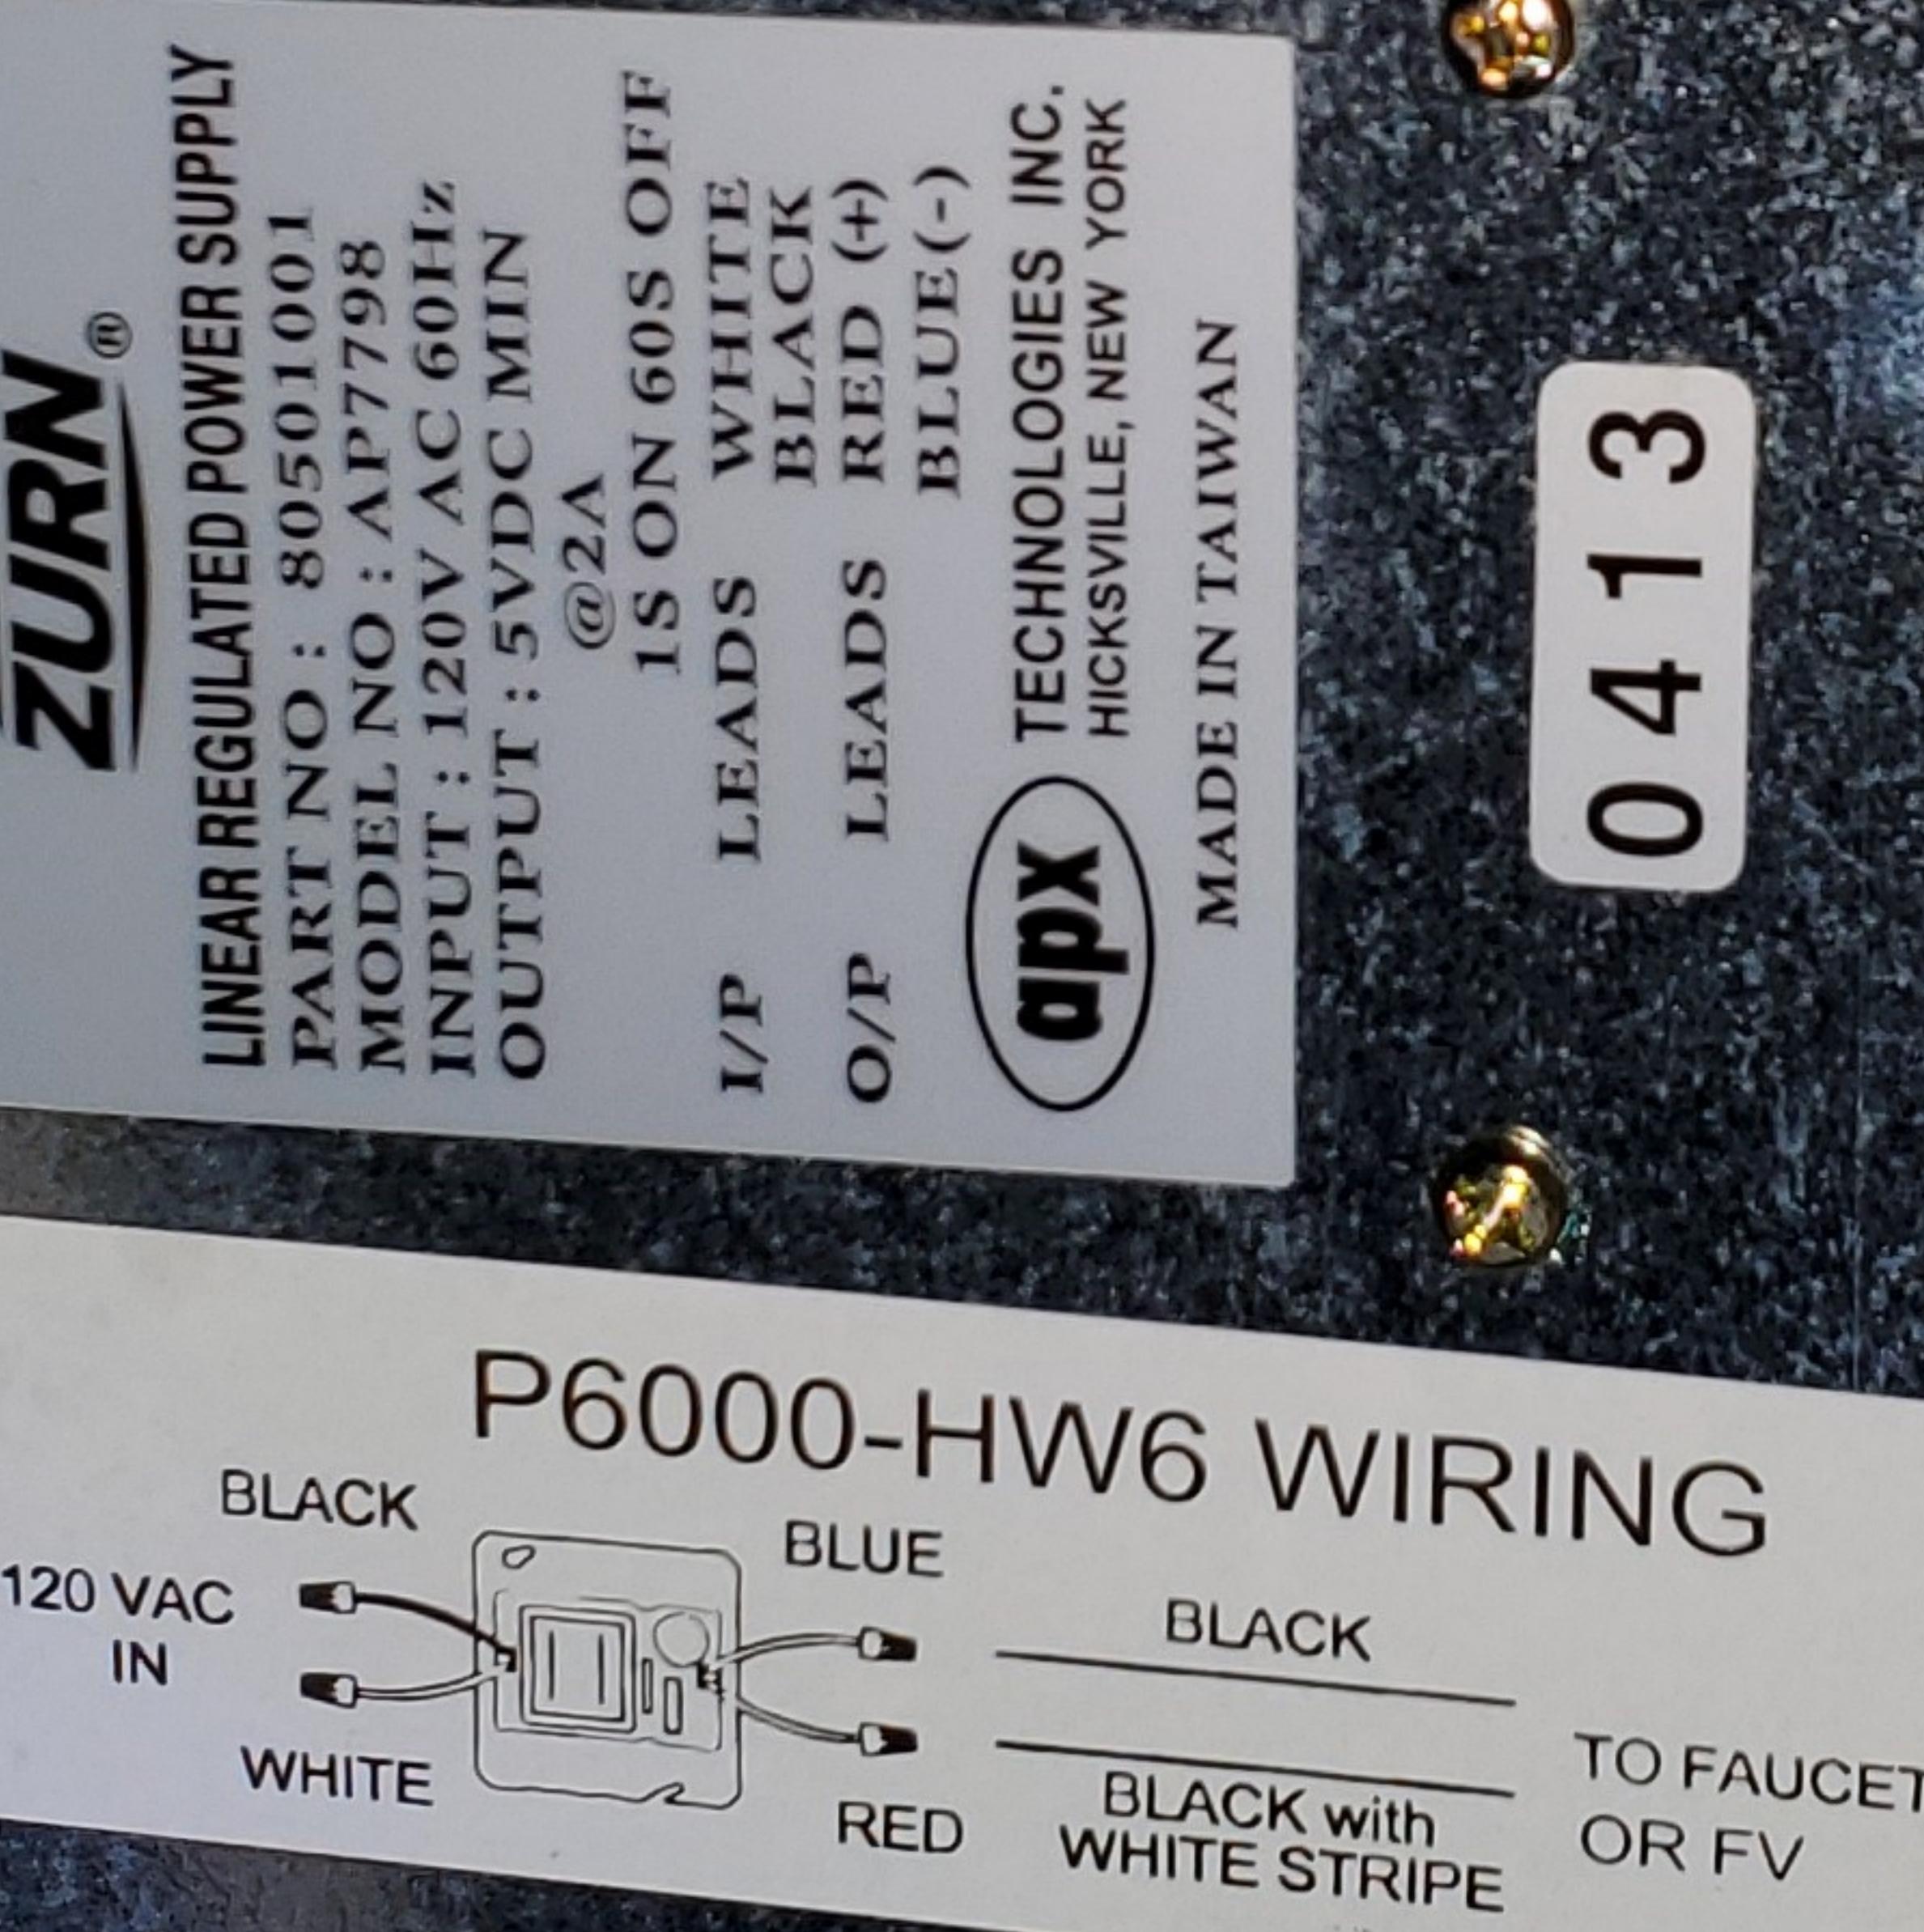

0413