

**PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST
FIRE DETECTION AND ALARM SYSTEM (VISUAL INSPECTION ONLY)**

SITE AND BLDG #: NY065 BLDG1

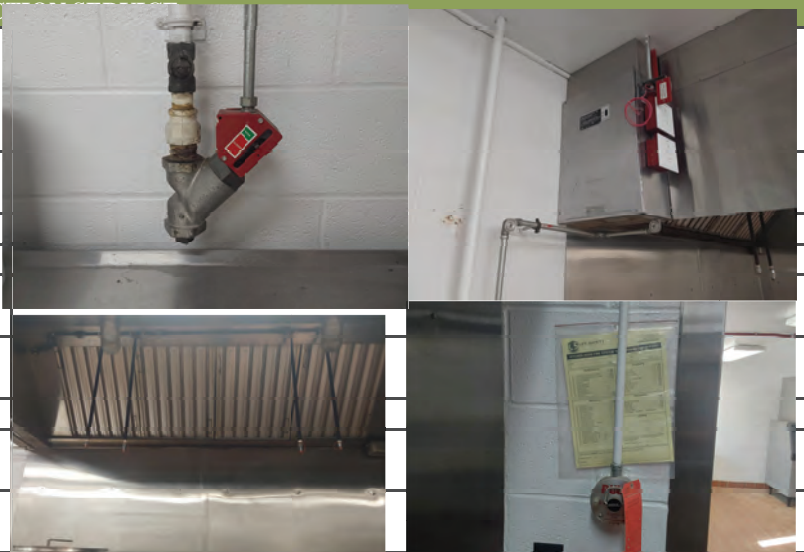
MECHANIC SIGNATURE: 

DATE: 3/2/26

LOCATION/RM #: kitchen **WO#** 21316 **ASSET #** G166

START TIME: 9:15am

FINISH TIME: 9:30am

CHECK POINT	CHECKPOINT DESCRIPTION	TASK COMPLETE		NOTES/ ACTIONS (IF TASK COMPLETE IS CHECKED NO, PROVIDE EXPLANATION)
		YES	NO	
TO BE PERFORMED AT EACH INSPECTION				
1	FIRE ALARM CONTROL PANEL AND ANNUNCIATOR EQUIPMENT - Visually inspect pannel condition (connections, fuses, light-emitting diodes [LEDs]) Note any trouble signals and last annual certification date.	✓		
2	BATTERIES - Inspect for corrosion or leakage. Verify tightness of connections.	✓		
3	PULLS HANDLES - Verify all appear in working order without damage.	✓		
4	HEAT SENSORS - Verify all appear in working order without damage.	✓		
5	AUDIO VISUAL ALARMS - Verify all Alarms appear in working order without damage.	✓		
6	SMOKE DETECTORS - Verify all Smoke Detectors appear in working order without damage	✓		
7	MASS NOTIFICATION - Verify system is in good condition.	✓		
8	FIRE SPRINKLERS WET AND DRY TYPE - Verify system is in good condition. Inspect fire riser for leaks and/or damage.	✓		
9	FIRE HYDRANTS - Verify that fire hydrants are not leaking and have not been damaged.	✓		

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and direct materials) and any repairs exceeding \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed discription of the deficiency.

To be performed by: General Maintenance Worker

Additional Notes: Kitchen suppression has been decommissioned capped gas lines and CO2 cartridge removed, with wires cut from system. Sign Posted.