



Argent Inspections

Form AI-03



Boiler Inspection Report

Inspection Date 9/6/2024	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2026/2025	Next Strength Test
Inspection Type(s) Performed ☒ Internal ☐ Watersides ☒ Firesides ☒ External/Operational ☒ Pressure Test ☐ Strength ☒ Tightness					
Customer 99th RSC R4A Z2 NY010 USARC Amherst			Boiler Location Name and/or Building Number Boiler Room 05		
Address 100 North Forest Rd.			Boiler Location Address		
City Amherst	State NY	Zip 14221-5244	City	State	Zip
National Board # 503186	Jurisdiction # Asset# 6589	Property # #3	Boiler Use Closed Heating Loop	Fuel Type Natural Gas	
Manufacturer Lochinvar		Model # KBN701	Serial # 2043121515355	Year Built 2020	
Capacity 700,000 BTU/HR	Design Pressure 160 psi	Operating Pressure 30 psi	Programmer Manufacturer Lochinvar	Burner Manufacturer Lochinvar	
Number of Safety Valves 1	Combustion Efficiency % CO2 ppm CO % Excess O2			Flue Gas Temperature Degrees F	
	Valve Manufacturer	Size	Set Pressure	Capacity	Lift Pressure
Valve 1	Watts	3/4"	50 psi	1,352,000 BTU/HR	Hand
Valve 2					
Valve 3:					
Valve 4:					
Safety Devices Tested Flame Rod, Combustion Air Switch by Blower Speed, Flow Switch, Condensate Drain Switch, Operating Temperature Control, Auto Reset High Temperature Limit, High Temperature limit Manual Rest, High Gas Pressure Switch, Low Gas Pressure Switch, The safety valve was lifted by hand per NBIC Part 2 para. 2.5.7(d). It lifted freely and reseated with no leakage.					
Reason(s) for Declining Certification No E-Stop installed as required by ASME-CSD-1 CE 110 (b) (repeat finding from last years inspection)					
Comments This Hot Water Heating Boiler was inspected per UFC 3-430-07, and the National Board Inspection Code. Light debris observed on firesides. All safety devices tested functioned properly during the inspection process. No E-Stop installed as required by ASME-CSD-1 CE 110 (b). Install Carbon Monoxide monitor/alarm as required by NBIC Part 1 Section 1.6.9.					
Inspector Commission 13373	Inspector Dale Brooks	Signature 			
Attachments No Pages	Technical Manager Jerry Kuykendall	Signature 			

Argent Inspections

Form AI-03


Boiler Inspection Report

Inspection Date 9/6/2024	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2027/2025	Next Strength Test
Inspection Type(s) Performed ☒ Internal ☒ Watersides ☒ Firesides ☒ External/Operational ☒ Pressure Test ☐ Strength ☒ Tightness					
Customer 99th RSC R4A Z2 NY010 USARC Amherst			Boiler Location Name and/or Building Number Boiler Room 05		
Address 100 North Forest Rd.			Boiler Location Address		
City Amherst		State NY	Zip 14221-5244	City State Zip	
National Board # 503174	Jurisdiction # Asset# 6606	Property # #2	Boiler Use Closed Heating Loop		Fuel Type Natural Gas
Manufacturer Lochinvar		Model # KBN701		Serial # 2043121515358	Year Built 2020
Capacity 700,000 BTU/HR	Design Pressure 160 psi	Operating Pressure 30 psi	Programmer Manufacturer Lochinvar		Burner Manufacturer Lochinvar
Number of Safety Valves 1	Combustion Efficiency % CO2 ppm CO % Excess O2			Flue Gas Temperature Degrees F	
	Valve Manufacturer	Size	Set Pressure	Capacity	Lift Pressure Reseat Pressure
Valve 1	Watts	3/4"	50 psi	1,352,000 BTU/HR	Hand Sat
Valve 2					
Valve 3:					
Valve 4:					
Safety Devices Tested Flame Rod, Combustion Air Switch by Blower Speed, Flow Switch, Condensate Drain Switch, Operating Temperature Control, Auto Reset High Temperature Limit, High Temperature limit Manual Reset, High Gas Pressure Switch, Low Gas Pressure Switch, The safety valve was lifted by hand per NBIC Part 2 para. 2.5.7(d). It lifted freely and reseated with no leakage.					
Reason(s) for Declining Certification No E-Stop installed as required by ASME-CSD-1 CE 110(b) (repeat finding from last years inspection)					
Comments This Hot Water Heating Boiler was inspected per UFC 3-430-07, and the National Board Inspection Code. Light scale film observed on watersides, and light debris observed on firesides. All safety devices tested functioned properly during the inspection process. No E-Stop installed as required by ASME-CSD-1 CE 110(b) . Install Carbon Monoxide monitor/alarm as required by NBIC Part 1 Section 1.6.9.					
Inspector Commission 13373	Inspector Dale Brooks		Signature 		
Attachments Yes 1 Pages	Technical Manager Jerry Kuykendall		Signature 		

Argent Inspections

Form AI-03

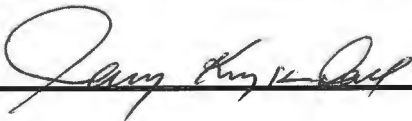
Boiler Inspection Report


Inspection Date 9/6/2024	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2026/2025	Next Strength Test
Inspection Type(s) Performed ☒ Internal ☐ Watersides ☒ Firesides ☒ External/Operational ☒ Pressure Test ☐ Strength ☒ Tightness					
Customer 99th RSC R4A Z2 NY010 USARC Amherst			Boiler Location Name and/or Building Number Boiler Room 05		
Address 100 North Forest Rd.			Boiler Location Address		
City Amherst	State NY	Zip 14221-5244	City	State	Zip
National Board # 503178	Jurisdiction # Asset# 6589	Property # #1	Boiler Use Closed Heating Loop	Fuel Type Natural Gas	
Manufacturer Lochinvar		Model # KBN701	Serial # 2043121515356	Year Built 2020	
Capacity 700,000 BTU/HR	Design Pressure 160 psi	Operating Pressure 30 psi	Programmer Manufacturer Lochinvar	Burner Manufacturer Lochinvar	
Number of Safety Valves 1	Combustion Efficiency % CO2 ppm CO % Excess O2			Flue Gas Temperature Degrees F	
	Valve Manufacturer	Size	Set Pressure	Capacity	Lift Pressure
Valve 1	Watts	3/4"	50 psi	1,352,000 BTU/HR	Hand
Valve 2					Sat
Valve 3:					
Valve 4:					
Safety Devices Tested Flame Rod, Combustion Air Switch by Blower Speed, Flow Switch, Condensate Drain Switch, Operating Temperature Control, Auto Reset High Temperature Limit, High Temperature limit Manual Rest, High Gas Pressure Switch, Low Gas Pressure Switch, The safety valve was lifted by hand per NBIC Part 2 para. 2.5.7(d). It lifted freely and reseated with no leakage.					
Reason(s) for Declining Certification No E-Stop installed as required by ASME-CSD-1 CE 110(b) (repeat finding from last years report)					
Comments This Hot Water Heating Boiler was inspected per UFC 3-430-07, and the National Board Inspection Code. Light debris observed on firesides. All safety devices tested functioned properly during the inspection process. No E-Stop installed as required by ASME-CSD-1 CE 110(b). Install Carbon Monoxide monitor/alarm as required by NBIC Part 1 Section 1.6.9.					
Inspector Commission 13373	Inspector Dale Brooks	Signature 			
Attachments Yes 1 Pages	Technical Manager Jerry Kuykendall	Signature 			

Argent Inspections

Form AI-04

Pressure Vessel Inspection Report

Inspection Date 9/6/2024	Certificate Issued Yes	Expiration Date 9/6/2027	Prepared for Inspection Yes	Inspection Type: ☒ Internal ☒ External ☐ Operational ☒ Pressure	
Customer 99th RSC R4A Z2 NY010 USARC Amherst			UPV Location Name and/or Building Number		
Address 100 North Forest Rd.			UPV Location Address		
City Amherst	State NY	Zip 14221-5244	City	State	Zip
National Board # 1113244	Property #	Manufacturer Melben	Serial Number 1113244		
Pressure Vessel Type ☒ Air Receiver ☐ Autoclave ☐ Heat Exchanger ☐ Hot Water ☐ Nitrogen ☐ Oxygen ☐ Other					Year Built 2003
Capacity 11 cu.ft	Design Pressure 150 psi	Operating Pressure	Test Pressure	Number of Safety Valves 1	
	Valve Manufacturer	Size	Capacity (CFM)	Setting (PSI)	Valve Condition
Valve 1	CDI	1/4"	49 SCFM	150 psi	Sat
Valve 2					
Reason(s) for Declining Certification					
Comments This air receiver was inspected using UFC 3-430-07 1.5 and NBIC as guides. Neither visual internal or external inspection nor ultrasonic measurement revealed any weak courses. Compressor did not start.					
Inspector Commission 13373	Inspector Dale A. Brooks		Signature 		
Attachments Yes 1 Pages	Jerry Kuykendall		Signature 		

Argent Inspections				
Form AI-09		Pressure Vessel Inspection Certificate		
Expiration Date 9/6/2027	Inspection Date 9/6/2024	National Board # 1113244	Pressure Allowed 150 psi	Capacity 11 cu.ft
Customer 99th RSC R4A Z2 NY010 USARC Amherst		Manufacturer Melben		Year Built 2003
Location/Building #		Serial # 1113244	Property #	
Inspection Type(s) Performed		Vessel Type		
☒ External ☒ Internal ☐ Operational ☒ Pressure		☒ Air Receiver ☐ Autoclave ☐ Heat Exchanger ☐ Hot Water ☐ Nitrogen ☐ Oxygen ☐ Other		
Commission # 13373	Inspector: Dale A. Brooks			
Signature 				

POST THIS CERTIFICATE UNDER GLASS ON OR NEAR CERTIFIED Vessel