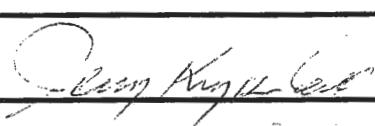


Argent Inspections

Form AI-03



Boiler Inspection Report

Inspection Date 9/9/2024	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2025/2025	Next Strength Test
Inspection Type(s) Performed <input checked="" type="checkbox"/> Internal <input type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness					
Customer 99th RSC R4A Z2 NY126 USARC Chili			Boiler Location Name and/or Building Number Mechanical Room 152		
Address 49 Jetview Dr.			Boiler Location Address		
City Chili	State NY NY	Zip 14624	City	State	Zip
National Board # 213581	Jurisdiction # Asset# 6539	Property # #2	Boiler Use Closed Heating Loop	Fuel Type Natural Gas	
Manufacturer Lochinvar	Model # FTX850N	Serial # 2118124214005	Year Built 2021		
Capacity 850,000 BTU/HR	Design Pressure 160 psi	Operating Pressure 25 psi	Programmer Manufacturer Lochinvar	Burner Manufacturer Lochinvar	
Number of Safety Valves 1	Combustion Efficiency % CO2	ppm CO	% Excess O2	Flue Gas Temperature Degrees F	
	Valve Manufacturer	Size	Set Pressure	Capacity	Lift Pressure
Valve 1	Watts	3/4"	50 psi	1,352,000 BTU/HR	Hand
Valve 2					
Valve 3:					
Valve 4:					
Safety Devices Tested Flame Rod, Combustion Air Switch by Blower Speed, Low Gas Pressure Switch, High Gas Pressure Switch (electrically), Blocked Intake Switch, Blocked Condensate Drain Switch, Low Water Lockout (electrically), Operating Temperature Control, Automatic Reset High Temperature Limit, High Temperature limit Manual Reset, Remote Emergency Shut Down, and The safety valve was lifted by hand per NBIC Part 2 para. 2.5.7(d). It lifted freely and reseated with no leakage.					
Reason(s) for Declining Certification Gas pressure regulator vent line manifolded to #2 boiler pressure regulator vent line. ASME CSD-1 Part CF-190 Para. (f) (3), vent line of one boiler manifolded to another boiler shall not be permitted. (repeat finding from 2023 inspection)					
Comments This Hot Water Heating Boiler was inspected per UFC 3-430-07, ASME CSD-1, and the National Board Inspection Code. Glycol in system, unable to perform watersides inspection. Technician stated that he will be prepared to remove glycol from boiler in order to complete watersides inspection at next inspection. Light debris observed on firesides. All safety devices tested functioned properly during the inspection process. Install insulation on inlet and outlet piping to boiler. Safety relief valve discharge should be piped back to glycol tank. Install Carbon Monoxide detector/alarm as required by NBIC Section 1.6.9. Gas pressure regulator vent line manifolded to #2 boiler pressure regulator vent line. ASME CSD-1 Part CF-190 Para. (f) (3), vent line of one boiler manifolded to another boiler shall not be permitted.					
Inspector Commission 13373	Inspector Dale Brooks	Signature 			
Attachments Yes 2 Pages	Technical Manager Jerry Kuykendall	Signature 			

Argent Inspections

Form AI-03

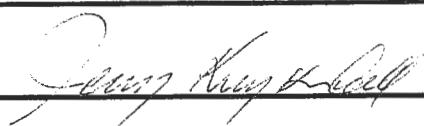
Boiler Inspection Report

Inspection Date 9/9/2024	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2025/2025	Next Strength Test
Inspection Type(s) Performed <input checked="" type="checkbox"/> Internal <input type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness					
Customer 99th RSC R4A Z2 NY126 USARC Chili			Boiler Location Name and/or Building Number Mechanical Room 152		
Address 49 Jetview Dr.			Boiler Location Address		
City Chili	State NY NY	Zip 14624	City	State	Zip 0
National Board # 215621	Jurisdiction # Asset# 6530	Property # #1	Boiler Use Closed Heating Loop	Fuel Type Natural Gas	
Manufacturer Lochinvar		Model # FTX850N		Serial # 212212608071	Year Built 2021
Capacity 850,000 BTU/HR	Design Pressure 160 psi	Operating Pressure 25 psi	Programmer Manufacturer Lochinvar	Burner Manufacturer Lochinvar	
Number of Safety Valves 1	Combustion Efficiency % CO2 ppm CO % Excess O2				Flue Gas Temperature Degrees F
Valve 1	Valve Manufacturer Watts	Size 3/4"	Set Pressure 50 psi	Capacity 1,352,000 BTU/HR	Lift Pressure Hand
Valve 2					Sat
Valve 3:					
Valve 4:					
Safety Devices Tested Flame Rod, Combustion Air Switch by Blower Speed, Low Gas Pressure Switch, High Gas Pressure Switch (electrically), Blocked Intake Switch, Blocked Condensate Drain Switch, Low Water Lockout (electrically), Operating Temperature Control, Automatic Reset High Temperature Limit, High Temperature limit Manual Reset, Remote Emergency Shut Down, and The safety valve was lifted by hand per NBIC Part 2 para. 2.5.7(d). It lifted freely and reseated with no leakage.					
Reason(s) for Declining Certification Gas pressure regulator vent line manifolded to #2 boiler pressure regulator vent line. ASME CSD-1 Part CF-190 Para. (f) (3), vent line of one boiler manifolded to another boiler shall not be permitted.(repeat finding from 2023 inspection)					
Comments This Hot Water Heating Boiler was inspected per UFC 3-430-07, ASME CSD-1, and the National Board Inspection Code. Glycol in system, unable to perform watersides inspection. Technician stated that he will be prepared to remove glycol from boiler in order to complete watersides inspection at next inspection. Light debris observed on firesides. All safety devices tested functioned properly during the inspection process. Install insulation on inlet and outlet piping to boiler. Safety relief valve discharge should be piped back to glycol tank. Install Carbon Monoxide detector/alarm as required by NBIC Section 1.6.9. Gas pressure regulator vent line manifolded to #2 boiler pressure regulator vent line. ASME CSD-1 Part CF-190 Para. (f) (3), vent line of one boiler manifolded to another boiler shall not be permitted.					
Inspector Commission 13373	Inspector Dale Brooks	Signature 			
Attachments Yes 2 Pages	Technical Manager Jerry Kuykendall	Signature 			

Argent Inspections

Form AI-04

Pressure Vessel Inspection Report

Inspection Date 9/9/2024	Certificate Issued Yes	Expiration Date 9/9/2027	Prepared for Inspection Yes	Inspection Type: <input checked="" type="checkbox"/> Internal <input checked="" type="checkbox"/> External <input checked="" type="checkbox"/> Operational <input checked="" type="checkbox"/> Pressure		
Customer 99 RSC R4A NY126 USARC Chili			UPV Location Name and/or Building Number Mechanical Room 111			
Address 49 Jetview Dr.			UPV Location Address			
City Chili		State NY	Zip 14624	City	State	Zip
National Board # 182381	Property #	Manufacturer Morganton			Serial Number M159379	
Pressure Vessel Type <input checked="" type="checkbox"/> Air Receiver <input type="checkbox"/> Autoclave <input type="checkbox"/> Heat Exchanger <input type="checkbox"/> Hot Water <input type="checkbox"/> Nitrogen <input type="checkbox"/> Oxygen <input type="checkbox"/> Other						Year Built 2012
Capacity 16 cu.ft	Design Pressure 200 psi	Operating Pressure 165 psi		Test Pressure 165 psi	Number of Safety Valves 1	
	Valve Manufacturer	Size	Capacity (CFM)	Setting (PSI)	Valve Condition	
Valve 1	CDI	1/4"	178 SCFM	200 psi	Sat	
Valve 2						
Reason(s) for Declining Certification						
Comments This air receiver was inspected per UFC 3-430-07 and the National Board Inspection Code. Vessel was inspected externally. All paint and welds are in good condition. Vessel was measured ultrasonically. All readings were satisfactory as compared to shell design thickness. The safety relief valve was removed and tested using an inert gas (nitrogen) and a regulator.						
Inspector Commission 13373	Inspector Dale A. Brooks	Signature 				
Attachments Yes 1 Pages	Jerry Kuykendall	Signature 				

Argent Inspections					
Form AI-09			Pressure Vessel Inspection Certificate		
Expiration Date 9/9/2027	Inspection Date 9/9/2024	National Board # 182381	Pressure Allowed 200 psi	Capacity 16 cu.ft	
Customer 99 RSC R4A NY126 USARC Chili		Manufacturer Morganton			Year Built 2012
Location/Building # Mechanical Room 111		Serial # M159379		Property #	
Inspection Type(s) Performed			Vessel Type		
<input checked="" type="checkbox"/> External <input checked="" type="checkbox"/> Internal <input checked="" type="checkbox"/> Operational <input checked="" type="checkbox"/> Pressure		<input checked="" type="checkbox"/> Air Receiver <input type="checkbox"/> Autoclave <input type="checkbox"/> Heat Exchanger <input type="checkbox"/> Hot Water <input type="checkbox"/> Nitrogen <input type="checkbox"/> Oxygen <input type="checkbox"/> Other			
Commission # 13373	Inspector: Dale A. Brooks				
Signature <i>Dale A. Brooks</i>					

POST THIS CERTIFICATE UNDER GLASS ON OR NEAR CERTIFIED Vessel