

PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST

UNIT HEATER, HOT WATER

SITE AND BLDG #: PA062



MECHANIC
SIGNATURE*Pat B. Sanden*



DATE: 11/15/2024

LOCATION/RM #: WO# 17032 ASSET # 3035

START TIME: 8:30AM

FINISH TIME: 9:30AM
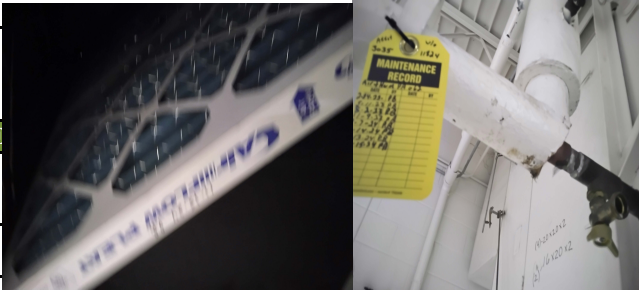
| CHECK POINT | CHECKPOINT DESCRIPTION | TASK COMPLETE | | NOTES/ ACTIONS (IF TASK COMPLETE IS CHECKED NO, PROVIDE EXPLANATION) |
|--|---|---------------|----|--|
| | | YES | NO | |
| SPECIAL INSTRUCTIONS | | | | |
| 1 | Schedule shutdown with operating personnel. | ● | |  |
| 2 | Follow lock out/tag out procedures at all times. De-energize or discharge all hydraulic, electrical, mechanical, or thermal energy prior to beginning work. | ● | | |
| TO BE PERFORMED AT EACH INSPECTION SERVICE | | | | |
| 1 | Check valve for signs of abnormal wear and leaks. Replace packing if needed. | ● | |  |
| 2 | Clean the coils | ● | | |
| 3 | Comb the fins as needed. | ● | | |
| 4 | Clean all fans and motors. | ● | | |
| 5 | Check operation of controls and safeties. | ● | | |
| 6 | Lubricate as required. | ● | | |
| 7 | Check all motors, belts, pulleys, shafts, etc. for alignment. | ● | | |

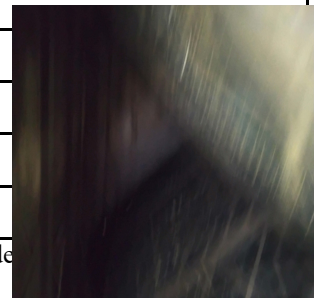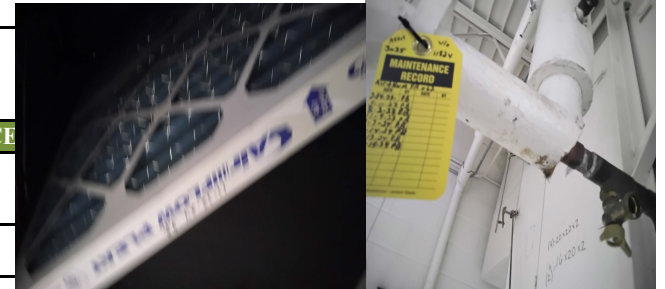

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and direct material cost) per PM occurrence. For any de exceeding \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed discription of the deficiency.

To be performed by: General Maintenance Worker

Additional Notes: