

**PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST**  
**LIGHTING, OUTSIDE**

**SITE AND BLDG #:** VA039-02

**MECHANIC**  
**SIGNATURE:** *Curly Rind*

**DATE:** 5-28-19

**LOCATION/RM #:**

**START TIME:** 7:45pm


**FINISH TIME:** 9:30pm

Site Location	WO #	Asset #	PM #	Manufacturer	Model Number	Serial #	Asset Description	Asset Location
VA039-02	8563	7415	PM-MO-7415	<i>N/A</i>			J-1502000-45 10-pc Flood Light, Pole Mounted Fluorescent	
VA039-02	8563	7445	PM-MO-7415	<i>N/A</i>			J-1502000-45 3-pc Double Light, Pole Mounted Aluminum Fluorescent	

CHECK POINT	CHECKPOINT DESCRIPTION	TASK COMPLETE		NOTES/ ACTIONS (IF TASK COMPLETE IS CHECKED NO, PROVIDE EXPLANATION)
		YES	NO	
<b>SPECIAL INSTRUCTIONS</b>				
1	In addition to the procedure(s) outlined in this standard, the equipment manufacturer's recommended maintenance procedure(s) and/or instruction(s) shall be strictly adhered to.	<input checked="" type="checkbox"/>		
2	Schedule and coordinate work with operating personnel.	<input checked="" type="checkbox"/>		
3	Follow lock out/tag out procedures always. De-energize or discharge all hydraulic, electrical, mechanical, or thermal energy prior to beginning work.	<input checked="" type="checkbox"/>		
<b>TO BE PERFORMED AT EACH INSPECTION SERVICE</b>				
1	Open and tag switch.		<input checked="" type="checkbox"/>	<i>N/A</i>
2	Inspect visual condition of wiring. Look for evidence of overheating.		<input checked="" type="checkbox"/>	<i>N/A</i>
3	Check for proper light operation.	<input checked="" type="checkbox"/>		
4	Test operation of automatic switches/ time clock/ photocells if applicable.		<input checked="" type="checkbox"/>	<i>N/A</i>
5	Inspect light pole and mounting devices for deficiencies.	<input checked="" type="checkbox"/>		

6	For any noted deficiency, takes pictures and open corrective maintenance ticket.	<input checked="" type="checkbox"/>		
---	--	-------------------------------------	--	--

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and direct material cost) per PM occurrence. For any deficiencies found exceeding \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed description of the deficiency. To be performed by: General Maintenance Worker **Additional Notes:**

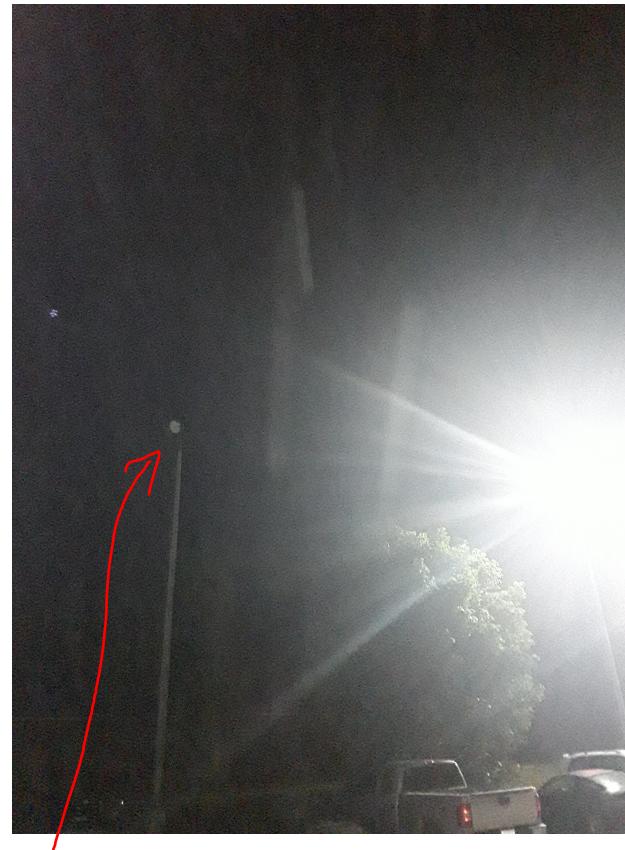

Asset 7445 aluminum single light is out.

CM Needed