

Device 151 (AHU-1)

BACtalk Edit View Tools Help

Previous


Top

Points

AHU-1

80th Division

Friday, 9/27/2018 4:28:48PM

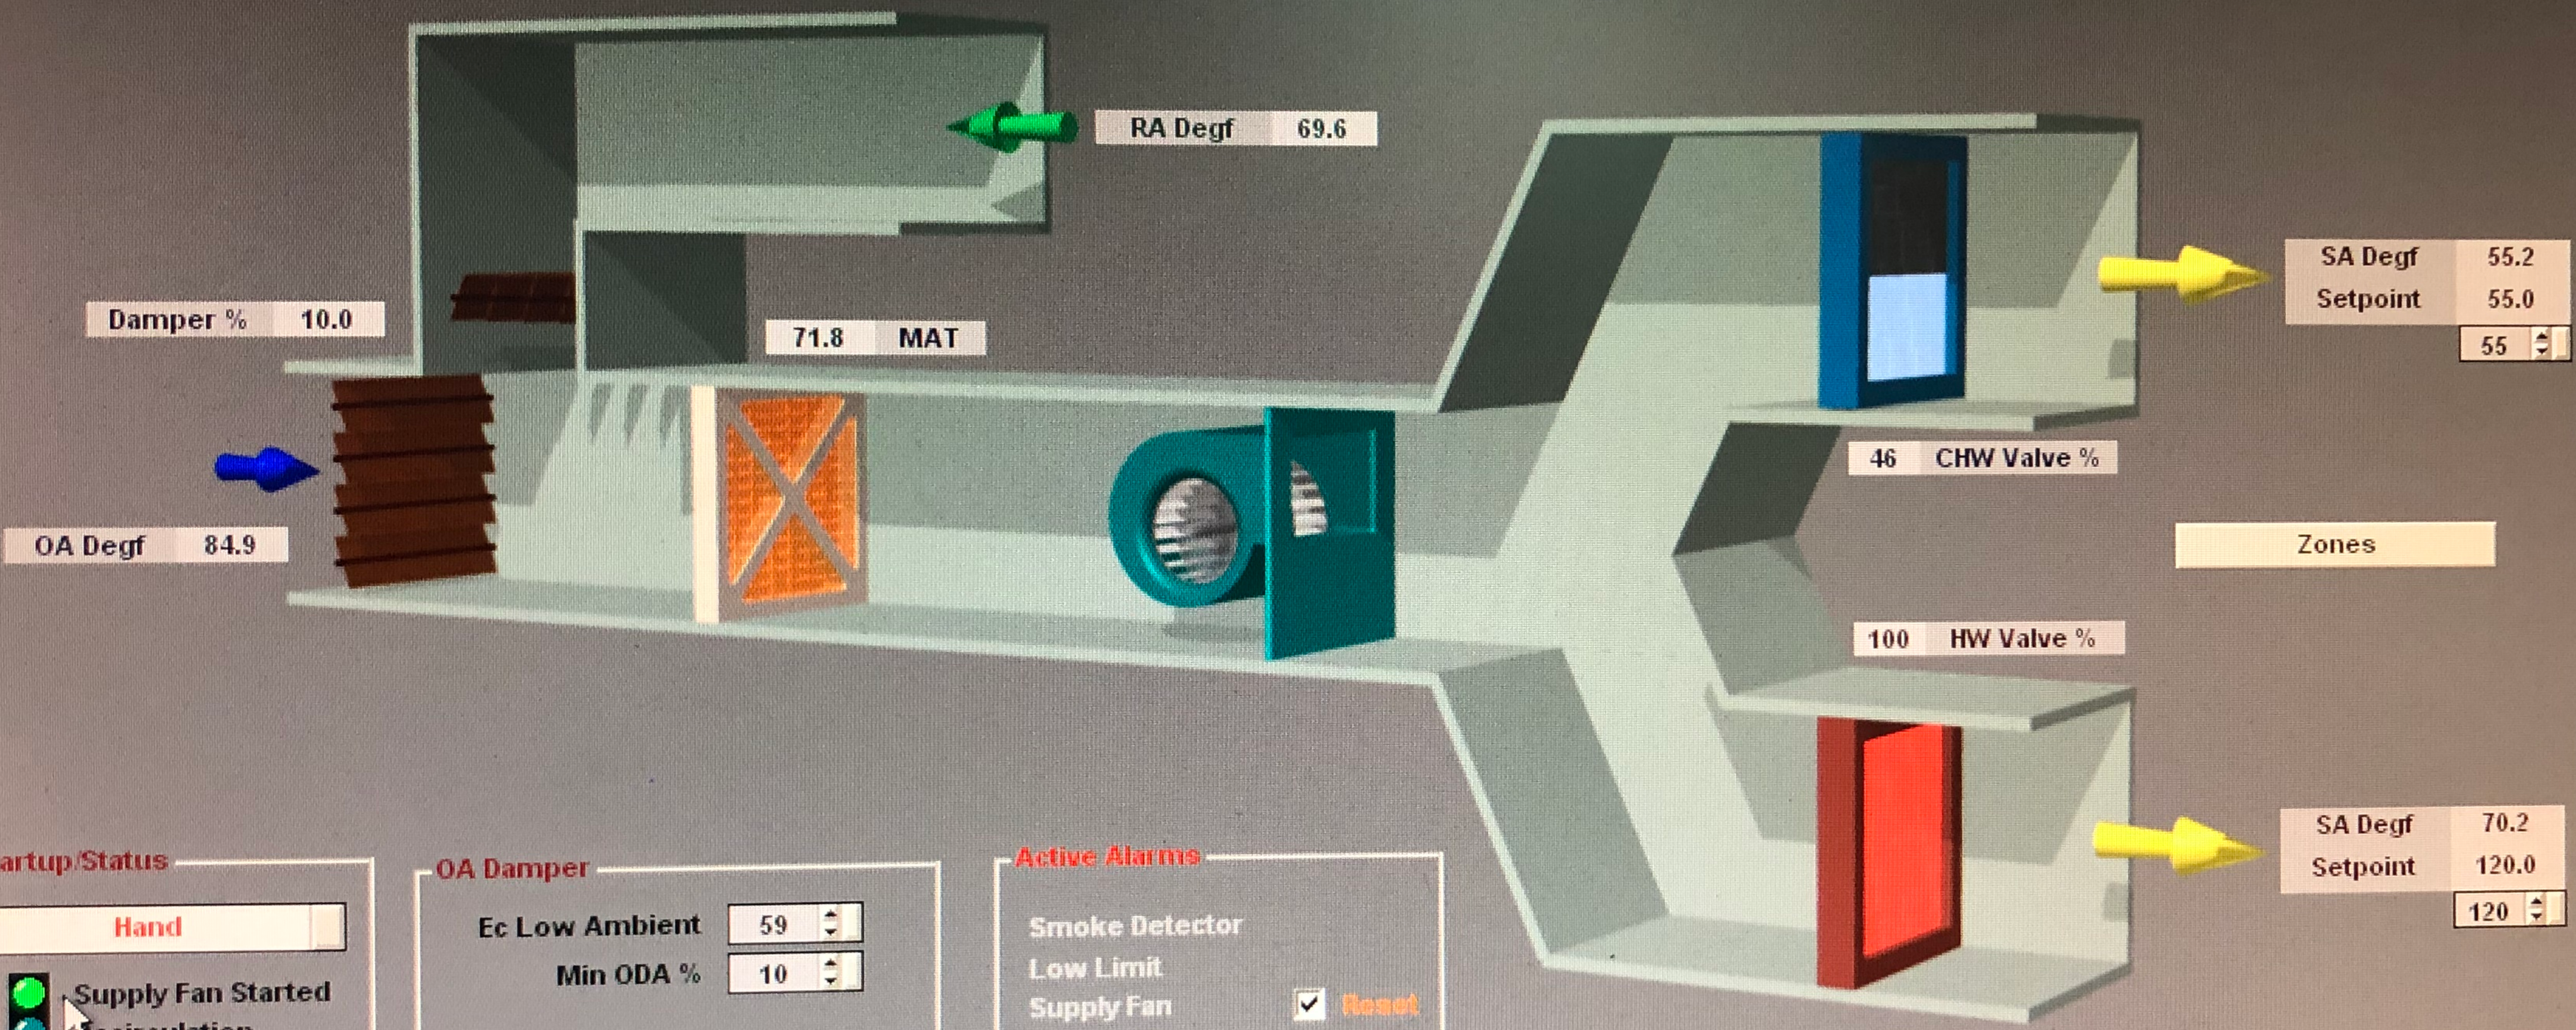

Startup/Status

Hand

- ☒ Supply Fan Started
- ☒ Recirculation
- ☒ Economizer

Terminal Zones

- 0 Occupied
- 0 Unoccupied
- 1 # To Start Unocc

OA Damper

- Ec Low Ambient 59
- Min ODA % 10

Active Alarms

- Smoke Detector
- Low Limit
- Supply Fan ☒ Reset
- Sup Fan Phase Loss
- Dirty Filter