

**CERTIFICATION OF WORK
PREVENTIVE MAINTENANCE**

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: _____ Date of Visit: 8/5/19

Contractor Personnel on Site:

- | | |
|----------|----------|
| 1. _____ | 3. _____ |
| 2. _____ | 4. _____ |

Work Performed:

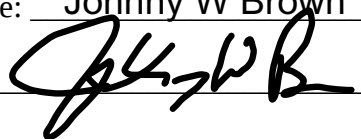
Preventive Maintenance - Services Completed (Annual, Quarterly, Monthly, equipment identification, etc.)

1. _____
2. _____
3. _____
4. _____
5. _____

CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: Johnny W Brown Date: 8/5/19

Signed: 

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: SFC Phillip Cannon Date: 8/5/19

Signed: 

E-Mail: _____

PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST

UNIT HEATER, HOT WATER

SITE AND BLDG #: **MD002-04**MECHANIC
SIGNATURE: DATE: **8/5/19**LOCATION/RM #: **RM 108** WO# **10081** ASSET # **1509**START TIME: **0900**FINISH TIME: **1630**

CHECK POINT	CHECKPOINT DESCRIPTION	TASK COMPLETE		NOTES/ ACTIONS (IF TASK COMPLETE IS CHECKED NO, PROVIDE EXPLANATION)
		YES	NO	
SPECIAL INSTRUCTIONS				
1	In addition to the procedure(s) outlined in this standard, the equipment manufacturer's recommended maintenance procedure(s) and/or instruction(s) shall be strictly adhered to.	/		
2	Schedule shutdown with operating personnel.	/		
3	Follow lock out/tag out procedures at all times. De-energize or discharge all hydraulic, electrical, mechanical, or thermal energy prior to beginning work.	/		
TO BE PERFORMED AT EACH INSPECTION SERVICE				
1	Check valve for full stroke operation in both directions, if applicable.	/		
2	Check valve for signs of abnormal wear and leaks. Replace packing if needed.	/		
3	Clean the coil with vacuum cleaner.	/		
4	Comb the fins as needed.	/		
5	Clean all fans and motors.	/		
6	Check operation of controls and safeties.	/		
7	Lubricate as required.	/		
8	Check all motors, belts, pulleys, shafts, etc. for alignment.	/		

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and direct material cost) per PM occurrence. For any deficiencies found exceeding \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed discription of the deficiency.

To be performed by: General Maintenance Worker

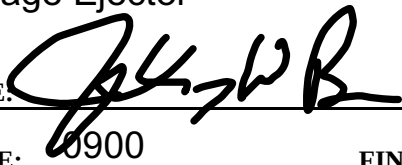
Additional Notes:

PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST

~~SEWAGE PUMP~~

Sewage Ejector

SITE AND BLDG #: MD002-04

MECHANIC
SIGNATURE: 

DATE: 8/5/19

LOCATION/RM #: RM 108 WO# 10081 ASSET # 1510

START TIME: 0900

FINISH TIME: 1630

CHECK POINT	CHECKPOINT DESCRIPTION	TASK COMPLETE		NOTES/ ACTIONS (IF TASK COMPLETE IS CHECKED NO, PROVIDE EXPLANATION)
		YES	NO	
SPECIAL INSTRUCTIONS				
1	In addition to the procedure(s) outlined in this standard, the equipment manufacturer's recommended maintenance procedure(s) and/or instruction(s) shall be strictly adhered to.			
2	Schedule outage with operating personnel.			
3	Follow lock out/tag out procedures at all times. De-energize or discharge all hydraulic, electrical, mechanical, or thermal energy prior to beginning work.			
4	If the material removed from the pump is hazardous, contact the Regional S&EM office for disposal instructions.			
5	If strainer cleaning requires removal of pump unit which should be considered a repair and not general maintenance.			
6	Excessive sediment and debris, not removed by flushing the pit should be handled on a project basis, and not considered under this standard.			
TO BE PERFORMED AT EACH INSPECTION SERVICE				
1	Remove cover plates and flush pit.			
2	Inspect check valve.			
3	Inspect interior of pit for cracks.			
4	Inspect cover plate gaskets and replace if necessary.			
5	Insuure the unit is operating properly, report any deficiencies			
6	Clean up work area and remove all debris.			

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and direct material cost) per PM occurrence. For any deficiencies found exceeding \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed discription of the deficiency.

To be performed by: General Maintenance Worker

Additional Notes: