

**CERTIFICATION OF WORK
PREVENTIVE MAINTENANCE**

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: NY039 Date of Visit: 12/8/20

Contractor Personnel on Site:

1. <u>Patrick Brown</u>	3. _____
2. _____	4. _____

Work Performed:

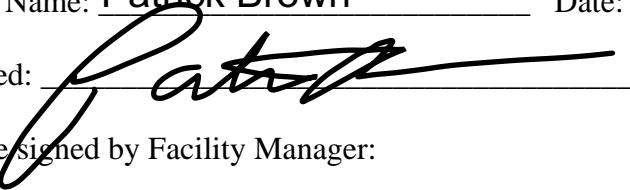
Preventive Maintenance - Services Completed (Annual, Quarterly, Monthly, equipment identification, etc.)

1. WO's 10720PFQ,10799-10800PMFQT, 10831-10832PMMO
2. 11032-11037PMSA, 11042PMM
3. 11049PMQ, 11063PMS, 10866PMQT, 11038PMSA, 11064-11065PMS
4. FILTERS, LIGHTING, HEATERS,GATES, SUMP PUMP, WALL PACKS,
5. EXHAUST SYSTEM

CERTIFICATION OF WORK

To be signed by the Contractor:

Print Name: Patrick Brown Date: 12/8/20

Signed: 

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: SGT STORMS Date: 12/8/20

Signed: 

E-Mail: _____

PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST
EXHAUST FANS

SITE AND BLDG #: NY039-02

MECHANIC
SIGNATURE: 

DATE: 12/8/20

LOCATION/RM #: WO# 10866 ASSET # 9943

START TIME: 12pm

FINISH TIME: 12:30pm

CHECK POINT	CHECKPOINT DESCRIPTION	TASK COMPLETE		NOTES/ ACTIONS (IF TASK COMPLETE IS CHECKED NO, PROVIDE EXPLANATION)
		YES	NO	
SPECIAL INSTRUCTIONS				
1	Follow lock out/tag out procedures at all times. De-energize or discharge all hydraulic, electrical, mechanical, or thermal energy prior to beginning work.	✓		
TO BE PERFORMED AT EACH INSPECTION SERVICE				
1	Clean unit, especially fan blades.	✓		
2	Inspect pulleys, belts, couplings, etc.; adjust tension and tighten mountings as necessary. Change badly worn belts. Multiple belts should be replaced with matched sets.	✓	✓	
3	Perform required lubrication and remove old or excess lubricant.	✓	✓	
4	Clean motor with vacuum or low pressure dry air (less than 40 psig). Check for obstructions in motor cooling and air flow.	✓	✓	
5	Check structural members, vibration eliminators, and flexible connections. Check fan housing to ensure there is no damage and the housing is tight.	✓	✓	
6	Start unit and check for vibration and noise.	✓	✓	
7	Remove all trash and debris.	✓	✓	

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and direct material cost) per PM occurrence. For any deficiencies found exceeding \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed description of the deficiency.

To be performed by: General Maintenance Worker

Additional Notes:

there's a CM request in to have the hose fixed on exhaust fan one