

**CERTIFICATION OF WORK
PREVENTIVE MAINTENANCE**

(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID/Building: VA099 Date of Visit: 11/14/19

Contractor Personnel on Site:

1. <u>BOND WATER TECHNOLOGIES</u>	3. _____
2. <u>BILL DAVIS</u>	4. _____

Work Performed:

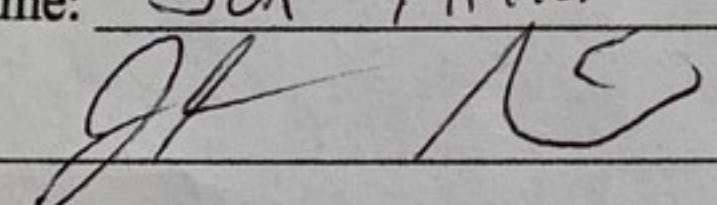
Preventive Maintenance - Services Completed (Annual, Quarterly, Monthly, equipment identification, etc.)

1. WO 11211 ASSET 190918-249
2. _____
3. _____
4. _____
5. _____

CERTIFICATION OF WORK

To be signed by the Contractor:

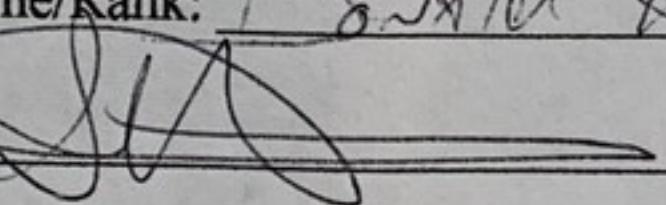
Print Name: Jon Miller Date: 11/14/19

Signed: 

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: Jon Miller Date: 11/14/19

Signed: 

E-Mail: _____

Tidewater, INC
 VA-099
 1117 Harmony Dr.
 Bedford VA 24523
 (410) 540-8700

Recorded By: Jon Miller
 (301) 580-9820
 jmiller@bondwater.com

2nd Floor Mechanical Room - HVAC Equipment

Test	Hot Loop	Chill Loop		
Conductivity (as mmhos)	2496 3500 max	2981 3500 max		
pH	8.5 8 - 10.5	9.6 8 - 10.5		
Molybdate (ppm as Mo)	0 50 min	0 50 min		
Sodium Nitrite (ppm as NaNO ₃)		400 400 - 1000		

Opening Comment

Performed monthly scheduled service visit.

Hot Water Loop

Online 

Corrosion inhibitor residual is low, added 1 gallon of BOND 5011 treatment for additional corrosion protection.

Chill Water Loop

Online 

Corrosion inhibitor residual is excellent at this time loop has a sufficient amount of sodium nitrite in it. Added 1 gallon of BOND 5011 treatment for additional corrosion protection.