

CERTIFICATION OF WORK
(To be completed by the Contractor and saved in the Contractor's CMMS)

OTHER RECURRING SERVICES CERTIFICATION OF WORK
(To be completed by the Contractor and saved in the Contractor's CMMS)

FACID Building: VA-011 Date of Visit: 12/13/19

Contractor Personnel on Site:

- | | |
|-----------------------|----------|
| 1. <u>Chris Chapp</u> | 4. _____ |
| 2. _____ | 5. _____ |
| 3. _____ | 6. _____ |

Work Performed:

Monthly Water Treatment

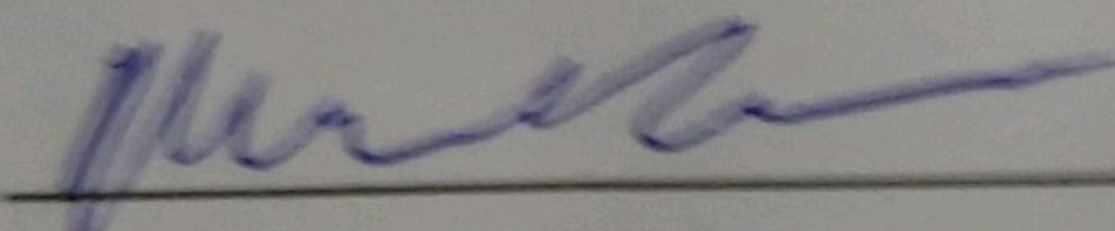
Other Recurring Services

- | |
|----------|
| 1. _____ |
| 2. _____ |
| 3. _____ |
| 4. _____ |

CERTIFICATION OF WORK

To be signed by the Contractor:

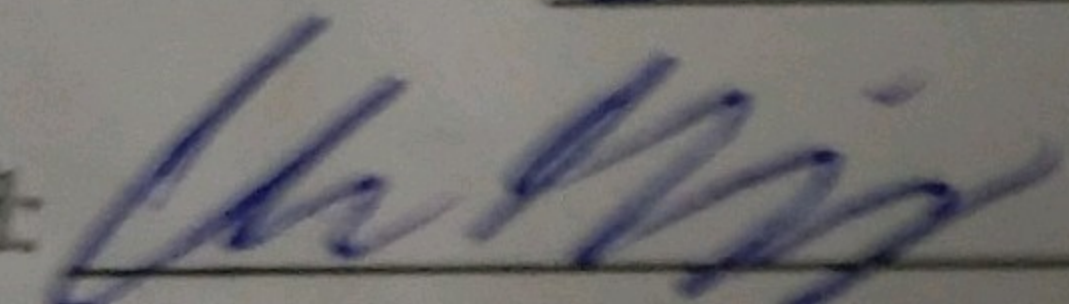
Print Name: Marshall Kolve Date: 12/13/19

Signed: 

To be signed by Facility Manager:

By signing the Certification of Work, the said government representative signature does not constitute acceptance of any work performed by the contractor, it only acknowledges that the contractor was on-site during the identified timeline:

Print Name/Rank: Chris Chapp Date: 12/13/19

Signed: 

E-Mail: _____

Tidewater, INC
VA-011
1821 Industry St.
Culpeper VA 22701
(410) 540-8700

Recorded By: **Marshall Kohne**
(301) 721-2663
mkohne@bondwater.com

Culpeper Minutemen Mem USARC - HVAC Equipment

Test	Closed Loop			
Conductivity (as mmhos)	4632 3500 max			
pH	9.8 8 - 10.5			
Molybdate (ppm as Mo)	0 50 - 200			

Evaporative Condenser

Online 

System is down.

Closed Loop

Online 

Conductivity is elevated. I hand pumped a half gallon of 5011, MO to the system to boost corrosion protection.