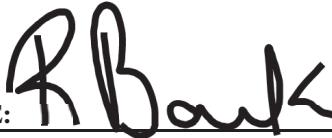







PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST
EXHAUST FANS

SITE AND BLDG #: WV009-01MECHANIC
SIGNATURE: DATE: Jun 3, 2024LOCATION/RM #: WO# 15769 ASSET # See Notes

START TIME:

FINISH TIME:

CHECK POINT	CHECKPOINT DESCRIPTION	TASK COMPLETE		NOTES/ ACTIONS (IF TASK COMPLETE IS CHECKED NO, PROVIDE EXPLANATION)	
		YES	NO	SPECIAL INSTRUCTIONS	
1	Follow lock out/tag out procedures at all times. De-energize or discharge all hydraulic, electrical, mechanical, or thermal energy prior to beginning work.	•		   	
TO BE PERFORMED AT EACH					
1	Clean unit, especially fan blades.	•		   	
2	Inspect pulleys, belts, couplings, etc.; adjust tension and tighten mountings as necessary. Change badly worn belts. Multiple belts should be replaced with matched sets.	•		   	
3	Perform required lubrication and remove old or excess lubricant.	•		   	
4	Clean motor with vacuum or low pressure dry air (less than 40 psig). Check for obstructions in motor cooling and air flow.	•		   	
5	Check structural members, vibration eliminators, and flexible connections. Check fan housing to ensure there is no damage and the housing is tight.	•		   	
6	Start unit and check for vibration and noise.	•		   	
7	Remove all trash and debris.	•		   	

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and materials). If the repair cost exceeds \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed description of the deficiency.

To be performed by: General Maintenance Worker

Additional Notes: This covers asset's 3474 3591 3865 3922. Found Exhaust fan 2a in welding shop with bad bearings and was told jen is trying to get them replaced.

