
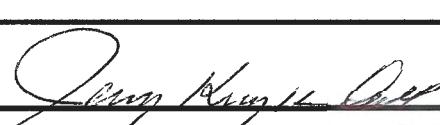


# Argent Inspections

## Form AI-03

## Boiler Inspection Report

Inspection Date 11/18/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2026/2026	Next Strength Test
Inspection Type(s) Performed					
<input checked="" type="checkbox"/> Internal <input type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness					
Customer 99th RSC R4C Z2 WV029 USARC Morgantown			Boiler Location Name and/or Building Number Mechanical Room		
Address 228 Comfort Inn Rd.			Boiler Location Address		
City Morgantown		State WV	Zip 26508-1501	City	
National Board # CA-1WV001	Jurisdiction #	Property # 1	Boiler Use Hot Water Heating Loop		Fuel Type N. Gas
Manufacturer Weil McLain		Model # Ultra 750		Serial #	Year Built
Capacity 750,000 btu/hr		Design Pressure 80 psi	Operating Pressure 12-20 psi	Programmer Manufacturer Weil McLain	Burner Manufacturer Weil McLain
Number of Safety Valves 1		Combustion Efficiency % CO2 ppm CO % Excess O2			Flue Gas Temperature Degrees F
Valve 1	Watts	Size 3/4"	Set Pressure 30 psi	Capacity 925,000 btu/hr	Lift Pressure Hand
Valve 2					Sat.
Valve 3:					
Valve 4:					
Safety Devices Tested Flame Rod, Low Gas Pressure Switch, High Gas Pressure Switch, Blocked Flue Switch, Combustion Air Switch by Speed of Blower Motor, Low Water Lockout, Operating Temperature Switch, Remote Emergency Stop Switches, and the safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1 (d). It lifted freely and reseated with no leakage.					
Reason(s) for Declining Certification Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110 (b)(2). No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a).					
Comments This boiler was inspected using ASME CSD-1 and NBIC as guides. Light debris observed on firesides. There was no evidence of leakage with 10 psi on the watersides. Technician did not have the code to test high temperature limit. Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110 (b)(2). All other safety devices tested functioned properly during the inspection process. No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a). Safety relief valve discharge should be piped back to glycol tank. Carbon Monoxide detector/alarm present.					
Inspector Commission 13373	Inspector Dale Brooks	Signature 			
Attachments Yes 2 Pages	Technical Manager Jerry Kuykendall	Signature 			

# Argent Inspections

## Form AI-03


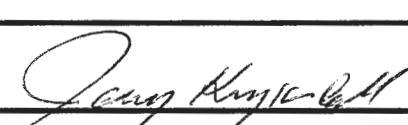
## Boiler Inspection Report

Inspection Date 11/18/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2026/2026	Next Strength Test	
Inspection Type(s) Performed						
<input checked="" type="checkbox"/> Internal <input type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational			<input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness			
Customer 99th RSC R4C Z2 WV029 USARC Morgantown			Boiler Location Name and/or Building Number Mechanical Room			
Address 228 Comfort Inn Rd.			Boiler Location Address			
City Morgantown		State WV	Zip 26508-1501	City		
State WV		Zip 26508-1501		State	Zip	
National Board # CA-1WV002	Jurisdiction #	Property # 2	Boiler Use Hot Water Heating Loop		Fuel Type N. Gas	
Manufacturer Weil McLain		Model # Ultra 750		Serial #		
Capacity 750,000 btu/hr		Design Pressure 80 psi	Operating Pressure 12-20 psi	Programmer Manufacturer Weil McLain	Burner Manufacturer Weil McLain	
Number of Safety Valves 1		Combustion Efficiency % CO2 ppm CO % Excess O2 Flue Gas Temperature Degrees F				
Valve 1	Valve Manufacturer Watts	Size 3/4"	Set Pressure 30 psi	Capacity 925,000 btu/hr	Lift Pressure Hand	Reseat Pressure Sat.
Valve 2						
Valve 3:						
Valve 4:						
Safety Devices Tested Flame Rod, Low Gas Pressure Switch, High Gas Pressure Switch, Blocked Flue Switch, Combustion Air Switch by Speed of Blower Motor, Low Water Lockout, Operating Temperature Switch, Remote Emergency Stop Switches, and the safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1 (d). It lifted freely and reseated with no leakage.						
Reason(s) for Declining Certification Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110 (b)(2). No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a).						
Comments This boiler was inspected using ASME CSD-1 and NBIC as guides. Light debris observed on firesides. There was no evidence of leakage with 10 psi on the watersides. Technician did not have the code to test high temperature limit. Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110 (b)(2). All other safety devices tested functioned properly during the inspection process. No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a). Safety relief valve discharge should be piped back to glycol tank. Carbon Monoxide detector/alarm present.						
Inspector Commission 13373	Inspector Dale Brooks	Signature <i>Dale O. Brooks</i>				
Attachments No 2 Pages	Technical Manager Jerry Kuykendall	Signature <i>Jerry Kuykendall</i>				

# Argent Inspections

## Form AI-03

## Boiler Inspection Report

Inspection Date 11/18/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2028/2025	Next Strength Test	
Inspection Type(s) Performed <input checked="" type="checkbox"/> Internal <input checked="" type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness						
Customer 99th RSC R4C Z2 WV029 USARC Morgantown			Boiler Location Name and/or Building Number Mechanical Room			
Address 228 Comfort Inn Rd.			Boiler Location Address			
City Morgantown		State WV	Zip 26508-1501	City		
State WV		Zip 26508-1501		State	Zip	
National Board # CA-1WV003	Jurisdiction #	Property # 3	Boiler Use Hot Water Heating Loop		Fuel Type N. Gas	
Manufacturer Weil McLain		Model # Ultra 750		Serial #		
Capacity 750,000 btu/hr		Design Pressure 80 psi	Operating Pressure 12-20 psi	Programmer Manufacturer Weil McLain	Burner Manufacturer Weil McLain	
Number of Safety Valves 1		Combustion Efficiency % CO2 ppm CO % Excess O2 Flue Gas Temperature Degrees F				
Valve 1	Valve Manufacturer Watts	Size 3/4"	Set Pressure 30 psi	Capacity 925,000 btu/hr	Lift Pressure Hand	Reseat Pressure Sat.
Valve 2						
Valve 3:						
Valve 4:						
Safety Devices Tested Flame Rod, Low Gas Pressure Switch, High Gas Pressure Switch, Blocked Flue Switch, Combustion Air Switch by Speed of Blower Motor, Low Water Lockout, Operating Temperature Switch, Remote Emergency Switch, and the safety valve was lifted by hand per NBIC Part 2 para. 2.5.71(d). It lifted freely and reseated with no leakage.						
Reason(s) for Declining Certification Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110(b)(2). No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a).						
Comments This boiler was inspected using ASME CSD-1 and NBIC as guides. Light scale observed on watersides, and light debris on the firesides. There was no evidence of leakage with 10 psi on the watersides. Technician did not have the code to test high temperature limit. Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110 (b)(2). All other safety devices tested functioned properly during the inspection process. No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a).. Safety relief valve discharge should be piped back to glycol tank. Carbon Monoxide detector/alarm present.						
Inspector Commission 13373	Inspector Dale Brooks	Signature 				
Attachments Yes 2 Pages	Technical Manager Jerry Kuykendall	Signature 				

# Argent Inspections

## Form AI-03


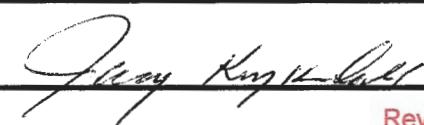
## Boiler Inspection Report

Inspection Date 11/18/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2026/2026	Next Strength Test	
Inspection Type(s) Performed						
<input checked="" type="checkbox"/> Internal <input type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational			<input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness			
Customer 99th RSC R4C Z2 WV029 USARC Morgantown			Boiler Location Name and/or Building Number Mechanical Room			
Address 228 Comfort Inn Rd.			Boiler Location Address			
City Morgantown		State WV	Zip 26508-1501	City		
National Board # CA-1WV004	Jurisdiction #	Property # 4	Boiler Use Hot Water Heating Loop		Fuel Type N. Gas	
Manufacturer Weil McLain		Model # Ultra 750		Serial #		
Capacity 750,000 btu/hr		Design Pressure 80 psi	Operating Pressure 12-20 psi	Programmer Manufacturer Weil McLain	Burner Manufacturer Weil McLain	
Number of Safety Valves 1		Combustion Efficiency % CO2 ppm CO % Excess O2				
		Flue Gas Temperature Degrees F				
Valve 1	Valve Manufacturer Watts	Size 3/4"	Set Pressure 30 psi	Capacity 925,000 btu/hr	Lift Pressure Hand	Reseat Pressure Sat.
Valve 2						
Valve 3:						
Valve 4:						
Safety Devices Tested Flame Rod, Low Gas Pressure Switch, High Gas Pressure Switch, Blocked Flue Switch, Combustion Air Switch by Speed of Blower Motor, Low Water Lockout, Operating Temperature Switch, Remote Emergency Switch, and the safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1 (d). It lifted freely and reseated with no leakage.						
Reason(s) for Declining Certification Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110 (b)(2). No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a). High gas pressure switch did not shut boiler down as required by ASME CSD-1 Table CF-162-1.						
Comments This boiler was inspected using ASME CSD-1 and NBIC as guides. Light debris observed on firesides. There was no evidence of leakage with 10 psi on the watersides. Technician did not have the code to test high temperature limit. Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110 (b). High gas pressure switch did not shut boiler down as required by ASME CSD-1 Table CF-162-1. All other safety devices tested functioned properly during the inspection process. No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a). Safety relief valve discharge should be piped back to glycol tank. Carbon Monoxide detector/alarm present.						
Inspector Commission 13373	Inspector Dale Brooks	Signature <i>Dale C. Brooks</i>				
Attachments Yes 3 Pages	Technical Manager Jerry Kuykendall	Signature <i>Jerry Kuykendall</i>				

# Argent Inspections

## Form AI-03


## Boiler Inspection Report

Inspection Date 11/18/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2028/2026	Next Strength Test		
Inspection Type(s) Performed <input checked="" type="checkbox"/> Internal <input checked="" type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness							
Customer 99th RSC R4C Z2 WV029 USARC Morgantown			Boiler Location Name and/or Building Number Mechanical Room				
Address 228 Comfort Inn Rd.			Boiler Location Address				
City Morgantown		State WV	Zip 26508-1501	City			
State WV		Zip 26508-1501	City		State WV	Zip 26508-1501	
National Board # CA-1WV005	Jurisdiction #	Property # 5	Boiler Use Hot Water Heating Loop		Fuel Type N. Gas		
Manufacturer Weil McLain		Model # Ultra 750		Serial #		Year Built	
Capacity 750,000 btu/hr		Design Pressure 80 psi		Operating Pressure 12-20 psi		Programmer Manufacturer Weil McLain	Burner Manufacturer Weil McLain
Number of Safety Valves 1		Combustion Efficiency % CO2 ppm CO % Excess O2				Flue Gas Temperature Degrees F	
	Valve Manufacturer Watts	Size 3/4"	Set Pressure 30 psi	Capacity 925,000 btu/hr	Lift Pressure Hand	Reseat Pressure Sat.	
Valve 1							
Valve 2							
Valve 3:							
Valve 4:							
Safety Devices Tested Flame rod, low gas pressure switch, low water lockout, and the safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1 (d). It lifted freely and reseated with no leakage.							
Reason(s) for Declining Certification Boiler stopped running in the middle of testing safety devices. Unable to complete safety device testing as required by ASME CSD-1 Part CM-110(b). No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a).							
Comments This boiler was inspected using ASME CSD-1 and NBIC as guides. Light scale observed on watersides, and light debris on the firesides. There was no evidence of leakage with 10 psi on the watersides. Boiler stopped running in the middle of testing safety devices. All safety devices tested functioned properly during the inspection process. No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a). Safety relief valve discharge should be piped back to glycol tank. Carbon Monoxide detector/alarm present.							
Inspector Commission 13373	Inspector Dale Brooks	Signature 					
Attachments Yes 2 Pages	Technical Manager Jerry Kuykendall	Signature 					

# Argent Inspections

## Form AI-03


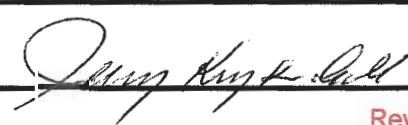
## Boiler Inspection Report

Inspection Date 11/18/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2028/2026	Next Strength Test	
Inspection Type(s) Performed						
<input checked="" type="checkbox"/> Internal <input checked="" type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness						
Customer 99th RSC R4C Z2 WV029 USARC Morgantown			Boiler Location Name and/or Building Number Mechanical Room			
Address 228 Comfort Inn Rd.			Boiler Location Address			
City Moigantown		State WV	Zip 26508-1501	City		
National Board # CA-1WV001A	Jurisdiction #	Property # 1A	Boiler Use Hot Water Heating Loop		Fuel Type N. Gas	
Manufacturer Weil McLain		Model # Ultra 750		Serial #		
Capacity 750,000 btu/hr		Design Pressure 80 psi	Operating Pressure 12-20 psi	Programmer Manufacturer Weil McLain	Burner Manufacturer Weil McLain	
Number of Safety Valves 1		Combustion Efficiency % CO2 ppm CO % Excess O2				
		Valve Manufacturer Watts	Size 3/4"	Set Pressure 30 psi	Capacity 925,000 btu/hr	Lift Pressure Hand
						Reseat Pressure Sat.
Safety Devices Tested Flame Rod, Low Gas Pressure Switch, High Gas Pressure Switch, Blocked Flue Switch, Combustion Air Switch by Speed of Blower Motor, Low Water Lockout, Operating Temperature Switch, Remote Emergency Switches, and the safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1 (d). It lifted freely and reseated with no leakage.						
Reason(s) for Declining Certification Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110(b)(2). No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a).						
Comments This boiler was inspected using ASME CSD-1 and NBIC as guides. Light scale observed on watersides, and light debris on the firesides. There was no evidence of leakage with 10 psi on the watersides. Technician did not have the code to test high temperature limit. Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110 (b)(2). All other safety devices tested functioned properly during the inspection process. No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a). Safety relief valve discharge should be piped back to glycol tank. Carbon Monoxide detector/alarm present.						
Inspector Commission 13373	Inspector Dale Brooks	Signature 				
Attachments Yes 2 Pages	Technical Manager Jerry Kuykendall	Signature 				

# Argent Inspections

## Form AI-03


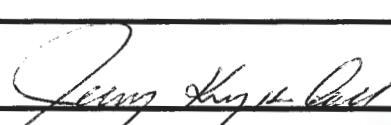
## Boiler Inspection Report

Inspection Date 11/18/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2028/2026	Next Strength Test	
Inspection Type(s) Performed <input checked="" type="checkbox"/> Internal <input checked="" type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness						
Customer 99th RSC R4C Z2 WV029 USARC Morgantown			Boiler Location Name and/or Building Number Mechanical Room			
Address 228 Comfort Inn Rd.			Boiler Location Address			
City Morgantown		State WV	Zip 26508-1501	City		
State WV		Zip 26508-1501		State	Zip	
National Board # CA-1WV002B	Jurisdiction #	Property # 2B	Boiler Use Hot Water Heating Loop		Fuel Type N. Gas	
Manufacturer Weil McLain		Model # Ultra 750		Serial #		
Capacity 750,000 btu/hr		Design Pressure 80 psi	Operating Pressure 12-20 psi	Programmer Manufacturer Weil McLain	Burner Manufacturer Weil McLain	
Number of Safety Valves 1		Combustion Efficiency % CO2 ppm CO % Excess O2 Flue Gas Temperature Degrees F				
Valve Manufacturer Watts		Size 3/4"	Set Pressure 30 psi	Capacity 925,000 btu/hr	Lift Pressure Hand	Reseat Pressure Sat.
Valve 1						
Valve 2						
Valve 3:						
Valve 4:						
Safety Devices Tested Flame Rod, Low Gas Pressure Switch, High Gas Pressure Switch, Blocked Flue Switch, Combustion Air Switch by Speed of Blower Motor, Low Water Lockout, Operating Temperature Switch, Remote Emergency Switches, and the safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1 (d). It lifted freely and reseated with no leakage.						
Reason(s) for Declining Certification Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110(b)(2). No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a).						
Comments This boiler was inspected using ASME CSD-1 and NBIC as guides. Light scale observed on watersides, and light debris on the firesides. There was no evidence of leakage with 10 psi on the watersides. Technician did not have the code to test high temperature limit. Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110 (b)(2). All other safety devices tested functioned properly during the inspection process. No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a). Safety relief valve discharge should be piped back to glycol tank. Carbon Monoxide detector/alarm present.						
Inspector Commission 13373	Inspector Dale Brooks	Signature 				
Attachments Yes 2 Pages	Technical Manager Jerry Kuykendall	Signature 				

# Argent Inspections

## Form AI-03

## Boiler Inspection Report

Inspection Date 11/18/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2028/2026	Next Strength Test
Inspection Type(s) Performed <input checked="" type="checkbox"/> Internal <input checked="" type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness					
Customer 99th RSC R4C Z2 WV029 USARC Morgantown			Boiler Location Name and/or Building Number Mechanical Room		
Address 228 Comfort Inn Rd.			Boiler Location Address		
City Morgantown		State WV	Zip 26508-1501	City	
State WV		Zip 26508-1501		State	Zip
National Board # CA-1WV003C	Jurisdiction #	Property # 3C	Boiler Use Hot Water Heating Loop		Fuel Type N. Gas
Manufacturer Weil McLain		Model # Ultra 750		Serial #	
Capacity 750,000 btu/hr		Design Pressure 80 psi		Operating Pressure 12-20 psi	Programmer Manufacturer Weil McLain
Burner Manufacturer Weil McLain		Flue Gas Temperature Degrees F			
Number of Safety Valves 1	Combustion Efficiency % CO2 ppm CO % Excess O2				
Valve 1	Valve Manufacturer Watts	Size 3/4"	Set Pressure 30 psi	Capacity 925,000 btu/hr	Lift Pressure Hand
Valve 2					Sat.
Valve 3:					
Valve 4:					
Safety Devices Tested Flame Rod, Low Gas Pressure Switch, High Gas Pressure Switch, emergency stop switch, and the safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1 (d). It lifted freely and reseated with no leakage.					
Reason(s) for Declining Certification Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110(b)(2). Boiler went into standby in the middle of testing safety devices. Unable to complete safety device testing as required by ASME CSD-1 Part CM-110(b). No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a).					
Comments This boiler was inspected using ASME CSD-1 and NBIC as guides. Light scale observed on watersides, and light debris on the firesides. There was no evidence of leakage with 10 psi on the watersides. Boiler went into standby in the middle of testing safety devices, could not complete controls testing. All safety devices tested functioned properly during the inspection process with the exception of the remote emergency stop. No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a). Carbon Monoxide detector/alarm present.					
Inspector Commission 13373	Inspector Dale Brooks	Signature 			
Attachments Yes 3 Pages	Technical Manager Jerry Kuykendall	Signature 			

# Argent Inspections

## Form AI-03

## Boiler Inspection Report

Inspection Date 11/18/2025	Certificate Issued No	Expiration Date	Prepared for Inspection Yes	Next Watersides/Firesides 2028/2026	Next Strength Test	
Inspection Type(s) Performed						
<input checked="" type="checkbox"/> Internal <input checked="" type="checkbox"/> Watersides <input checked="" type="checkbox"/> Firesides <input checked="" type="checkbox"/> External/Operational <input checked="" type="checkbox"/> Pressure Test <input type="checkbox"/> Strength <input checked="" type="checkbox"/> Tightness						
Customer 99th RSC R4C Z2 WV029 USARC Morgantown			Boiler Location Name and/or Building Number Mechanical Room			
Address 228 Comfort Inn Rd.			Boiler Location Address			
City Morgantown		State WV	Zip 26508-1501	City		
State WV		Zip 26508-1501	City		State WV	Zip 26508-1501
National Board # CA-1WV004D	Jurisdiction #	Property # 4D	Boiler Use Hot Water Heating Loop		Fuel Type N. Gas	
Manufacturer Weil McLain		Model # Ultra 750		Serial #		Year Built
Capacity 750,000 btu/hr		Design Pressure 80 psi	Operating Pressure 12-20 psi	Programmer Manufacturer Weil McLain		Burner Manufacturer Weil McLain
Number of Safety Valves 1		Combustion Efficiency % CO2 ppm CO % Excess O2				Flue Gas Temperature Degrees F
Valve 1	Valve Manufacturer Watts	Size 3/4"	Set Pressure 30 psi	Capacity 925,000 btu/hr	Lift Pressure Hand	Reseat Pressure Sat.
Valve 2						
Valve 3:						
Valve 4:						
Safety Devices Tested Flame Rod, Low Gas Pressure Switch, High Gas Pressure Switch, emergency stop switch, and the safety valve was lifted by hand per NBIC Part 2 para. 2.5.7.1(d). It lifted freely and reseated with no leakage.						
Reason(s) for Declining Certification Remote emergency stops did not shut boiler down as required by ASME CSD-1 Part CE-110(b)(2). Boiler went into standby in the middle of testing safety devices. Unable to complete safety device testing as required by ASME CSD-1 Part CM-110(b). No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a).						
Comments This boiler was inspected using ASME CSD-1 and NBIC as guides. Light scale observed on watersides, and light debris on the firesides. There was no evidence of leakage with 10 psi on the watersides. Boiler went into standby in the middle of testing safety devices, and could not complete controls testing. All safety devices tested functioned properly during the inspection process with the exception of the remote emergency stop. No lockable disconnect installed as required by ASME CSD-1 Part CE-110 Para. (a). Carbon Monoxide detector/alarm present.						
Inspector Commission 13373	Inspector Dale Brooks	Signature <i>Dale O. Brooks</i>				
Attachments Yes 3 Pages	Technical Manager Jerry Kuykendall	Signature <i>Jerry Kuykendall</i>				