

PM-MO-10855

PAGE 1 OF 2

PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST
LIGHTING, OUTSIDE

SITE AND BLDG #: NY128 Military Parking

MECHANIC
SIGNATURE:

Dave Ruppel

DATE: 12/28/2018

LOCATION/RM #: GATED WO# 1405 ASSET # 10855
PARKING LOT

START TIME:

FINISH TIME:

				NOTES/ACTIONS
1	In addition to the procedure(s) outlined in this standard, the equipment manufacturer's recommended maintenance procedure(s) and/or instruction(s) shall be strictly adhered to.	X		
2	Schedule and coordinate work with operating personnel.	X		
3	Follow lock out/tag out procedures at all times. De-energize or discharge all hydraulic, electrical, mechanical, or thermal energy prior to beginning work.	X		
1	Open and tag switch.		X	
2	Inspect visual condition of wiring. Look for evidence of overheating.		X	
3	Check for proper light operation.	X		
4	Test operation of automatic switches/ time clock/ photocells if applicable.	X		
5	Inspect light pole and mounting devices for deficiencies.	X		
6	For any noted deficiency, takes pictures and open corrective maintenance ticket.	X		

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and direct material cost) per PM occurrence. For any deficiencies found exceeding \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed description of the deficiency.



To be performed by: General Maintenance Worker

Additional Notes:

15 Pole Lights at dark do not illuminate (5:15pm 12/28/2018)

SEE PAGE 2

OFF = 15 Pole Lights

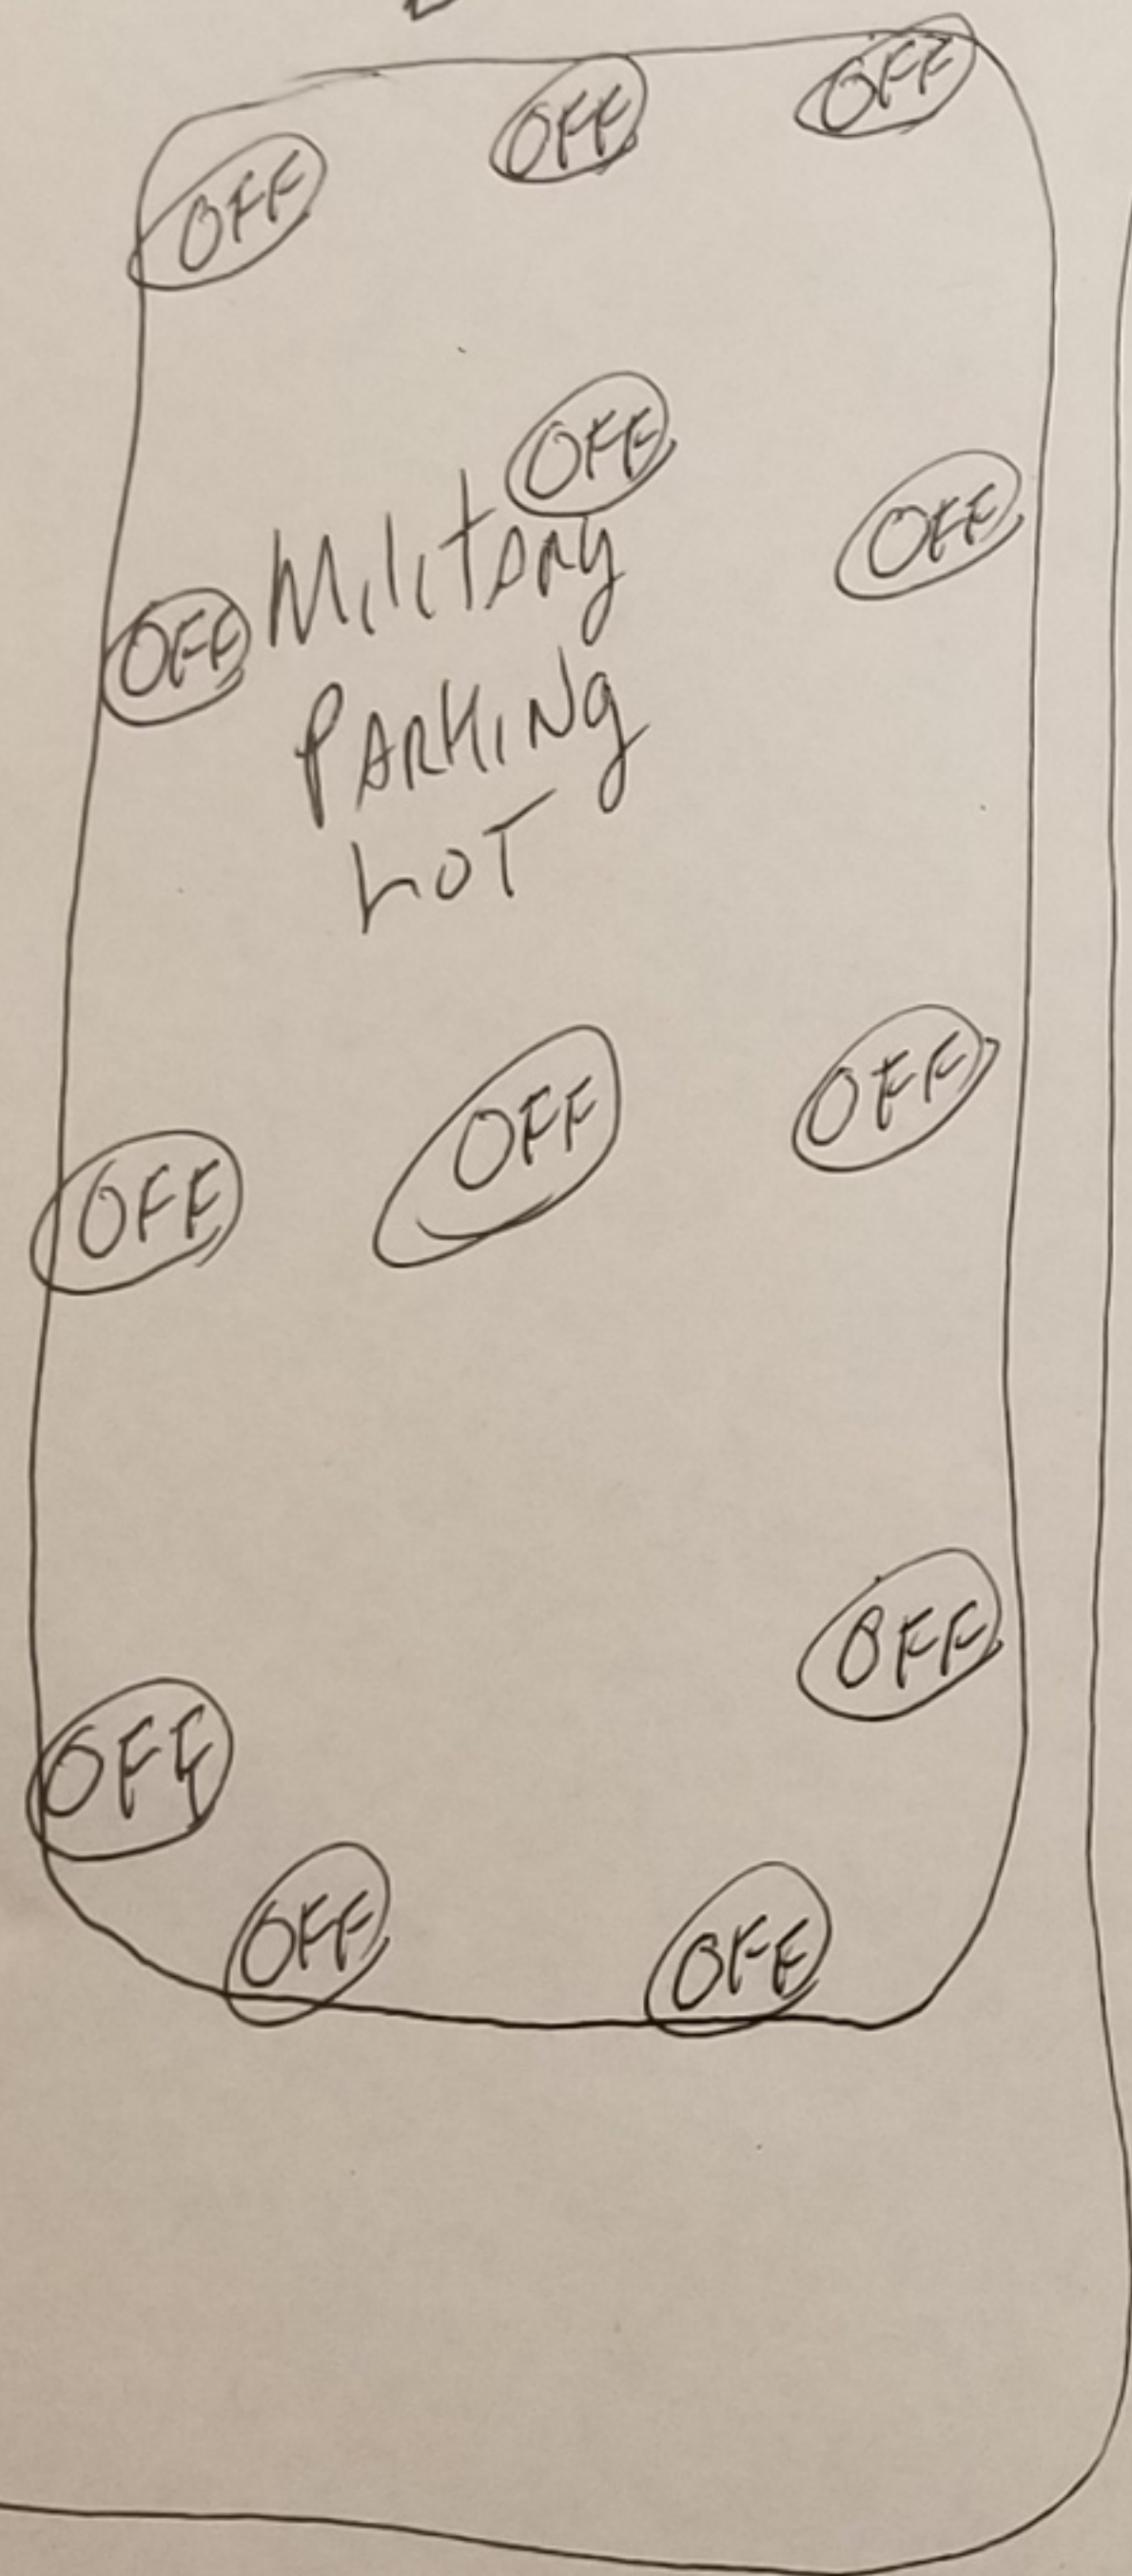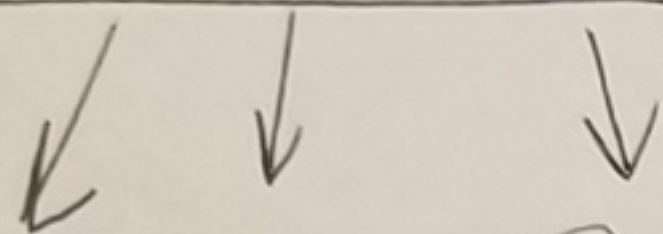


ON ON

Total Pole Light Units
(27)

OFF
OFF

ON = 11 Pole Lights
OFF = 1 POV Pole Light

12/28/18
5:15 pm

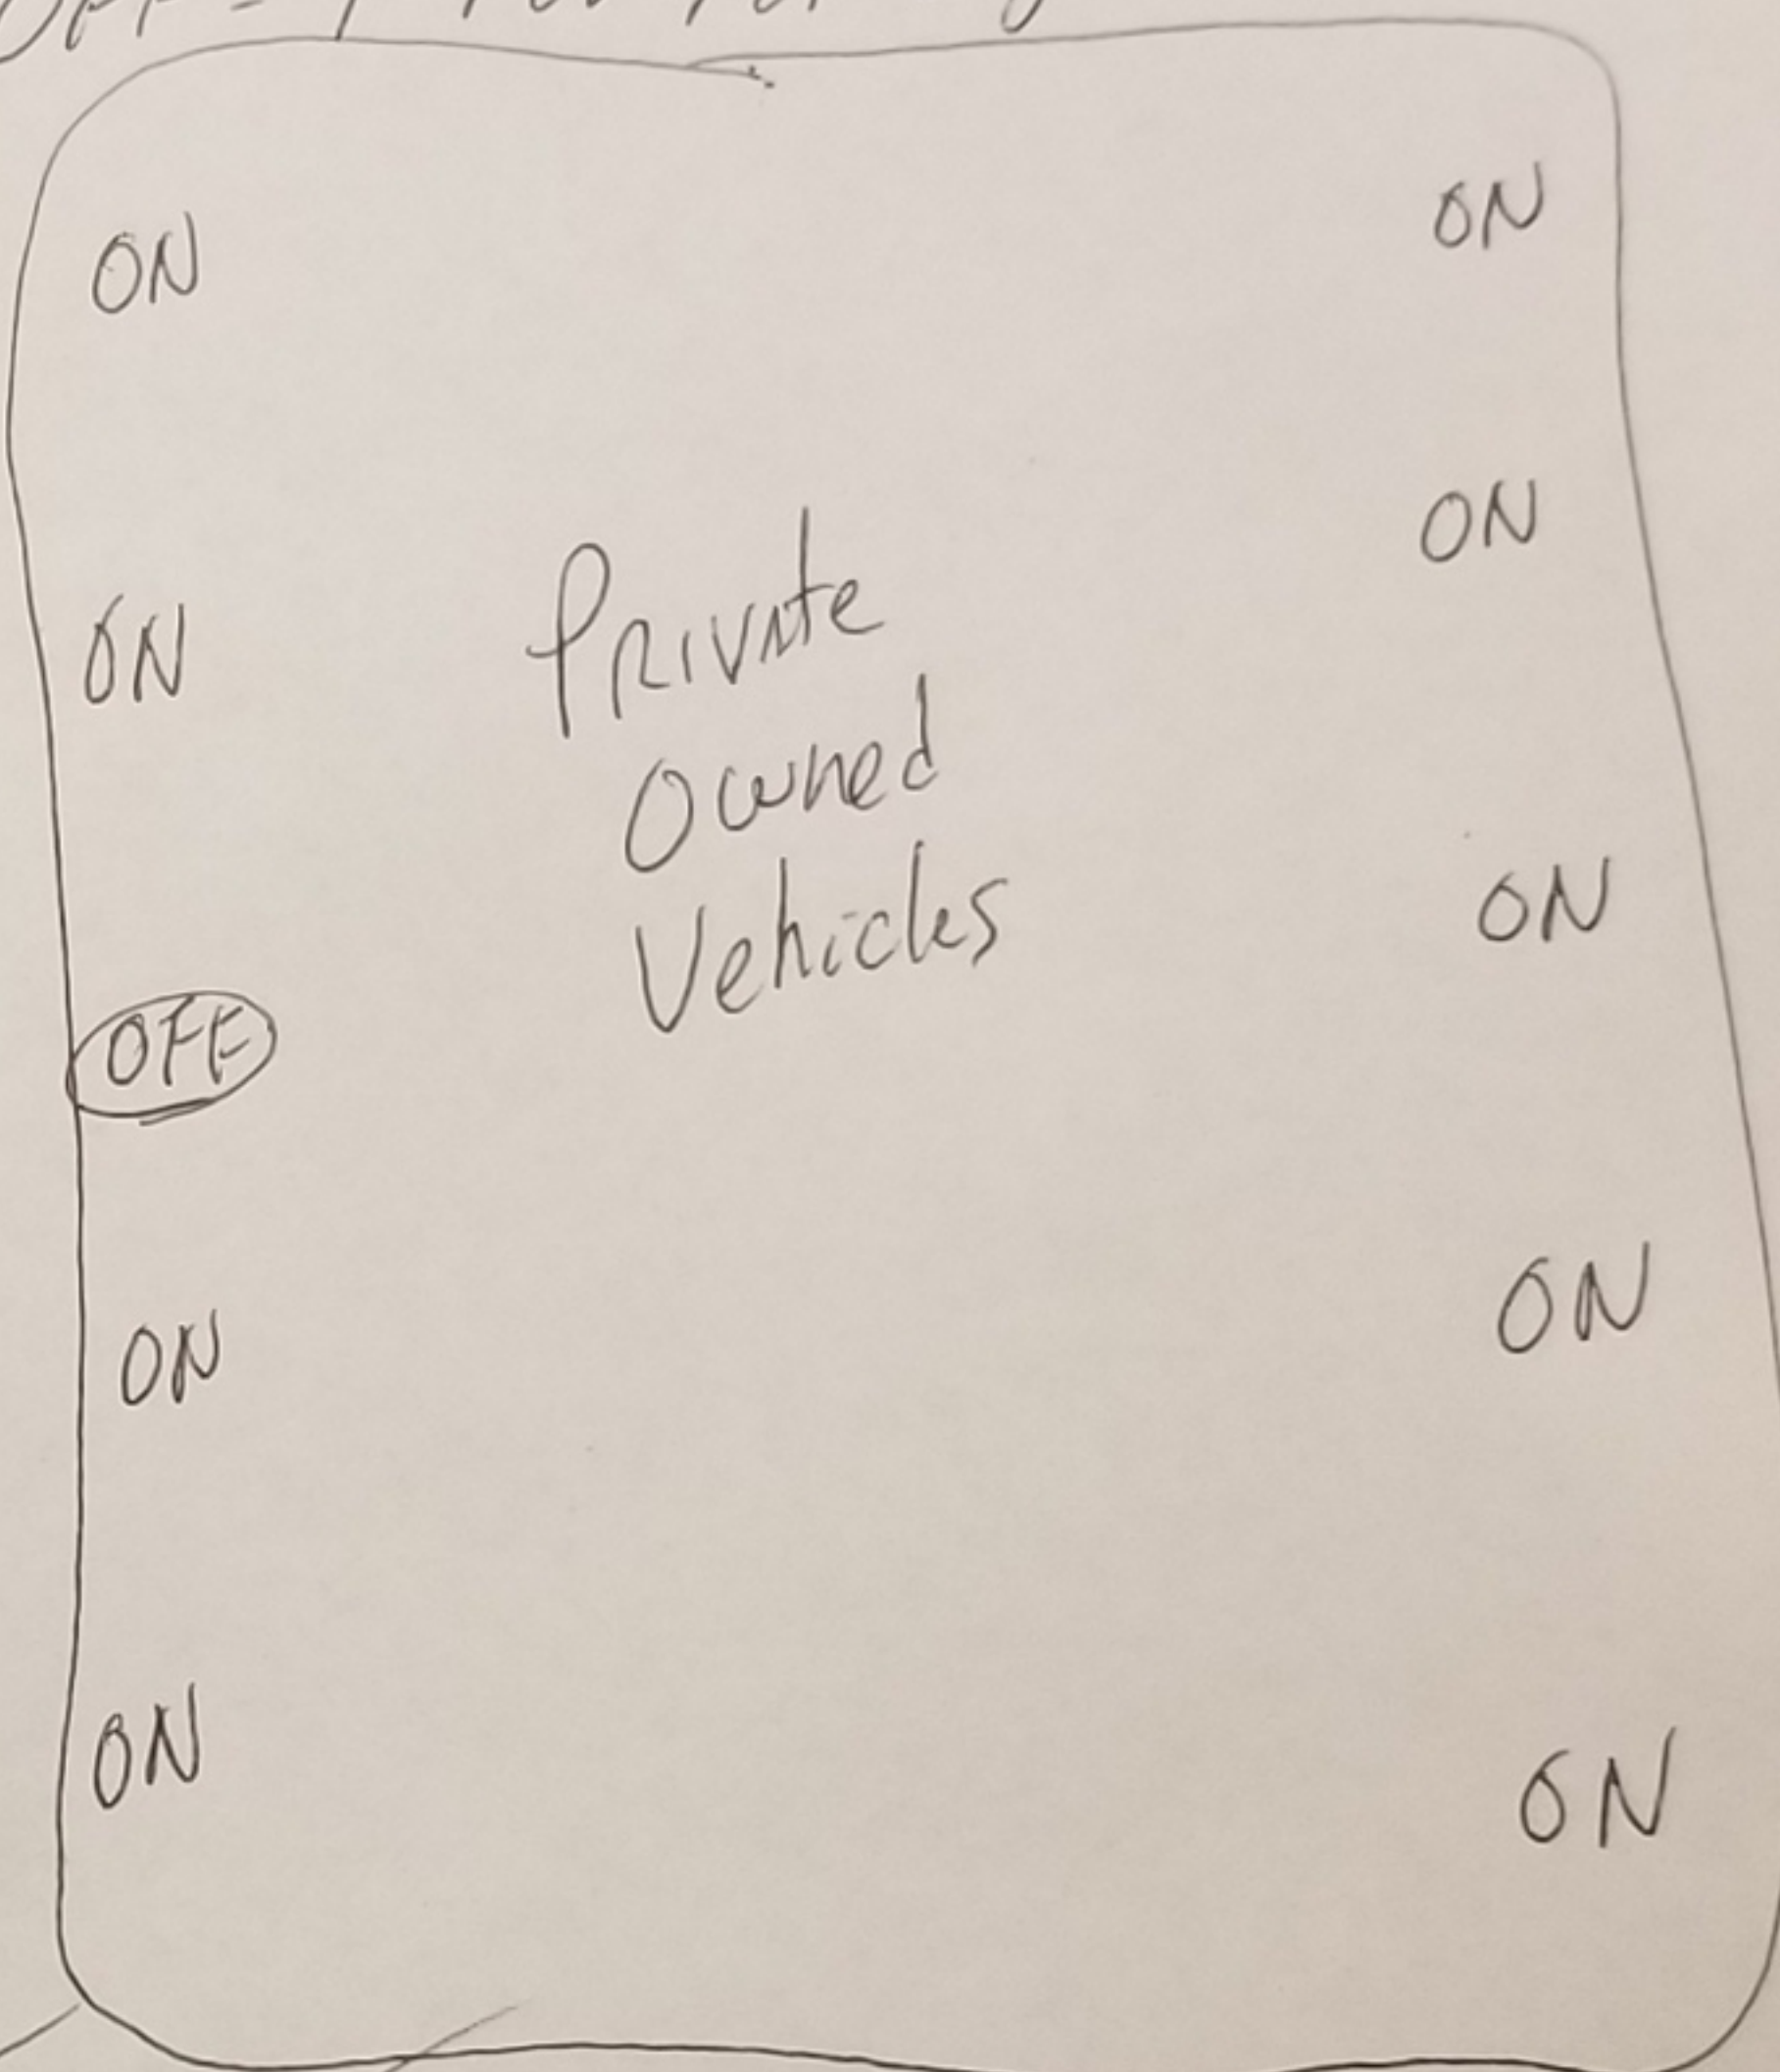

KING'S H-WAY