

PM-SA-10854

Page 1 of 2

PREVENTATIVE MAINTENANCE PROGRAM CHECKLIST
LIGHTING, OUTSIDE

SITE AND BLDG #: NY128 POV Parking

MECHANIC
SIGNATURE:

David Ruppel

DATE:

12/28/2018

LOCATION/RM #: Ungated Parking Lot WO# 1558 ASSET # 10854

START TIME:

FINISH TIME:



1	In addition to the procedure(s) outlined in this standard, the equipment manufacturer's recommended maintenance procedure(s) and/or instruction(s) shall be strictly adhered to.	X		
2	Schedule and coordinate work with operating personnel.	X		
3	Follow lock out/tag out procedures at all times. De-energize or discharge all hydraulic, electrical, mechanical, or thermal energy prior to beginning work.	X		
1	Open and tag switch.		X	
2	Inspect visual condition of wiring. Look for evidence of overheating.		X	
3	Check for proper light operation.	X		
4	Test operation of automatic switches/ time clock/ photocells if applicable.	X		
5	Inspect light pole and mounting devices for deficiencies.	X		
6	For any noted deficiency, takes pictures and open corrective maintenance ticket.	X		

Note: The technician shall perform any repairs identified during PM up to \$250 (direct labor and direct material cost) per PM occurrence. For any deficiencies found exceeding \$250 open a corrective maintenance (CM) ticket and include the Asset #, WO #, photos, and a detailed description of the deficiency.
To be performed by: General Maintenance Worker

Additional Notes:

- 1 of 10 POV POLE LIGHTS ARE OUT OR NOT ILLUMINATING @ 5:15pm on date on this PM
- SEE PAGE 2

OFF = 15 Pole Lights

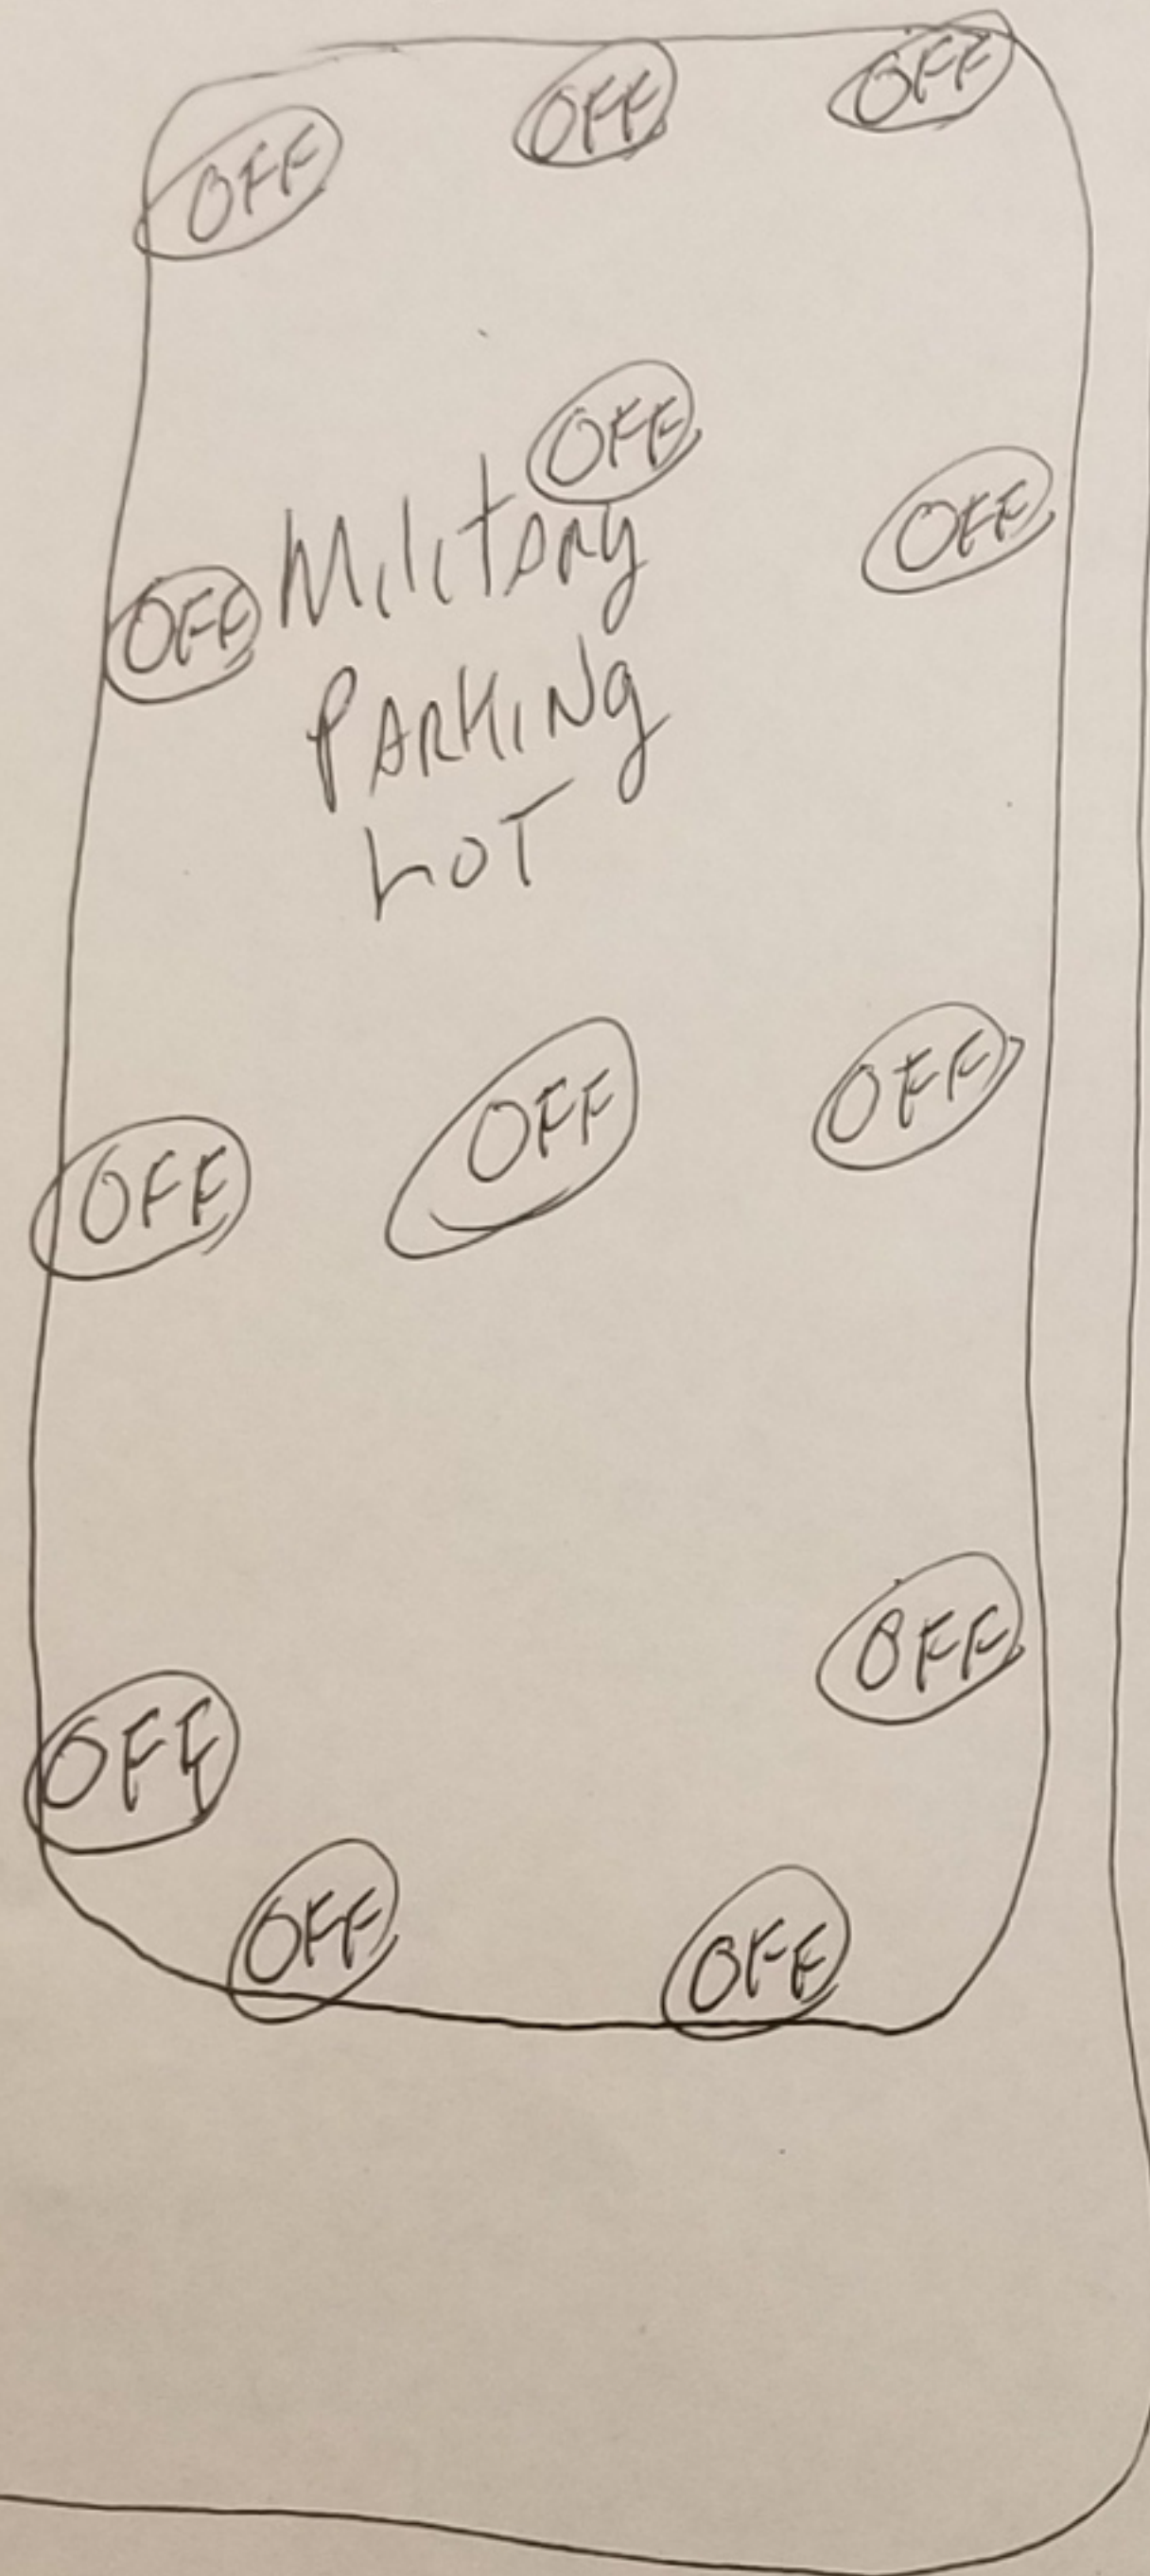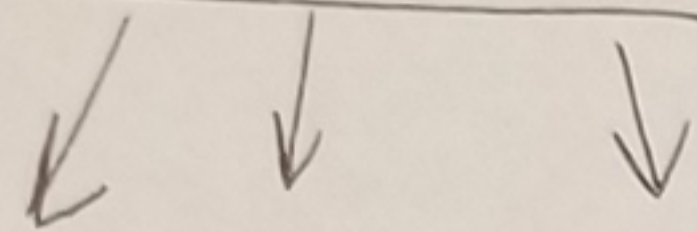

ON

ON

Total Pole Light Units


27

OFF

OFF

ON = 11 Pole Lights
OFF = 1 POV Pole Light

12/28/18
5:15 pm

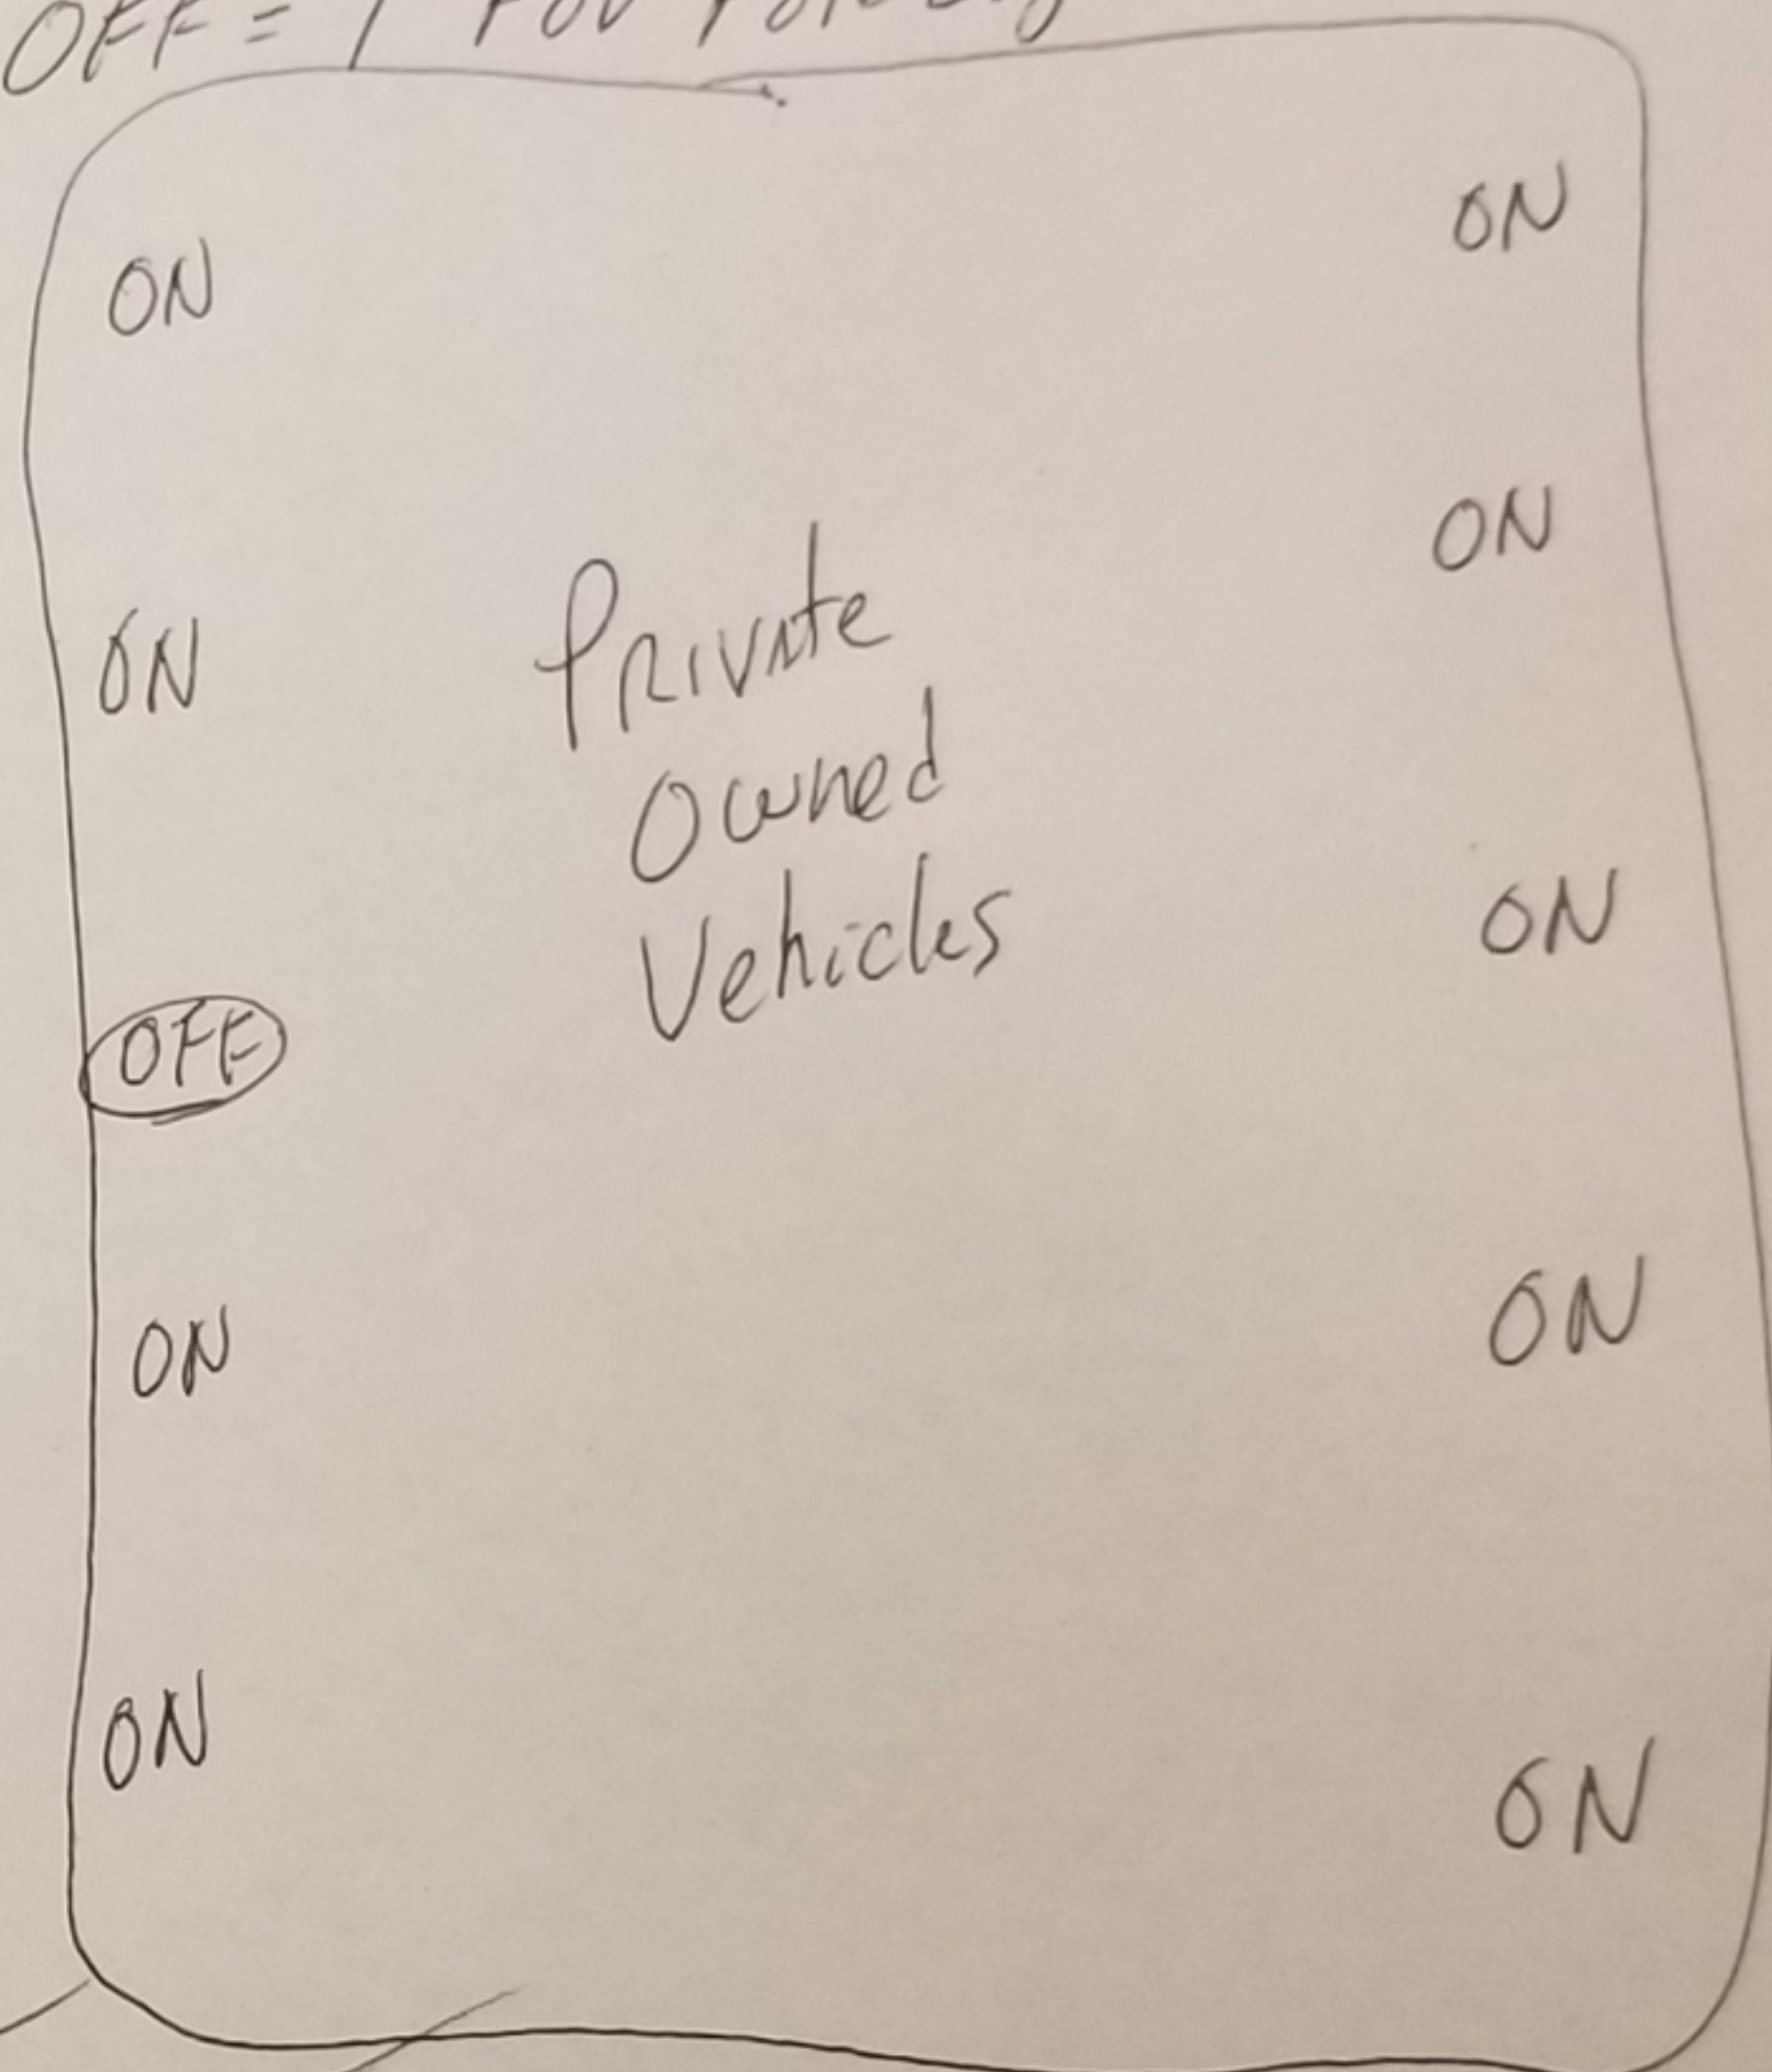

KING'S H-WAY